


Sign Type:

RE-01

Building
Information
Levels 1-4

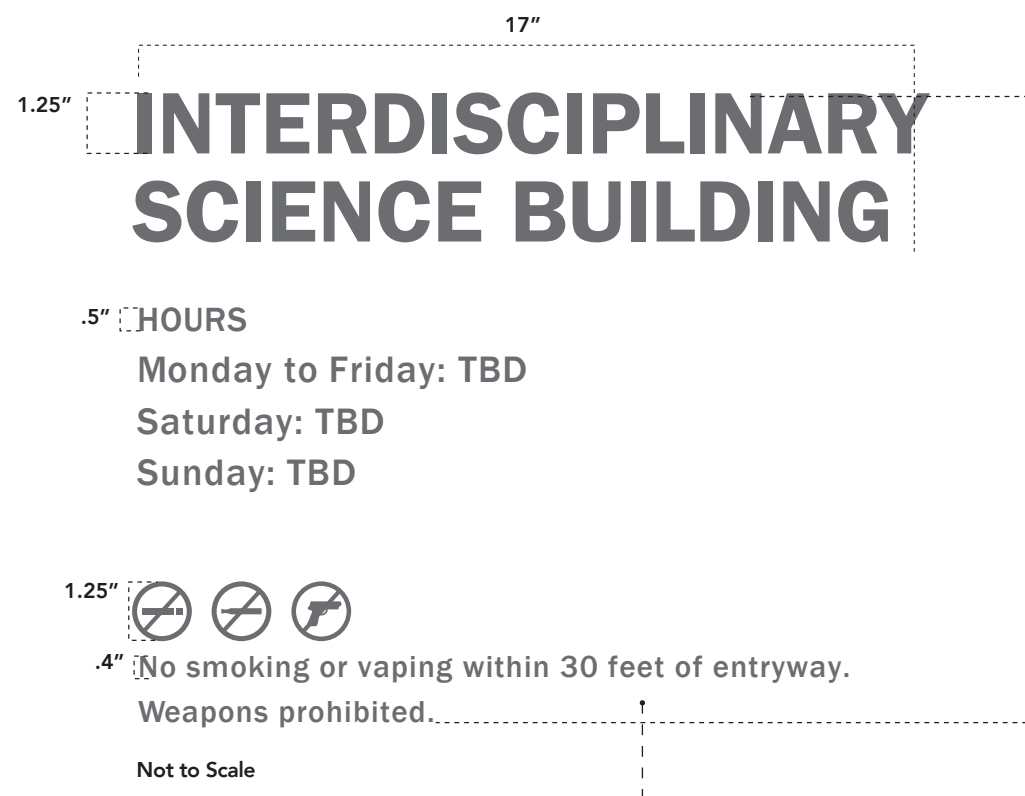

EXTERIOR TRANSLUCENT GRAPHIC FILM / VINYL
CUT AND INSTALLED ON INTERIOR SIDE OF GLASS
BASIS OF DESIGN PRODUCT:
3M TRANSLUCENT FILMS 3630-020 WHITE

RE-01

Sign Type:


RI-01

Stairwell Evacuation
Levels 1-4

*FINAL ART WORK (TEXT AND
MAP LAYOUT AND ORIENTATION
LOCATED ON OVERALL SIGN
OUTLINE) FOR EACH UNIQUE SIGN
MESSAGE TO BE
PROVIDED BY KUHLMANN LEAVITT,
INC. PRIOR TO PRODUCTION.

*INSTALLATION SHOWN
OR BEST INSTALL METHOD FOR
SECURE ATTACHMENT.
FABRICATOR RESPONSIBLE FOR
INTEGRITY OF INSTALLATION
METHOD.

*SEE PROJECT MANUAL SECTION
101400 FOR SAMPLE
REQUIREMENTS AND SPECIFICA-
TIONS.

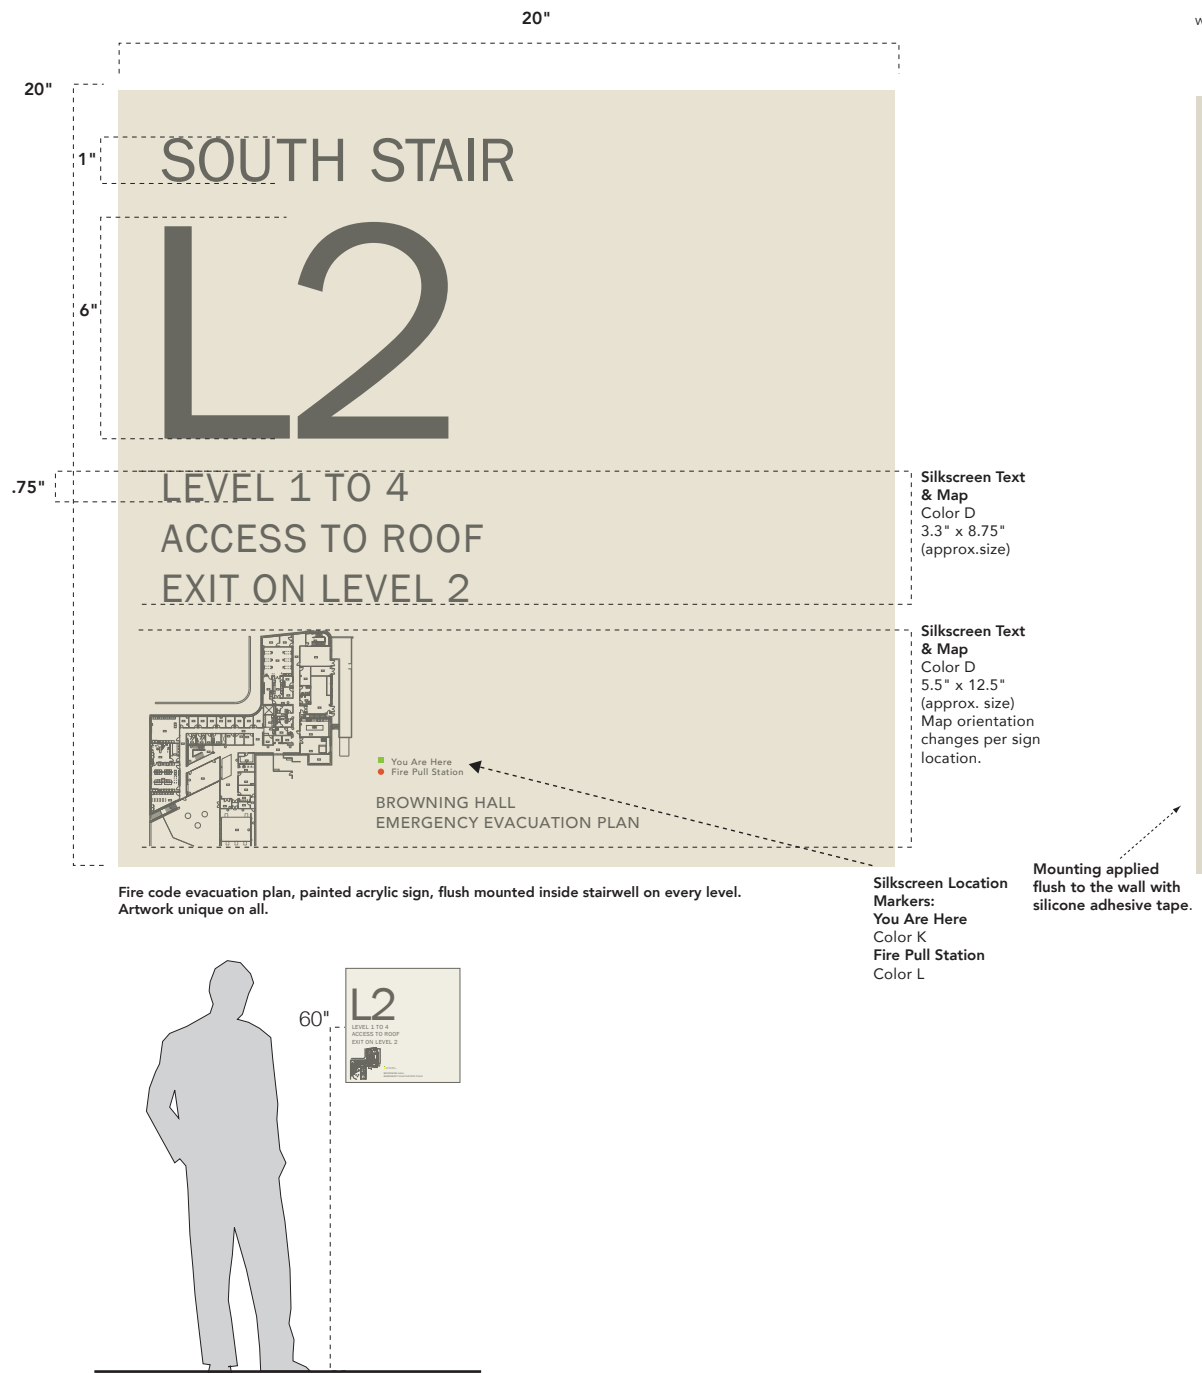

RI-01

Sign Type:

RI-02

Regulatory Messages
Levels 1-4

* FINAL ART WORK (TEXT LAYOUT ON DOOR)
TO BE PROVIDED BY KUHLMANN LEAVITT, INC.
PRIOR TO PRODUCTION.


* FINAL COLOR SELECTED WITH COLOR
SAMPLE REVIEW.

* SEE PROJECT MANUAL SECTION 101400
FOR SAMPLE REQUIREMENTS.

* REFERENCE ARCHITECTURAL
DRAWINGS FOR DOOR PAINT
SCHEDULE.



scale : 1/4" = 1'

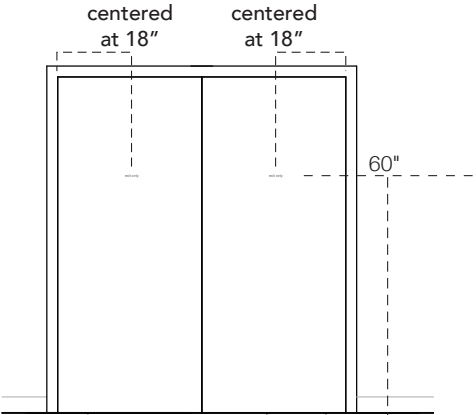

RI-02

Sign Type:

RI-03

Elevator Evacuation
Levels 1-4

*FINAL ART WORK (TEXT AND MAP
LAYOUT AND ORIENTATION LOCATED
ON OVERALL SIGN OUTLINE) FOR
EACH UNIQUE SIGN MESSAGE TO BE
PROVIDED BY KUHLMANN LEAVITT, INC.
PRIOR TO PRODUCTION.

*INSTALLER TO COORDINATE WITH
CONTRACTOR/ELEVATOR
MANUFACTURER FOR CALL PANEL
SILKSCREENING.

*SEE PROJECT MANUAL SECTION
101400 FOR SAMPLE REQUIREMENTS
AND SPECIFICATIONS.



FIRE CODE EVACUATION PLAN, ELEVATOR CALL
PANELS, EVERY LEVEL. ARTWORK UNIQUE ON ALL
CALL PANEL FINISH PER ELEVATOR SPECIFICATIONS
ARTWORK 3-COLOR SILKSCREEN (1ST SURFACE).
SILK SCREENED MAPS AND DIRECTIONAL
INFORMATION: COLOR C
YOU ARE HERE DOT: COLOR K
FIRE PULL STATION & EXIT ICON: COLOR L

RI-02

Sign Type:

RI-04


Maximum Occupancy
Levels 1-4

* FINAL ART WORK (TEXT) TO BE PROVIDED
BY KUHLMANN LEAVITT, INC. PRIOR TO
PRODUCTION.

*INSTALLATION SHOWN OR BEST INSTALL
METHOD FOR SECURE ATTACHMENT.
FABRICATOR RESPONSIBLE FOR INTEGRITY
OF INSTALLATION METHOD.

*PROVIDE BLOCKING AS NEEDED.

*SEE PROJECT MANUAL SECTION 101400
FOR SAMPLE REQUIREMENTS AND
SPECIFICATIONS.

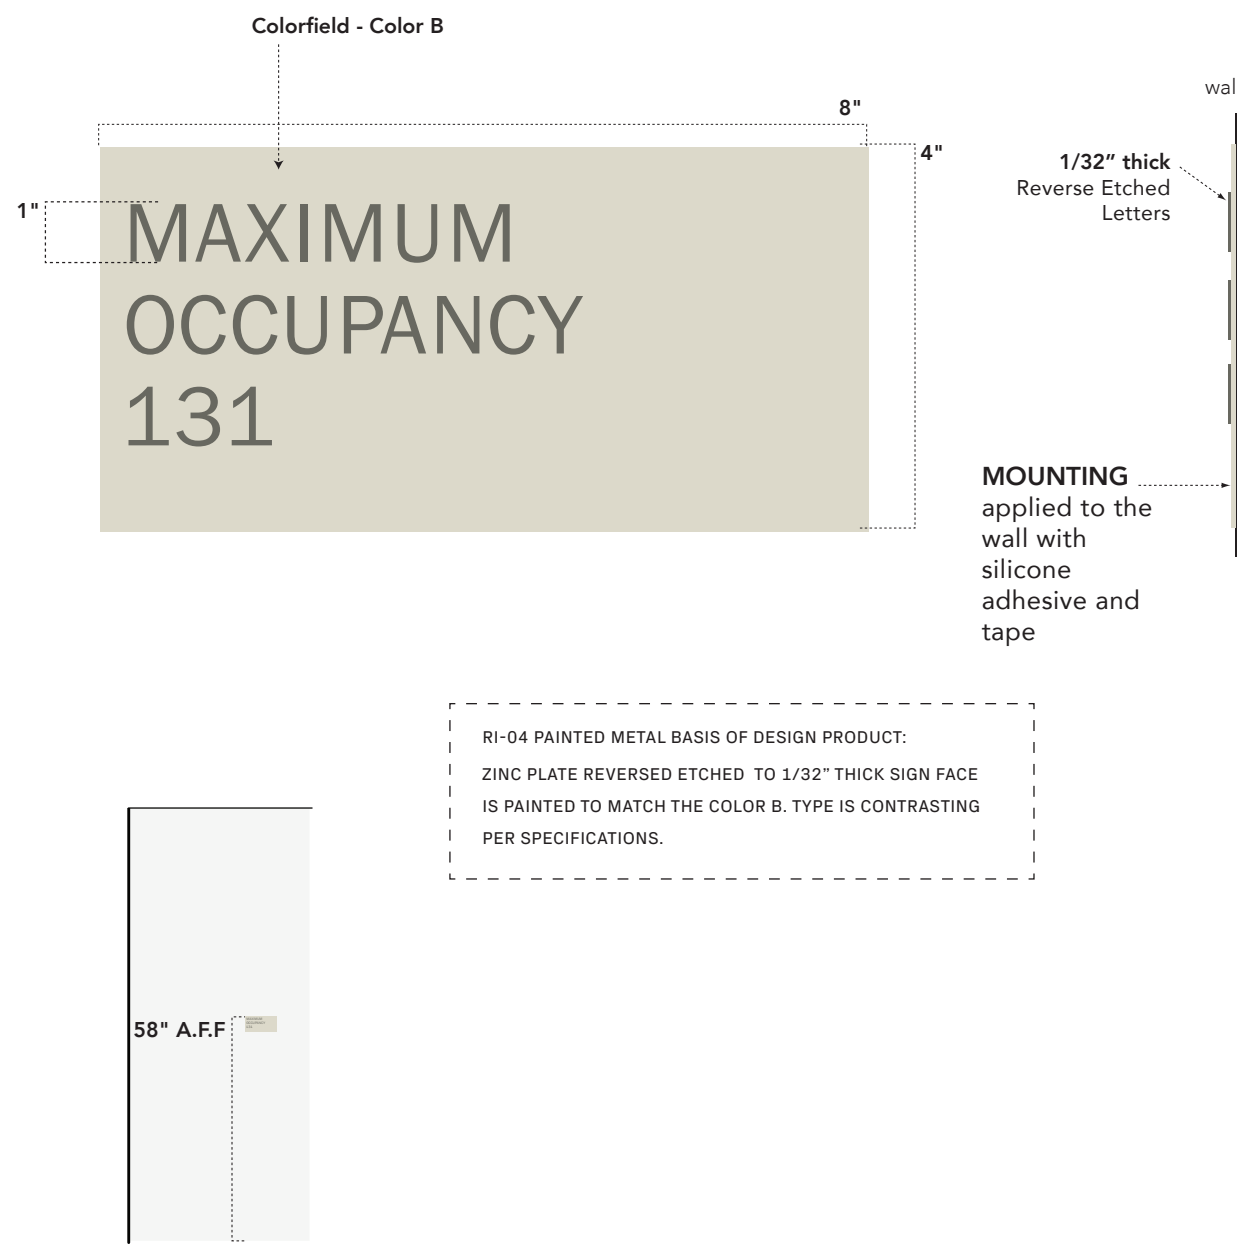

RI-02