



KEYED NOTES: (THIS SHEET ONLY)

- 1 PROVIDE CONCEALED DRY-PENDANT SPRINKLER HEAD AT THIS LOCATION.
- 2 COORDINATE LOCATION OF SPRINKLER HEADS WITH SUSPENDED LUMINAIRES. REFER TO THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
- 3 THIS AREA IS DESIGNATED AS ORDINARY HAZARD, GROUP 1
- 4 PIPE TO BE OFF-SET ABOVE THE CEILING ON THE LEVEL TO LEVEL 3.
- 5 COORDINATE LOCATION OF SPRINKLERS IN THIS ROOM WITH THE ELECTRICAL EQUIPMENT AND OVERHEAD RACEWAY. HOLD PIPING AS HIGH AS POSSIBLE. PROVIDE INTERMEDIATE TEMPERATURE RATED SPRINKLER HEAD.
- 6 RECESSED FIRE HOSE VALVE CABINET WITH 2.5 INCH ANGLE FIRE HOSE VALVE, CAP AND CHAIN. REFER TO THE ARCHITECTURAL DRAWINGS FOR THE EXACT LOCATION.
- 7 CONTRACTOR TO REVIEW ARCHITECTURAL DRAWING FOR RECESSED OR ELEVATED CEILING POCKETS. PROVIDE PROTECTION AS REQUIRED.
- 8 PROVIDE CONCEALED DRY-PENDANT SPRINKLER HEADS IN THE EXPOSED BUILDING OVERHANG CEILING. COVER PLATE OF THE SPRINKLER HEAD IS TO HAVE A FACTORY CUSTOM FINISH TO BE SELECTED BY THE ARCHITECT. OBTAIN SAMPLES FROM THE SPRINKLER MANUFACTURER OF THE TRUE COVER PLATE FINISHES AS DIRECTED BY THE ARCHITECT PRIOR TO ORDERING.
- 9 COORDINATE THE ROUTING OF THE SPRINKLER PIPING IN THIS SPACE WITH THE PRE-FABRICATED OPENING IN THE STRUCTURAL STEEL. LOCATIONS INDICATED ARE APPROXIMATE TO THE ROUTING OF HEATING PIPING IN SEPARATE OPENINGS AND ARE SHOWN FOR REFERENCE. REFER TO THE MECHANICAL DRAWINGS FOR LOCATIONS OF SUPPLY/RETURN PIPING AND HEATING ELEMENTS WITHIN THE OVERHANG.
- 10 STANDPIPE SUPPLY RISER FROM LEVEL 1 TO SERVE FIRE HOSE VALVE ON THIS LEVEL.

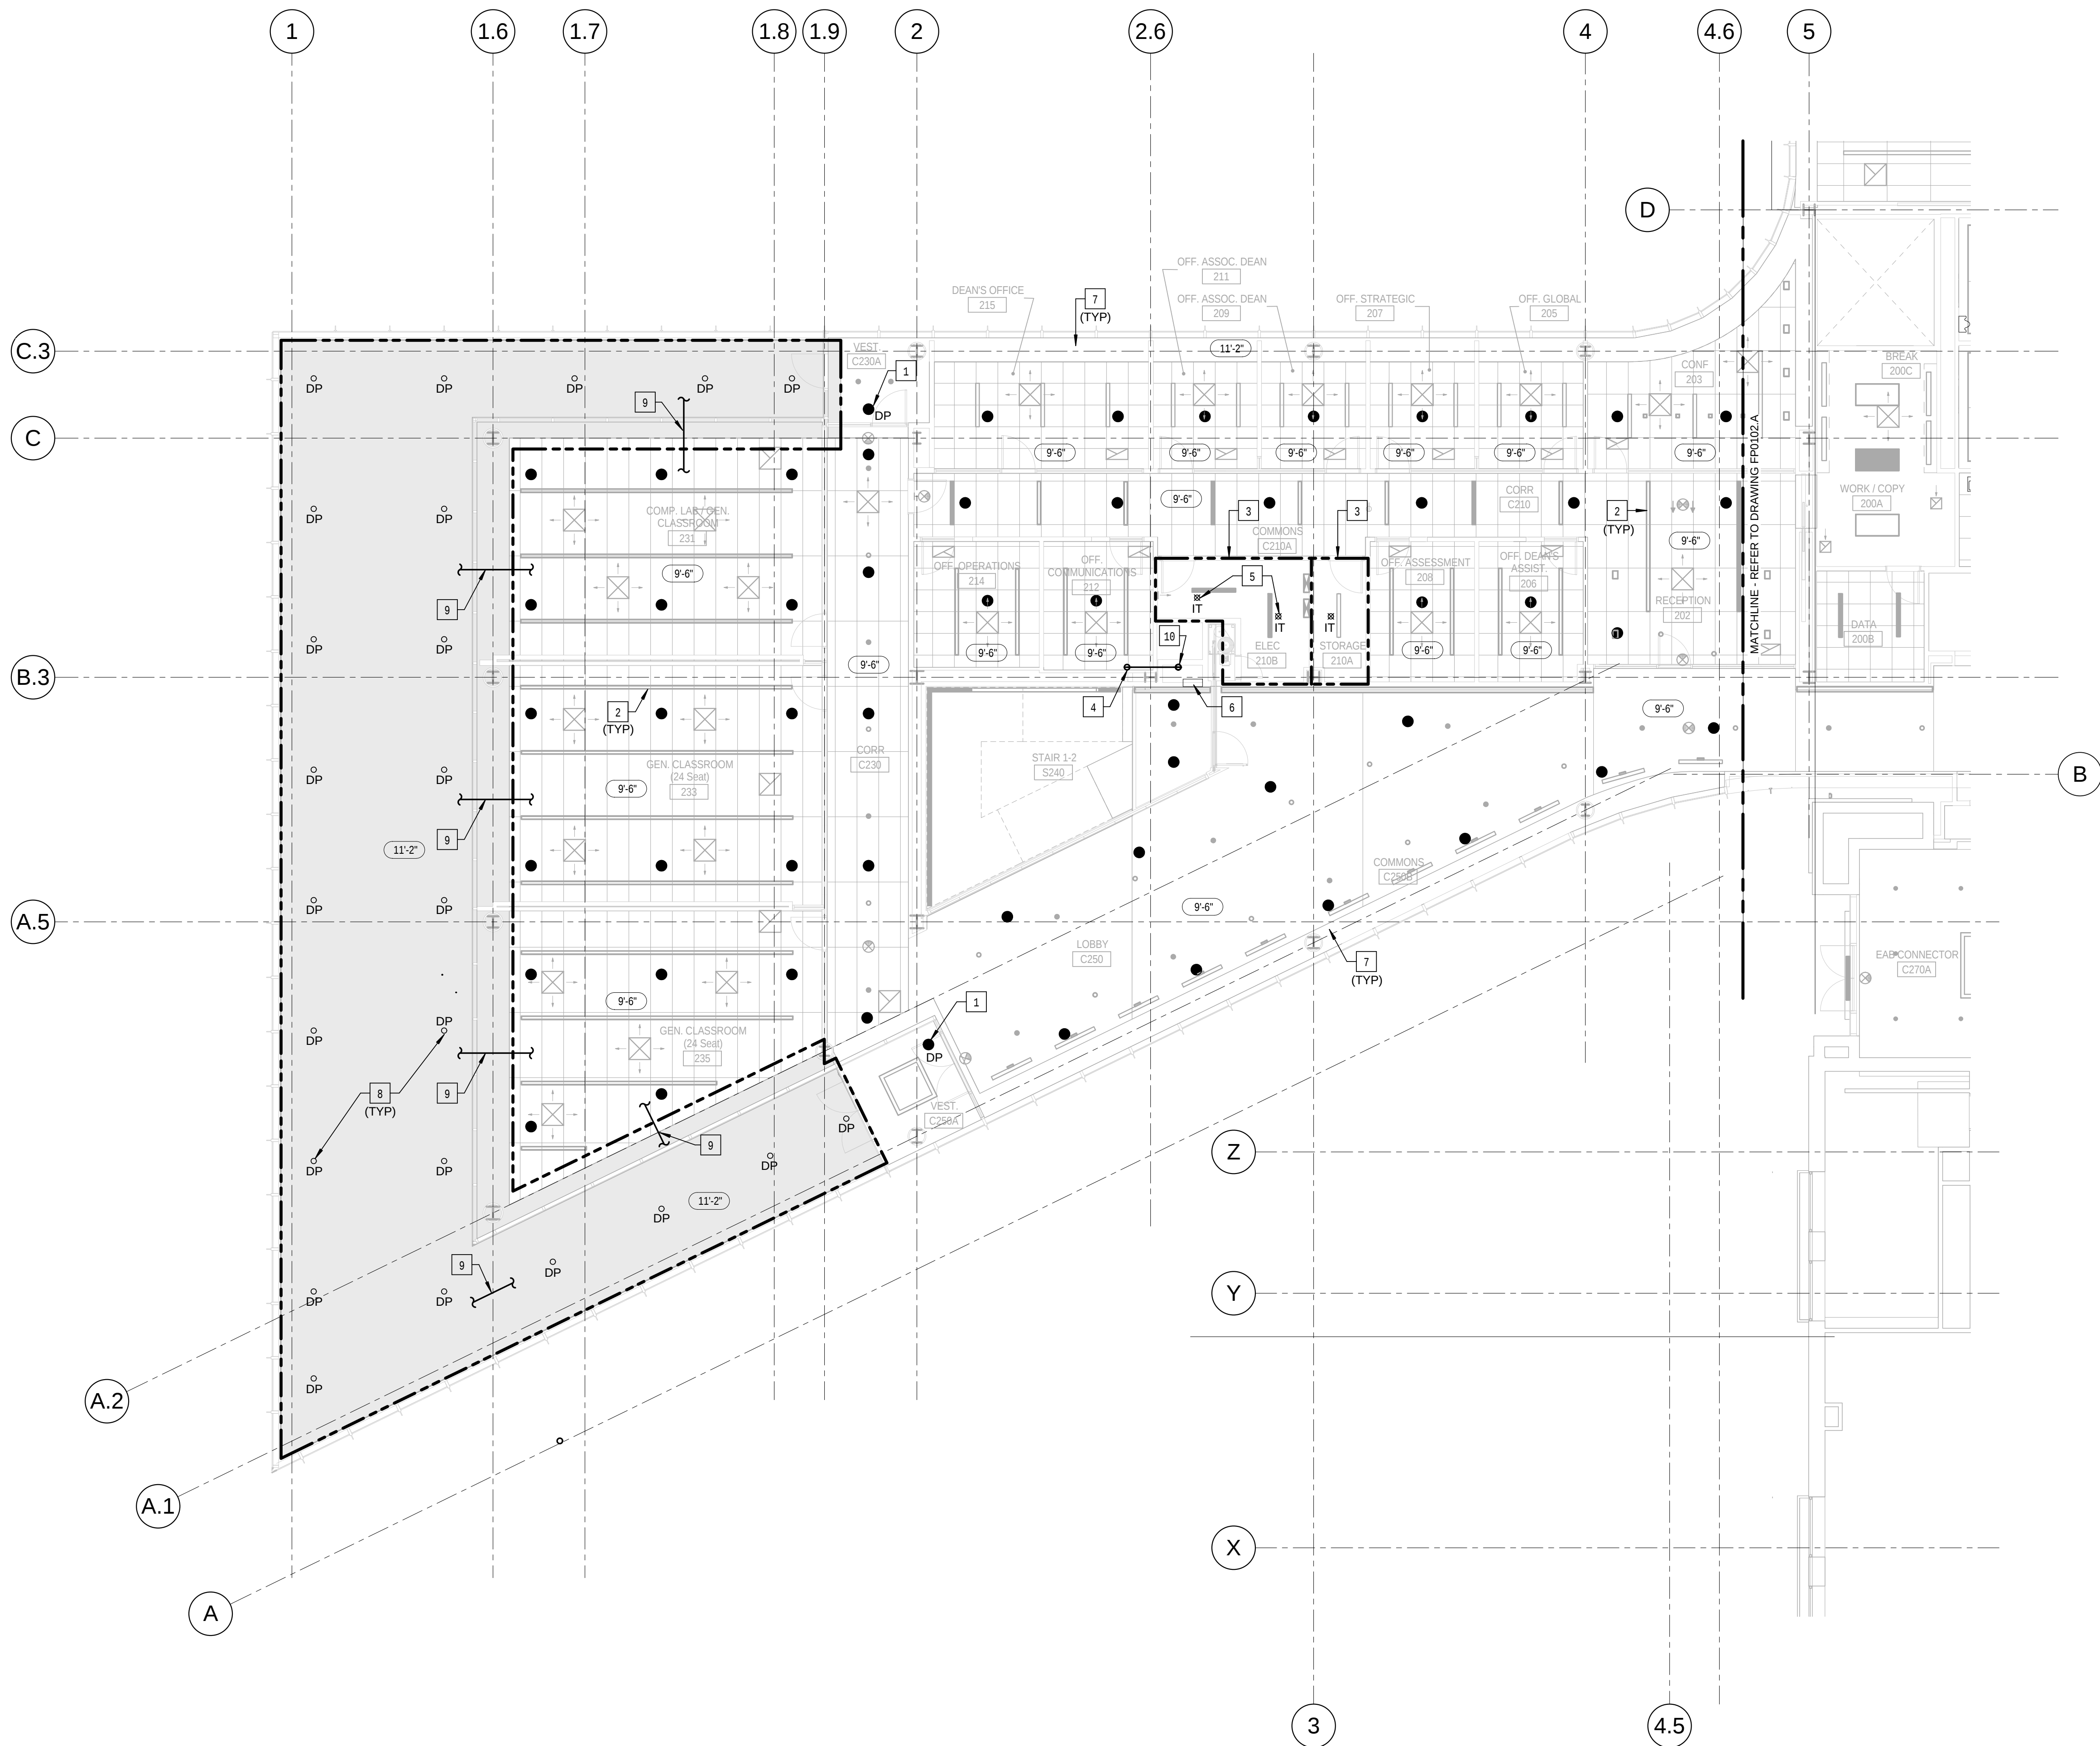

1 LEVEL 02 AREA B FLOOR PLAN - FIRE PROTECTION
1/8" = 1'-0"

ISSUED FOR CONSTRUCTION (BP2)		01 MAR 2016
No.	Description	Date

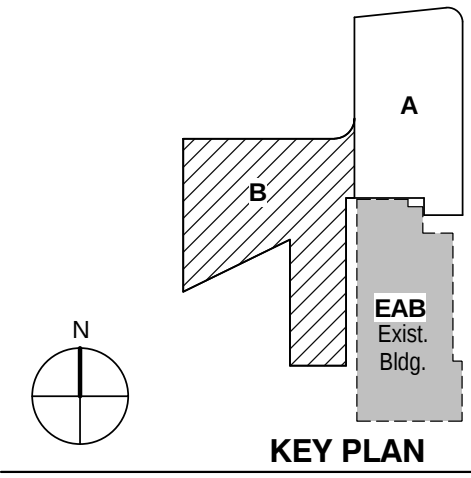

KEY PLAN

LEVEL 02 AREA B FLOOR
PLAN - FIRE PROTECTION

Project No.: 04561.01 Checked by:

FP0102.B