


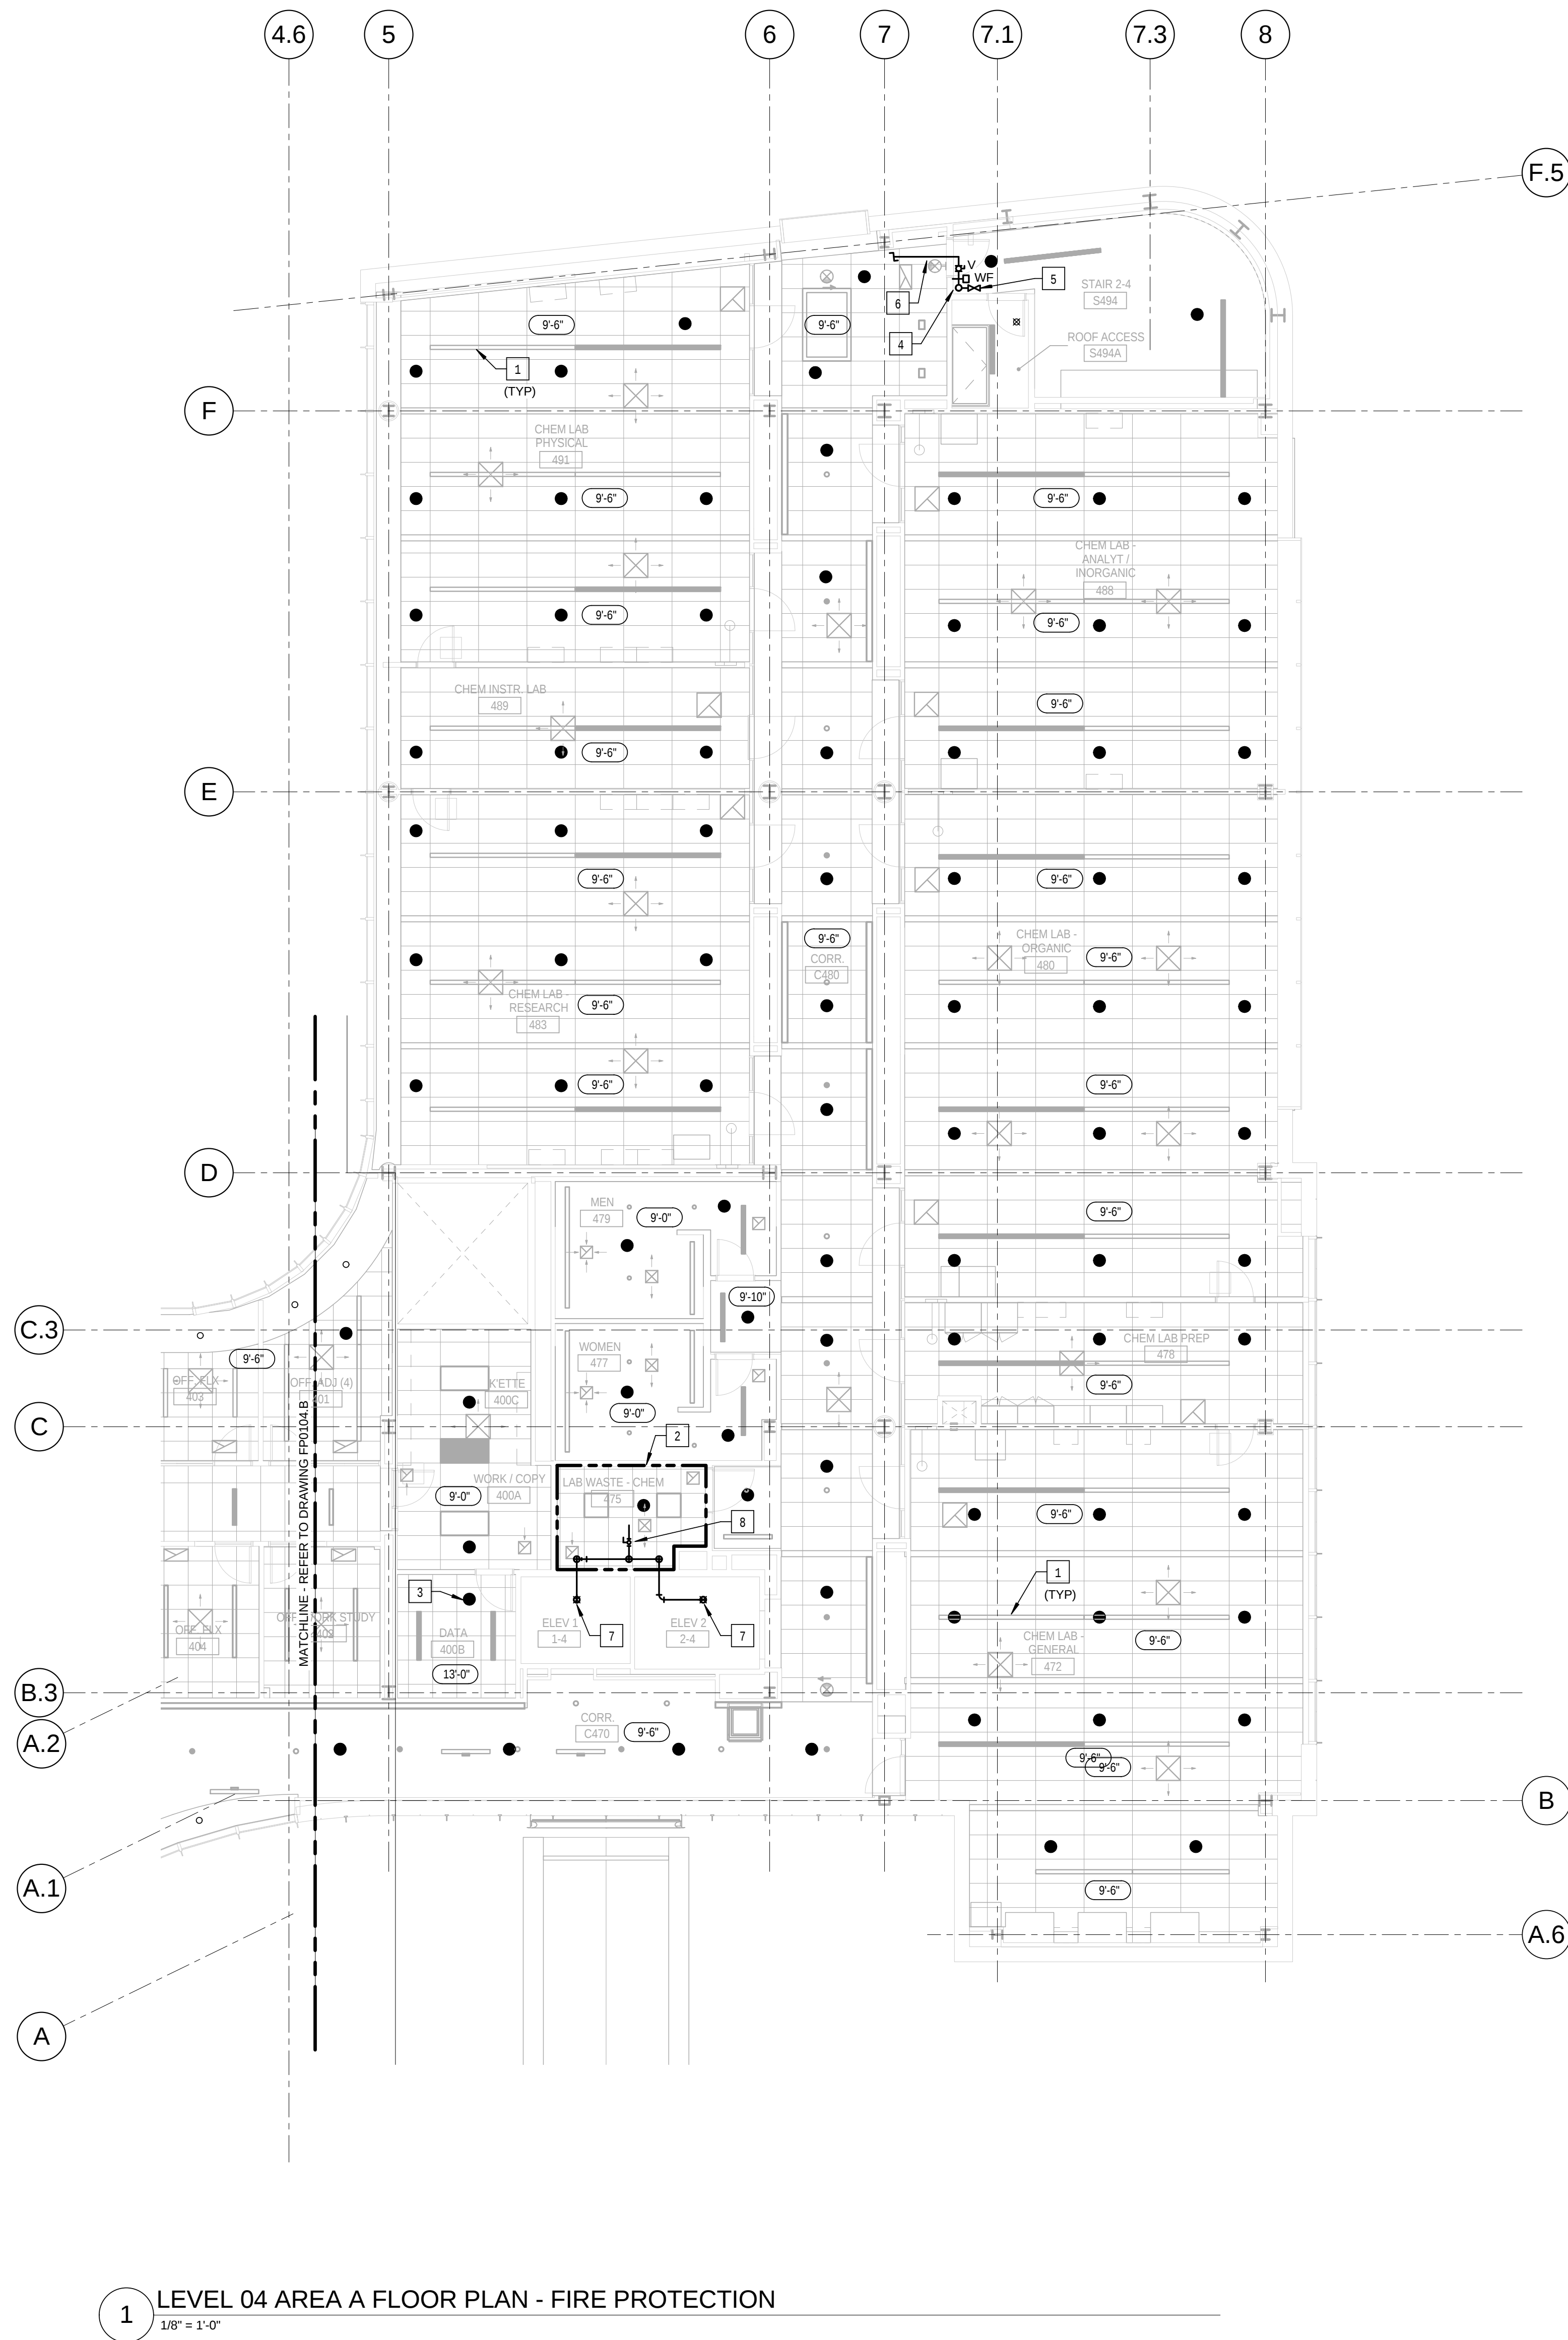


KEYED NOTES: (THIS SHEET ONLY)

1. COORDINATE LOCATION OF SPRINKLER HEADS WITH SUSPENDED LUMINARIES. REFER TO THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
2. THIS AREA IS DESIGNATED AS EXTRA HAZARD, GROUP 2.
3. PROVIDE A SPRINKLER HEAD IN THIS ROOM WITH A TEMPERATURE RATING OF 200°F OR GREATER. COORDINATE LOCATION OF THE SPRINKLER HEAD AND PIPING WITH THE EQUIPMENT LAYOUT, OVERHEAD CABLE TRAY AND RACEWAY. HOLD PIPING AS HIGH AS POSSIBLE.
4. FIRE SERVICE RISER, DRAIN PIPE TO BE RUN PARALLEL WITH SUPPLY RISER.
5. EXPOSED 2.5 INCH ANGLE FIRE DEPARTMENT HOSE VALVE, CAP AND CHAIN.
6. FIRE SPRINKLER TO EXTEND TO SERVE THIS LEVEL. PROVIDE MONITORED FLOOR ZONE CONTROL VALVE AND WATER FLOW SWITCH. REFER TO DRAWING FP0501, DETAIL 3 FOR PIPING CONFIGURATION AND REQUIREMENTS. PROVIDE ACCESS PANEL IN CEILING AS REQUIRED.
7. SPRINKLER HEAD AT TOP OF ELEVATOR HOISTWAY. COORDINATE WITH GENERAL CONTRACTOR FOR THE LOCATION OF THE SPRINKLER HEAD ROUTING OF PIPING AND PIPE PENETRATION OF THE HOISTWAY.
8. MONITORED ISOLATION VALVE ABOVE CEILING.

1 LEVEL 04 AREA A FLOOR PLAN - FIRE PROTECTION
1/8" = 1'-0"

ISSUED FOR CONSTRUCTION (BP2) 01 MAR 2016	
No.	Description

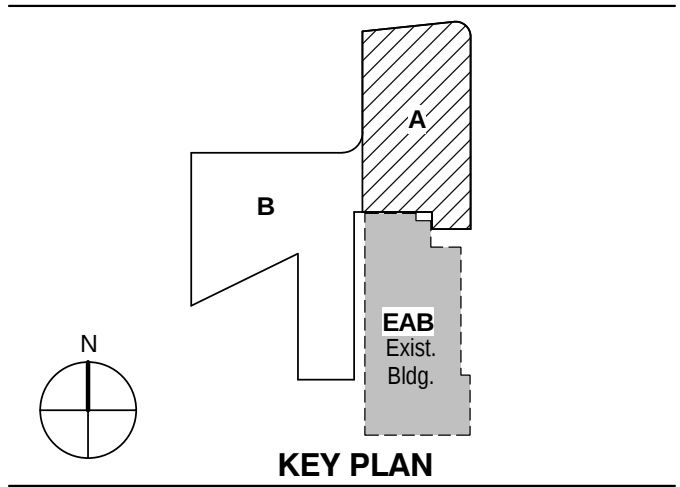

KEY PLAN

**LEVEL 04 AREA A FLOOR
PLAN - FIRE PROTECTION**

Project No.: 04561.01 Checked by:

FP0104.A