



KEYED NOTES: (THIS SHEET ONLY)

- COORDINATE LOCATION OF SPRINKLER HEADS WITH SUSPENDED LUMINARIES. REFER TO THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
- THIS AREA IS DESIGNATED AS ORDINARY HAZARD, GROUP 1.
- COORDINATE LOCATION OF SPRINKLERS IN THIS ROOM WITH THE ELECTRICAL EQUIPMENT AND OVERHEAD RACEWAY. HOLD PIPING AS HIGH AS POSSIBLE. PROVIDE INTERMEDIATE TEMPERATURE RATED SPRINKLER HEAD.
- RECESSED FIRE HOSE VALVE CABINET WITH 2.5 INCH ANGLE FIRE DEPARTMENT HOSE VALVE, CAP AND CHAIN. REFER TO THE ARCHITECTURAL DRAWINGS FOR THE EXACT LOCATION.
- CONTRACTOR TO REVIEW ARCHITECTURAL DRAWINGS FOR RECESSED OR ELEVATED CEILING POCKETS. PROVIDE PROTECTION AS REQUIRED.
- PROVIDE EXTENDED COVERAGE CONCEALED PENDANT SPRINKLER HEADS IN WOOD SLATE CEILING OF STAIR. REFER TO ARCHITECTURAL DRAWINGS FOR CEILING DETAILS. PIPING ABOVE CEILING THAT IS EXPOSED OR VISIBLE, IS TO BE PAINTED TO MATCH THE BACKGROUND SURFACE. COVERPLATE FINISH OF THE SPRINKLER HEAD IS TO BE SELECTED AND APPROVED BY THE ARCHITECT. OBTAIN SAMPLES FROM THE SPRINKLER MANUFACTURER OF THE TRUE COVERPLATE FINISHES AS DIRECTED BY THE ARCHITECT PRIOR TO ORDERING.
- EXTEND SPRINKLER PROTECTION INTO ROOF MONITOR/SKYLIGHT. PROVIDE SPRINKLER HEADS WITH A TEMPERATURE RATING SUITABLE FOR THE APPLICATION. EXPOSED OR VISIBLE PIPING IS TO BE PAINTED TO MATCH THE BACKGROUND SURFACE.
- STANDPIPE SUPPLY RISER FROM LEVEL 3 TO SERVE FIRE HOSE VALVE ON THIS LEVEL. PROVIDE PRESSURE GAUGE AT ACCESSIBLE LOCATION.

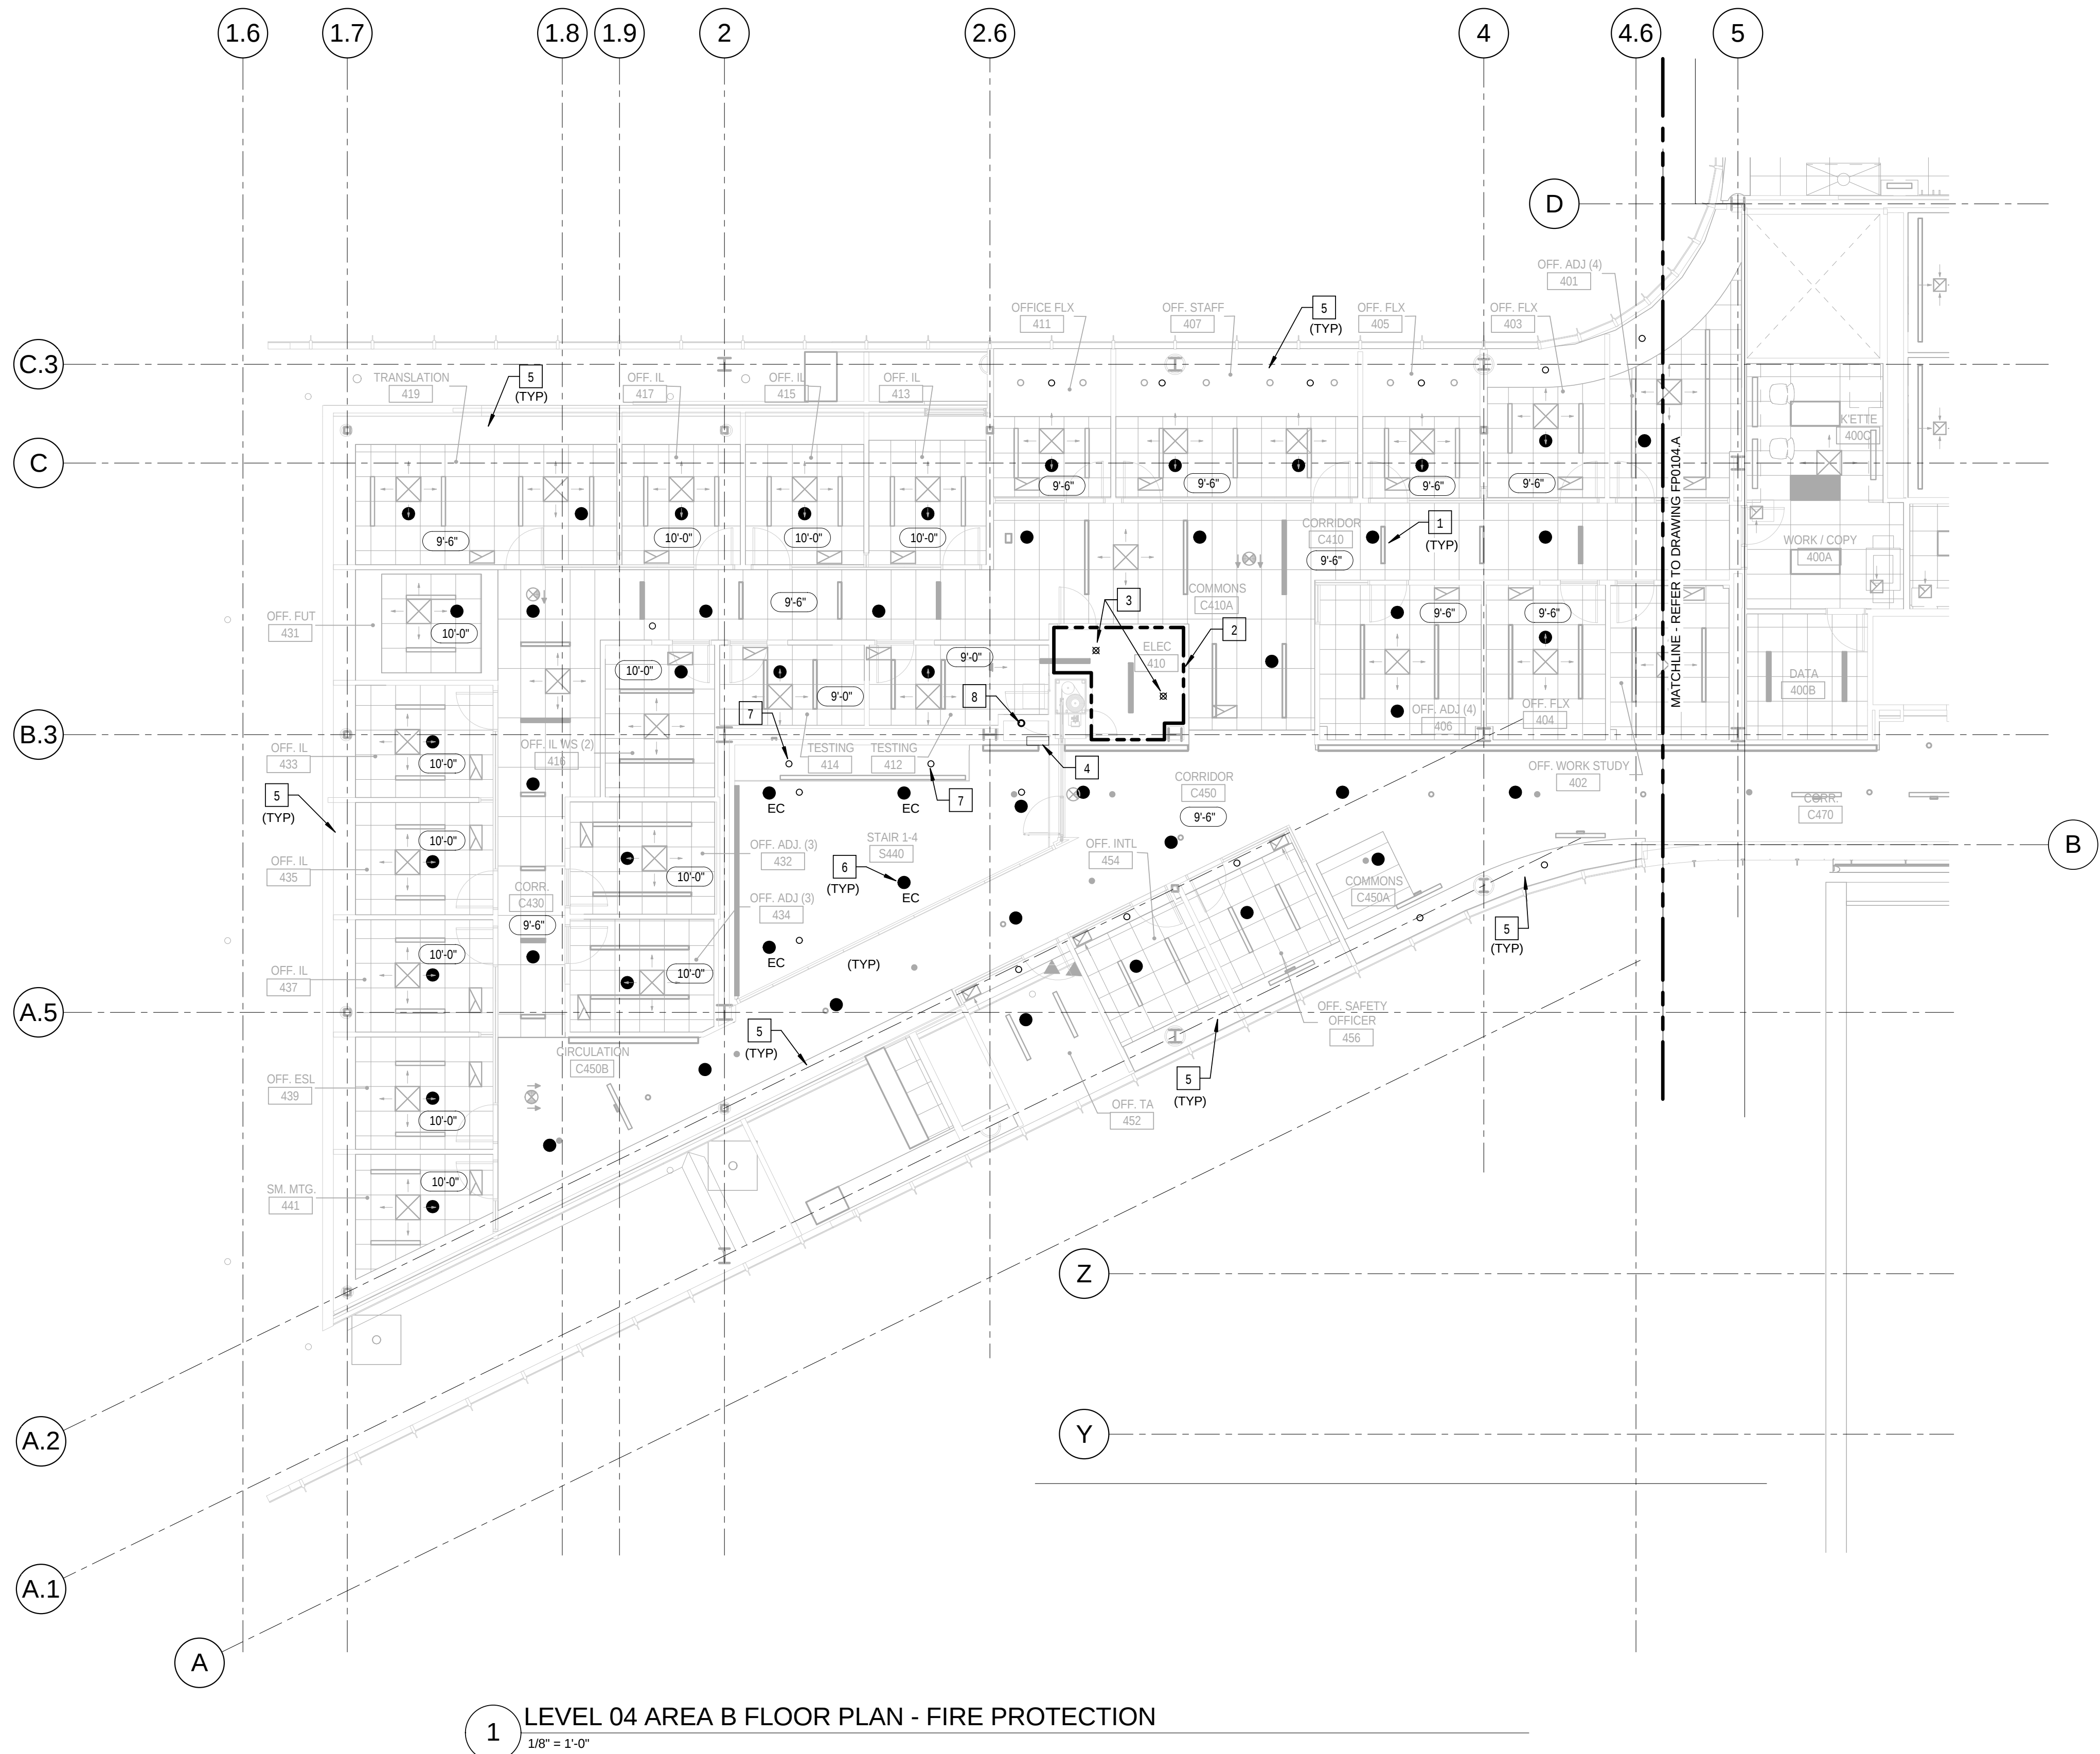

1 LEVEL 04 AREA B FLOOR PLAN - FIRE PROTECTION
1/8" = 1'-0"

ISSUED FOR CONSTRUCTION (BP2)		01 MAR 2016
No.	Description	Date

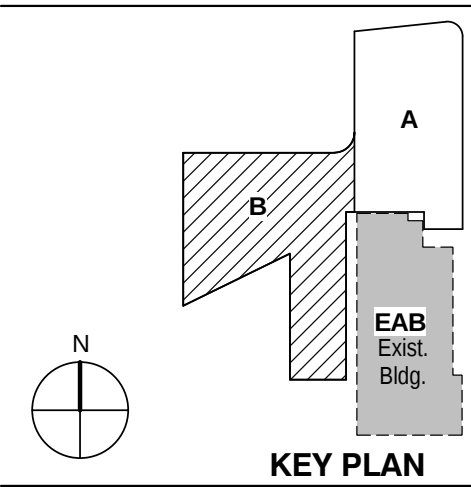

KEY PLAN

LEVEL 04 AREA B FLOOR
PLAN - FIRE PROTECTION

Project No.: 04561.01 Checked by:

FP0104.B