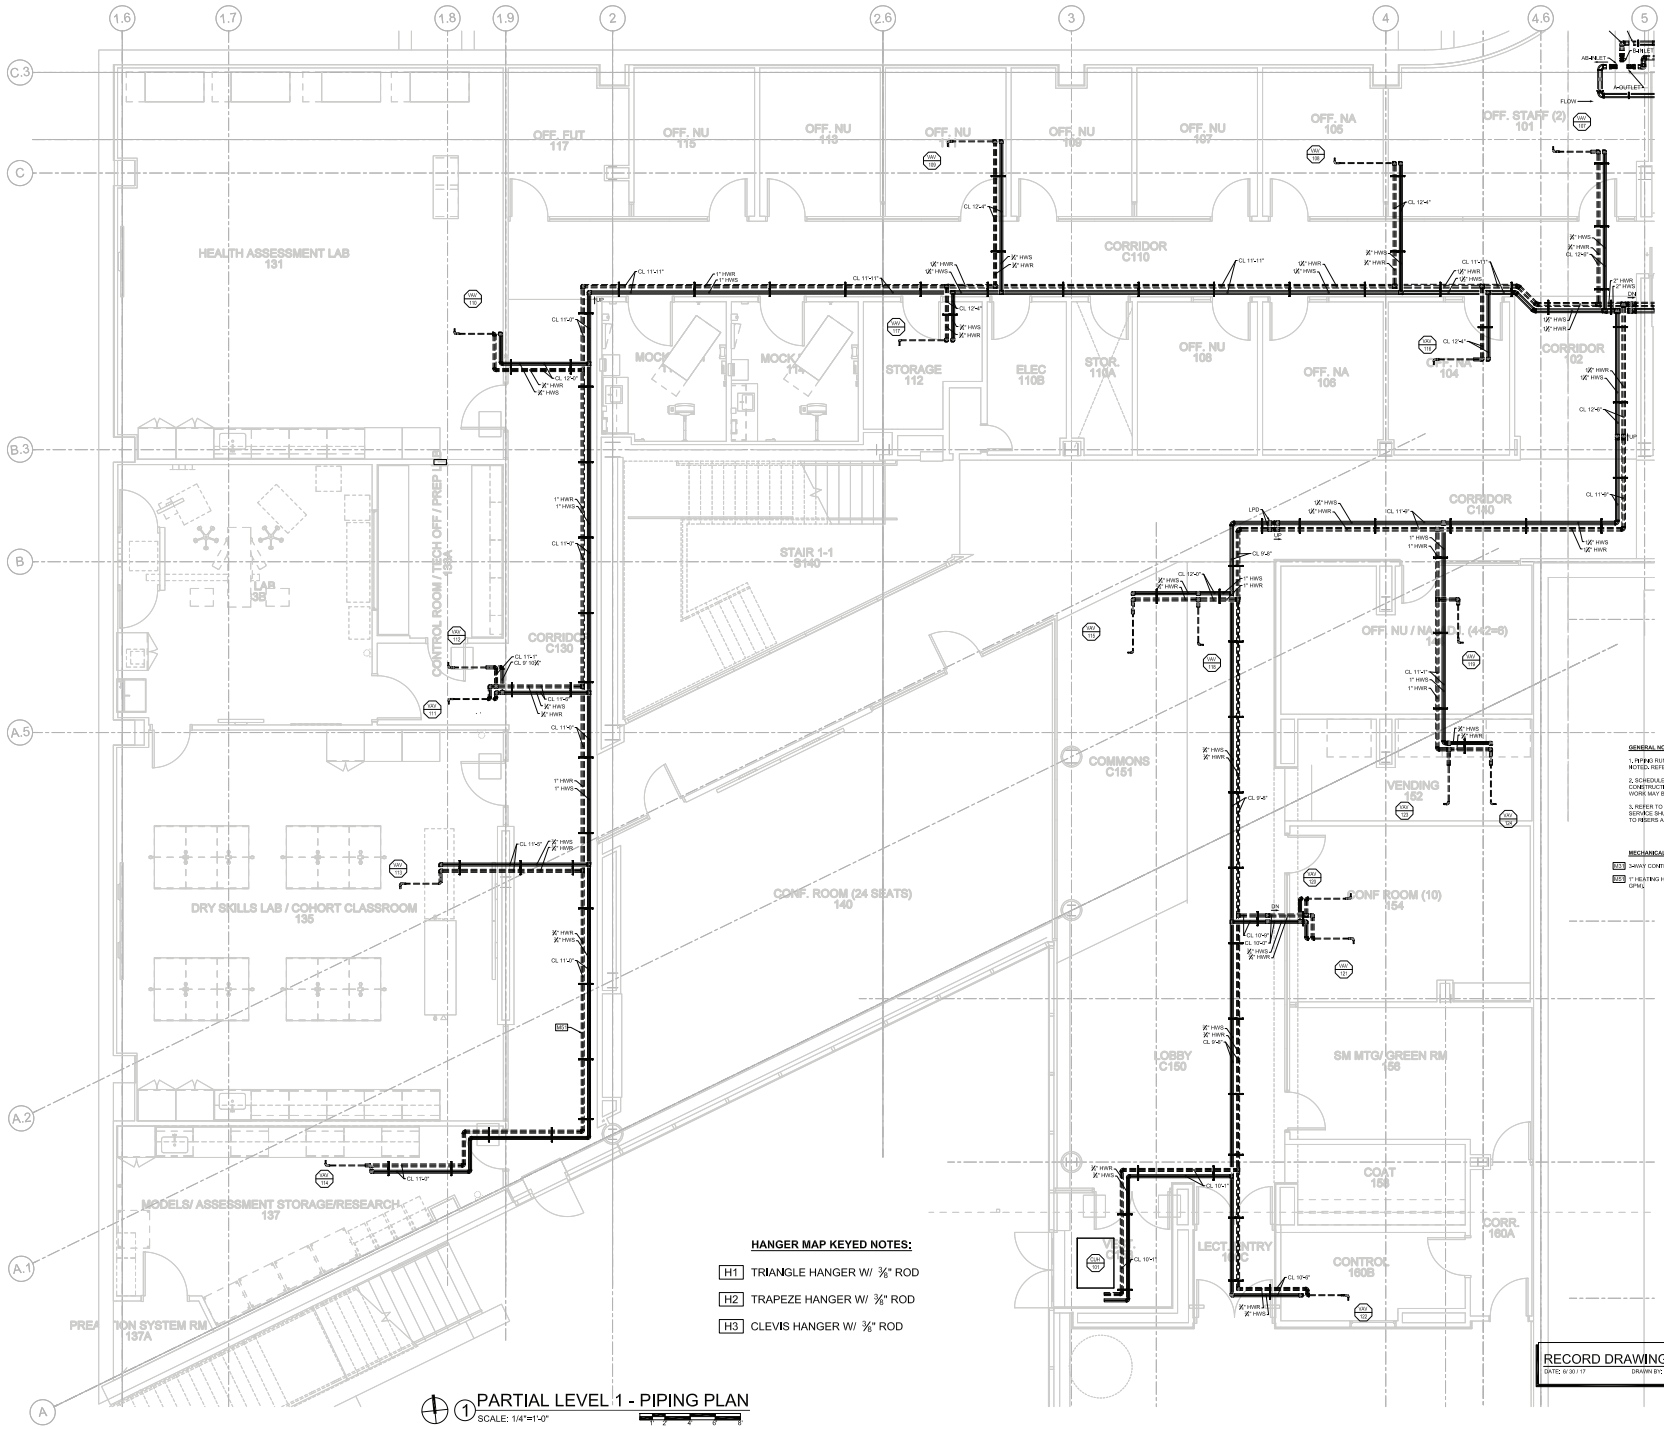
HEALTH ASSESSMENT LAB 131
OFF. FUT 117
OFF. NU 115
OFF. NU 113
OFF. NU 109
OFF. NU 107
OFF. NA 106
OFF. STAFF (2) 101
CORRIDOR C110
MOCK 1
MOCK 1A
STORAGE 112
ELEC 110B
STOR. 111A
OFF. NU 108
OFF. NA 106
CORRIDOR 102
104
CONTROL ROOM / TECH OFF / PREP 139A
LAB 3B
CORRIDOR C130
STAIR 1-1 S140
CORRIDOR C140
OFF. NU / NA (4+2=6)
COMMONS C151
VENDING 152
DRY SKILLS LAB / COHORT CLASSROOM 135
CONF. ROOM (24 SEATS) 140
CONF ROOM (10) 154
LOBBY C150
SM MTG/ GREEN RM 156
COAT 158
CORR. 160A
LECT/ENTRY 160C
CONTROL 160B
MODELS/ ASSESSMENT STORAGE/RESEARCH 137
PREA TION SYSTEM RM 137A
AB-INLET
B-INLET
A-OUTLET
FLOW
LPD
SN
MV 112
MV 113
MV 114
MV 115
MV 116
MV 117
MV 118
MV 119
MV 120
MV 121
MV 122
MV 123
MV 124
MV 125
MV 126
MV 127
MV 128
MV 129
MV 130
MV 131
MV