



Kathy R. Williams
3.16.16

CONFORMED SET

01 JUL 2016

1	ADDENDUM 1-7	16 MAR 2016
-	ISSUED FOR CONSTRUCTION (BP1)	15 JAN 2016
No.	Description	Date

Drawing Title:


ROOF DETAILS

Project No.: 04561.01


Checked by:

A0471


NOTES:
VALLEY FLASHING SHALL BE USED IN ALL
AREAS WHERE SLOPE EXCEEDS 1 1/2" PER
FOOT

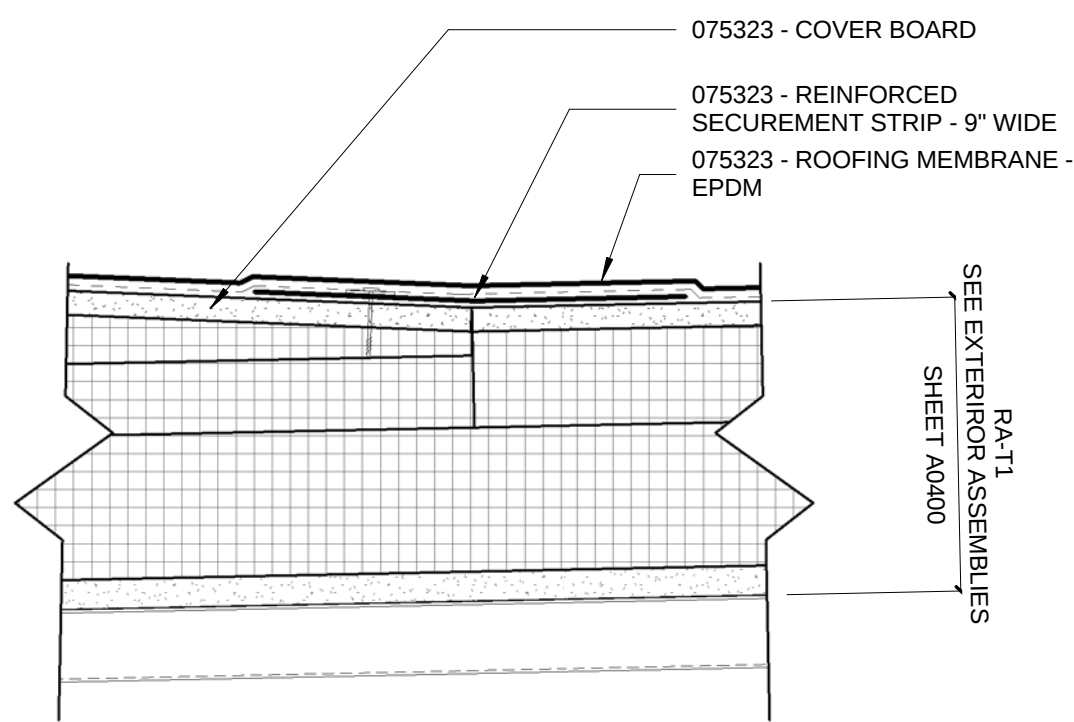


11 ENLARGED DETAIL - EPDM VALLEY - TYP
3" = 1'-0"

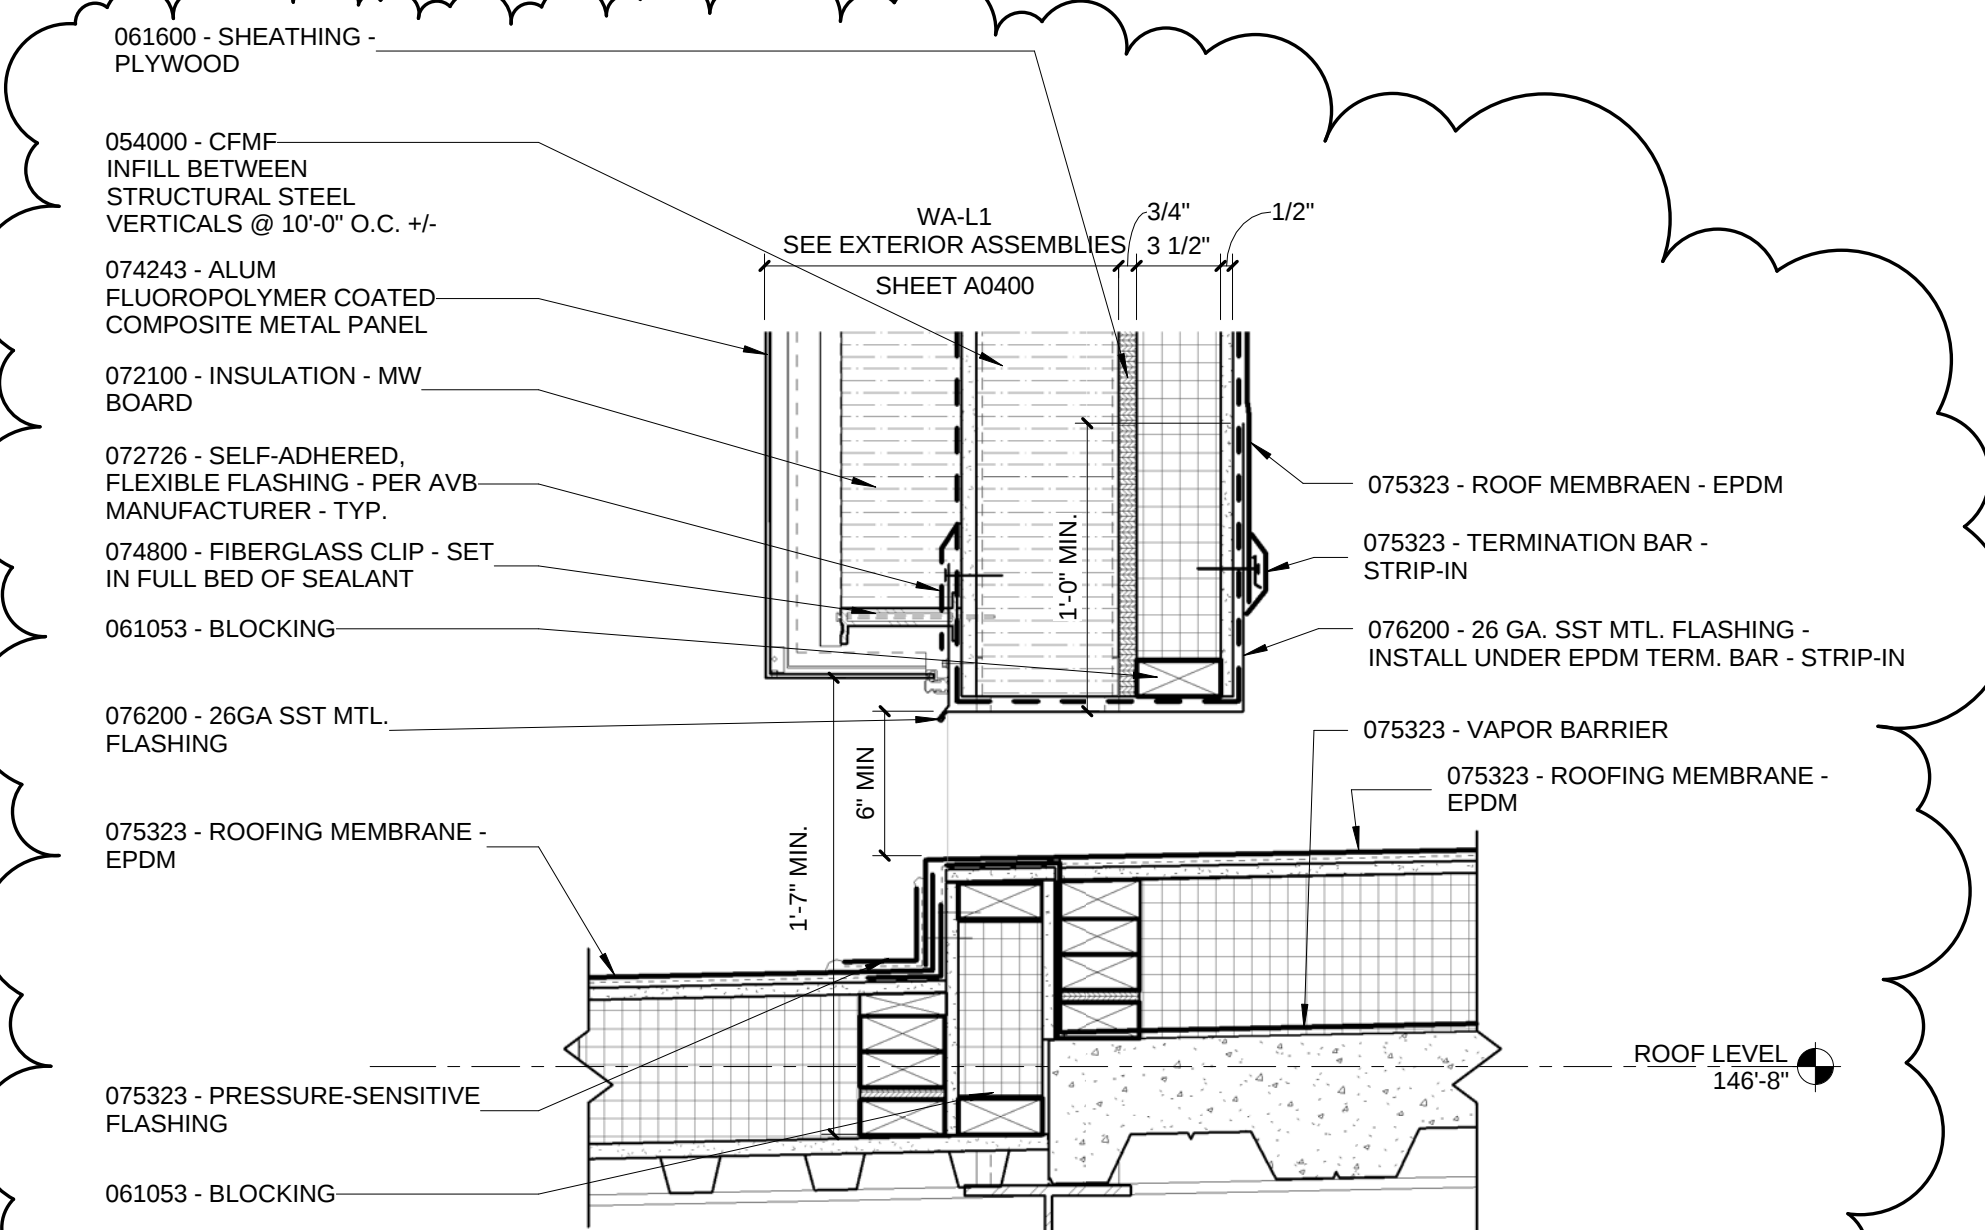


10 ENLARGED DETAIL - SCUPPER @ MECHANICAL SCREEN
1 1/2" = 1'-0"

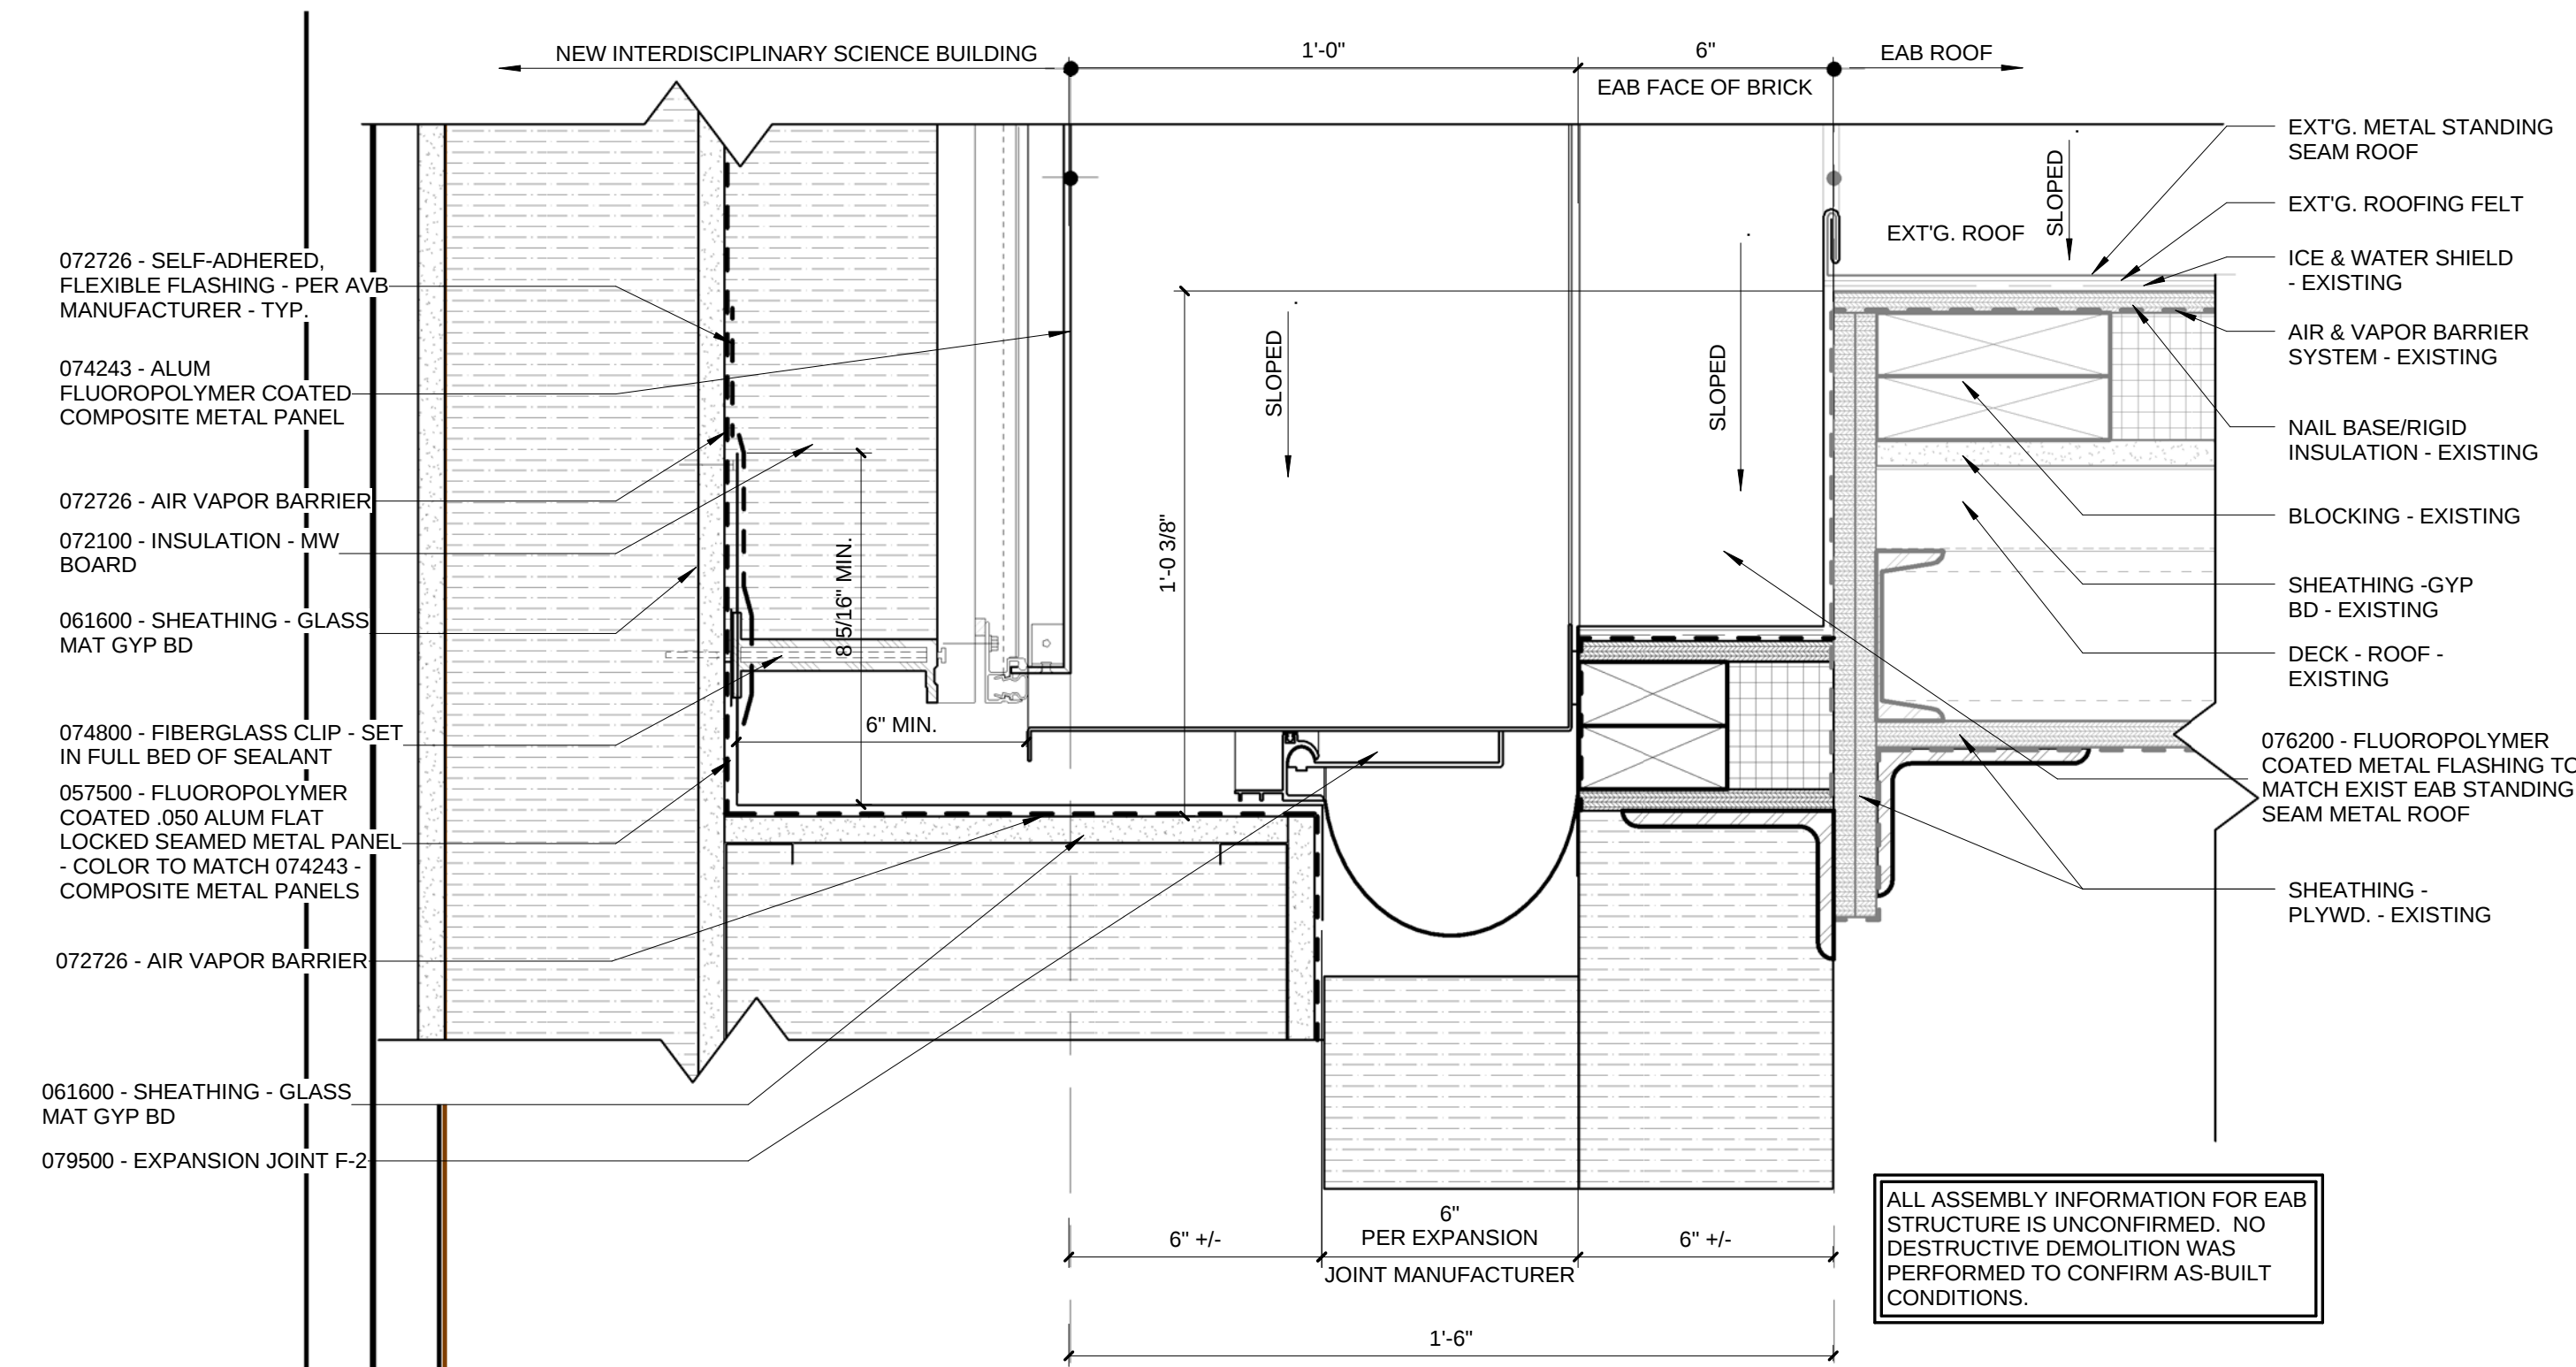


9 ISB TO EAB ROOF TO WALL EXPANSION JOINT DETAIL
3" = 1'-0"

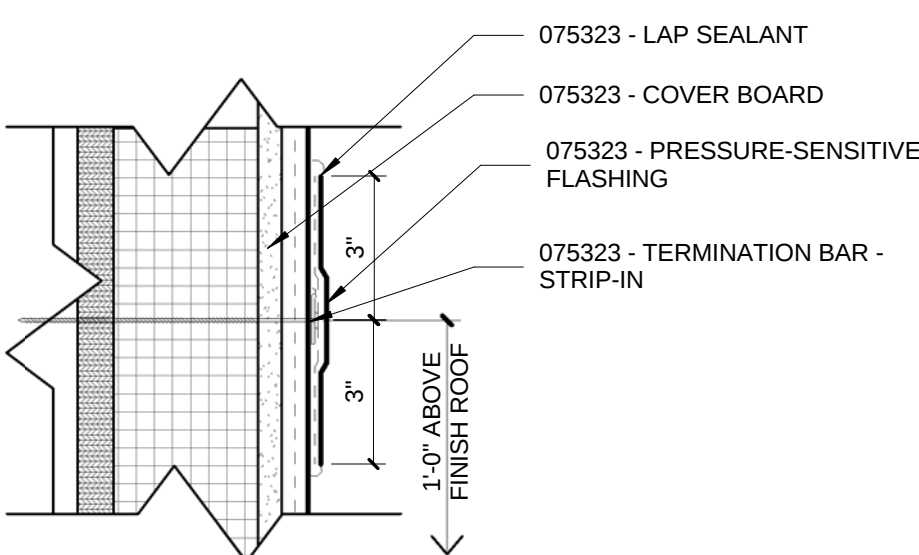


8 ENLARGED DETAIL - TERM. BAR FLASHING - TYP
3" = 1'-0"

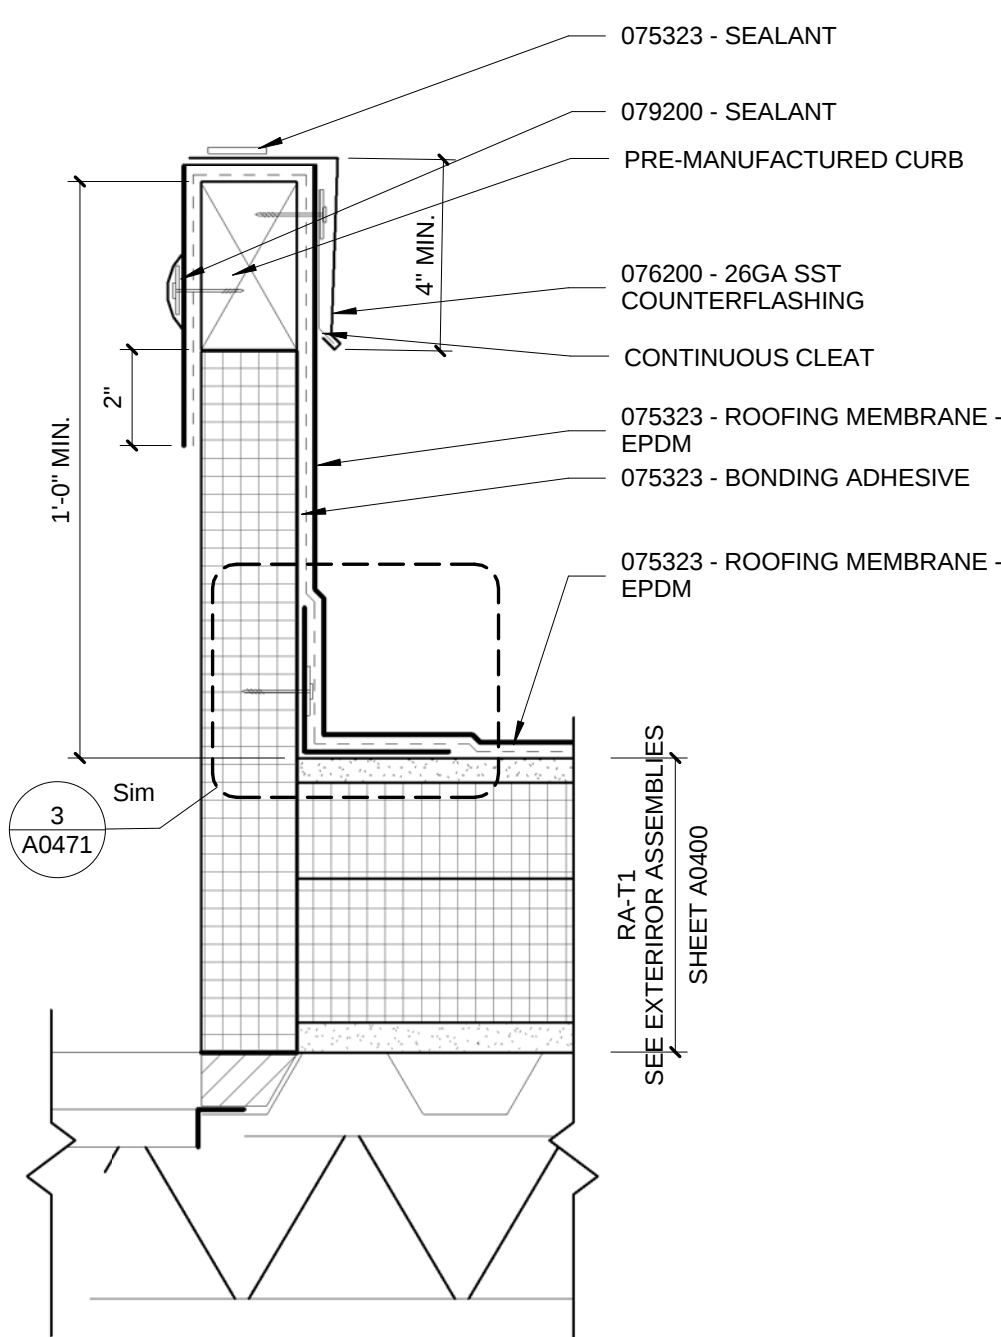


7 ENLARGED DETAIL - PRE-MANUFACTURED ROOF CURB
3" = 1'-0"

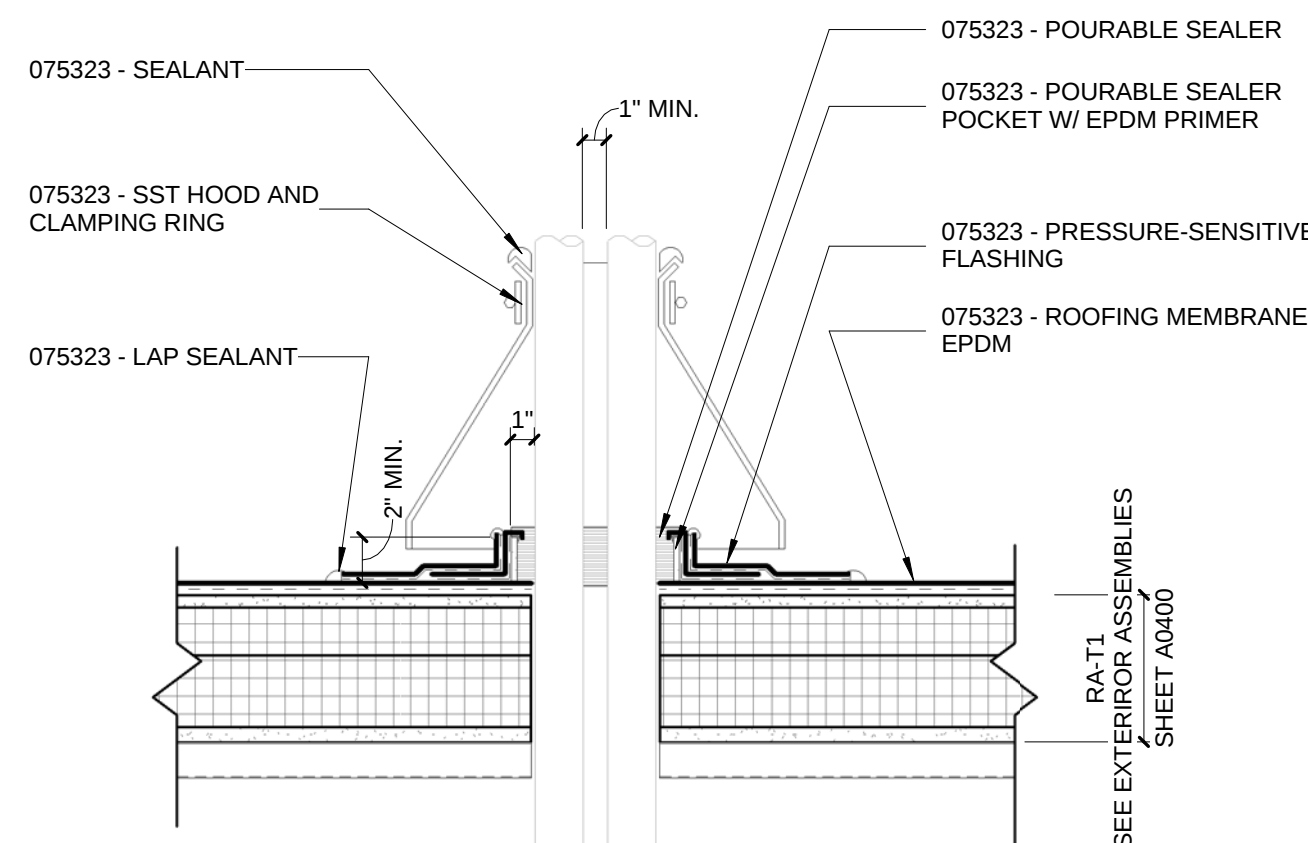


6 ENLARGED DETAIL - PITCH POCKET
1 1/2" = 1'-0"

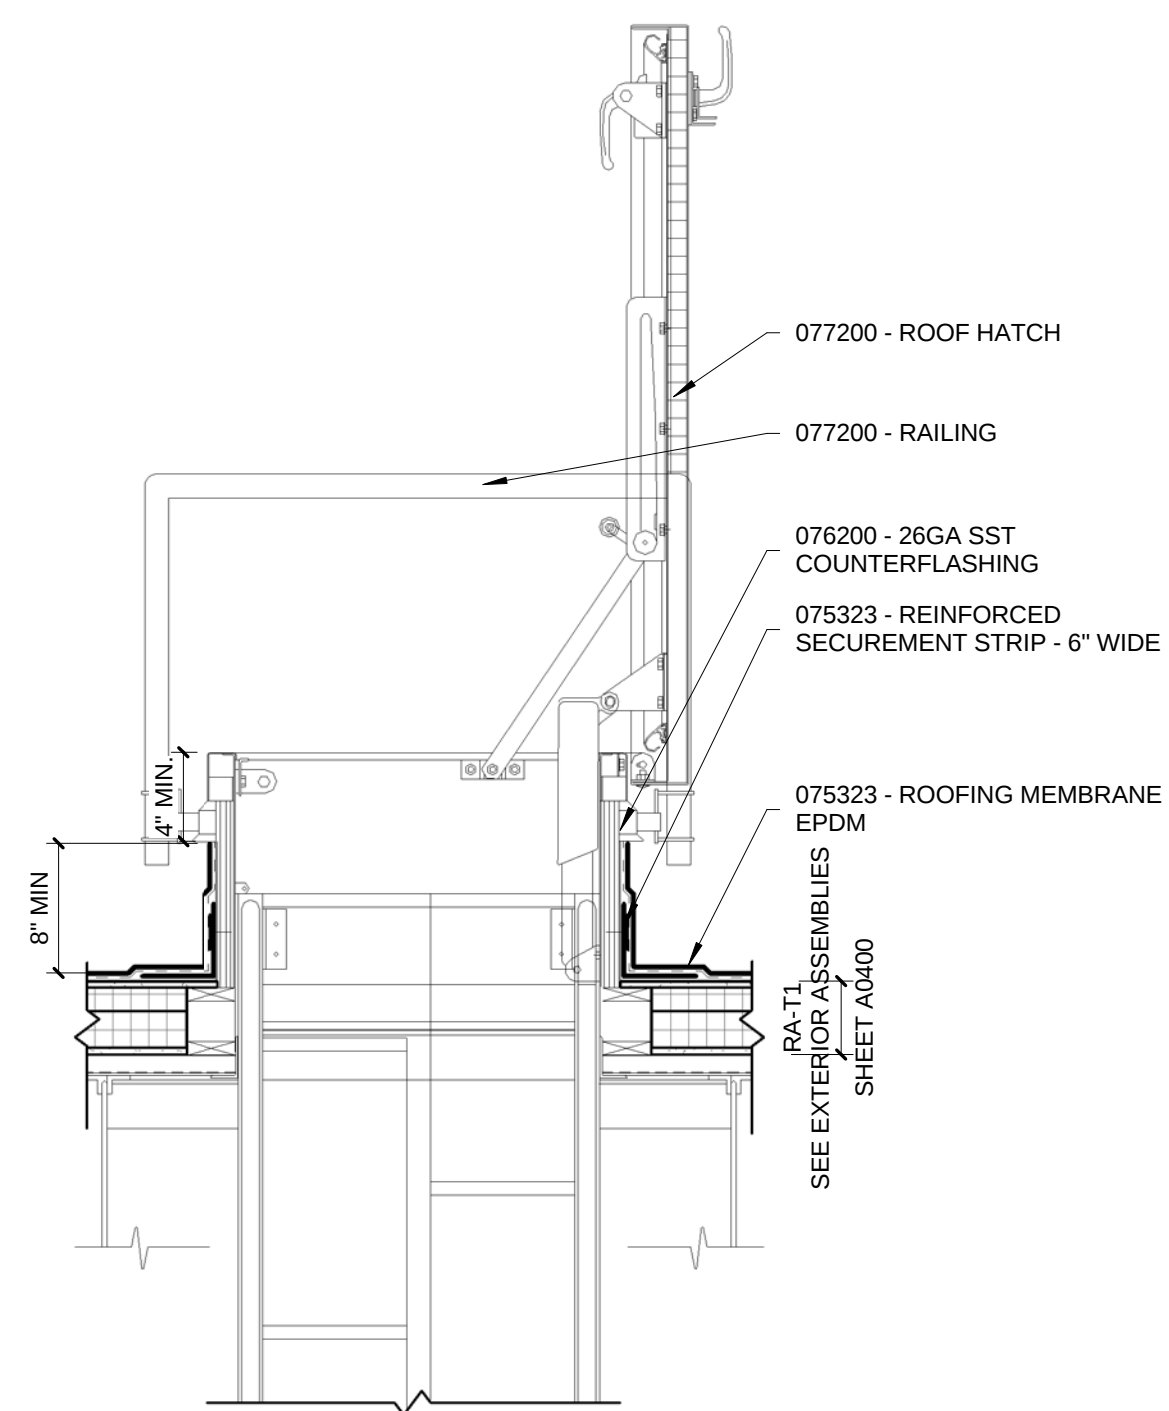


5 ENLARGED DETAIL - PRE-MANUFACTURED ROOF HATCH
3/4" = 1'-0"

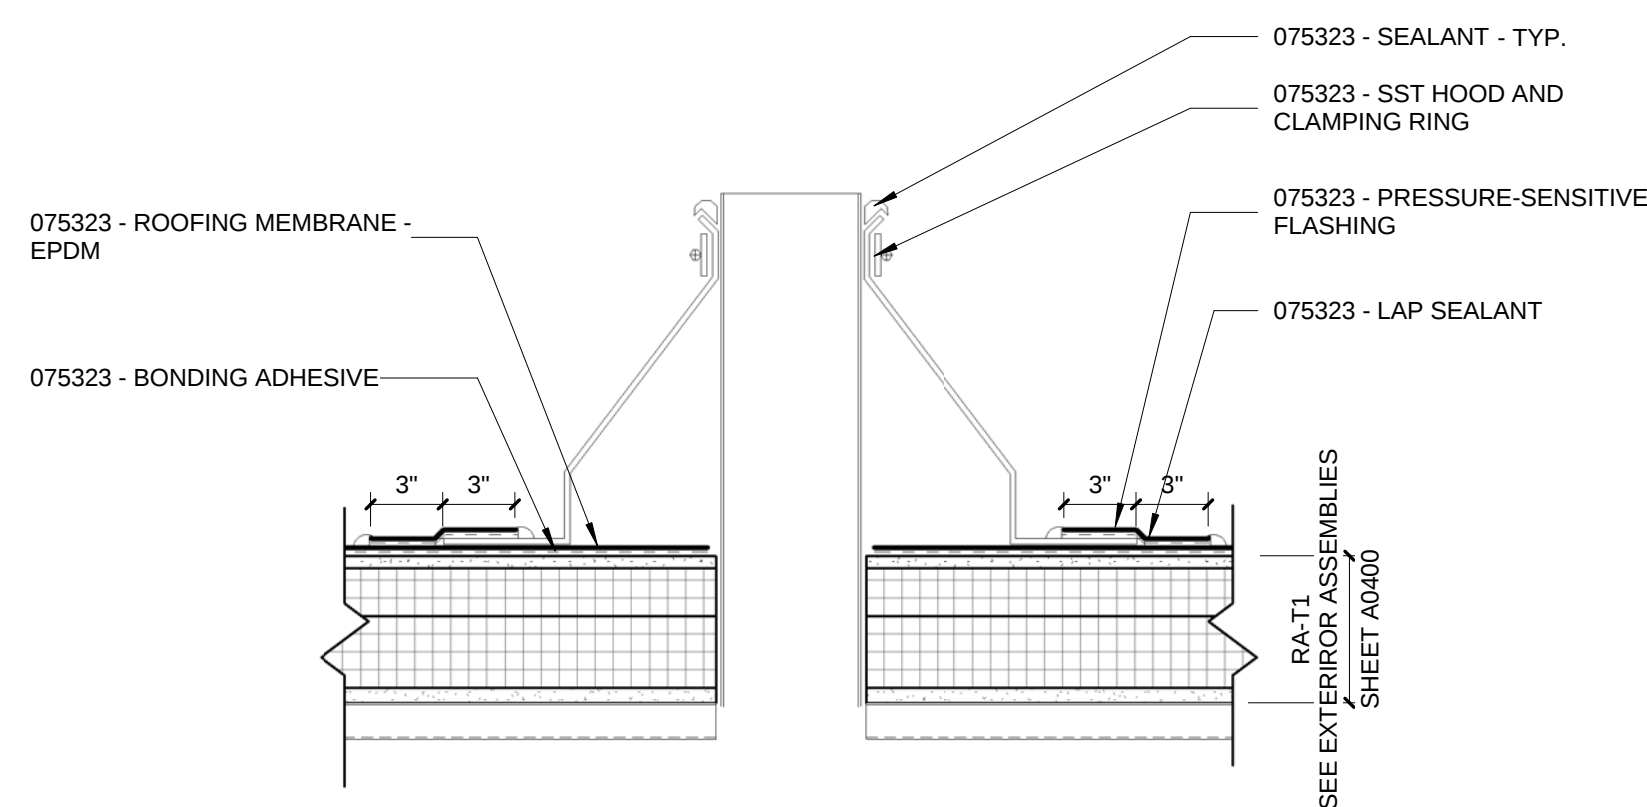


4 ENLARGED DETAIL - PRE-MOLDED PIPE BOOT DETAIL
1 1/2" = 1'-0"

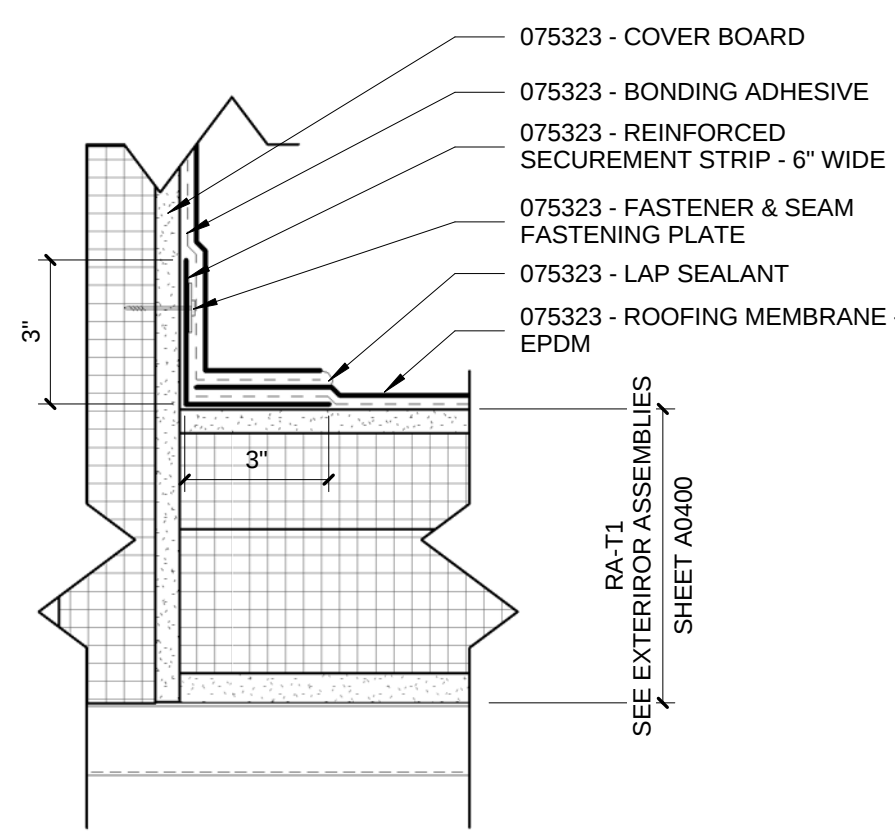

3 ENLARGED DETAIL - ROOF TO WALL FLASHING - TYP
3" = 1'-0"

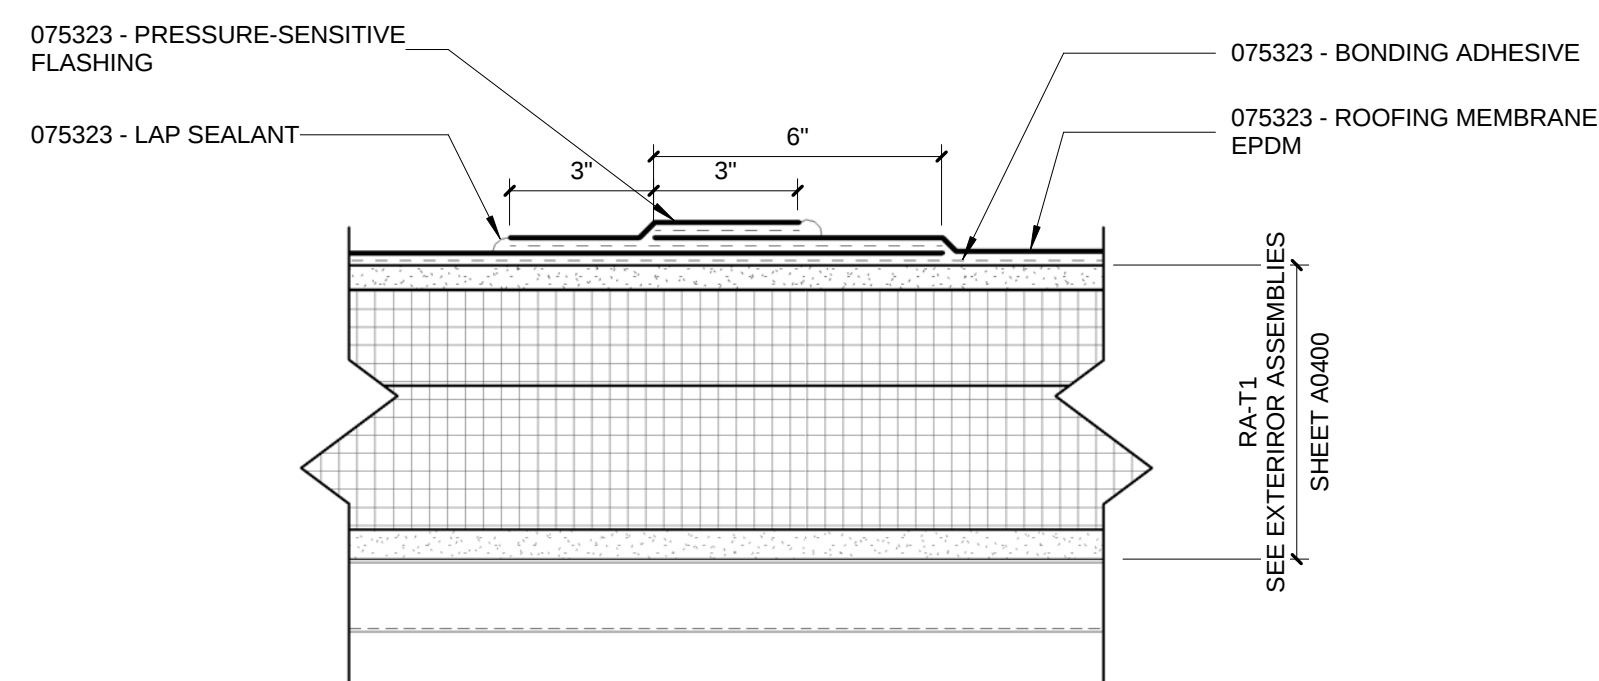

2 ENLARGED DETAIL - EPDM STRIP-IN - TYP
3" = 1'-0"

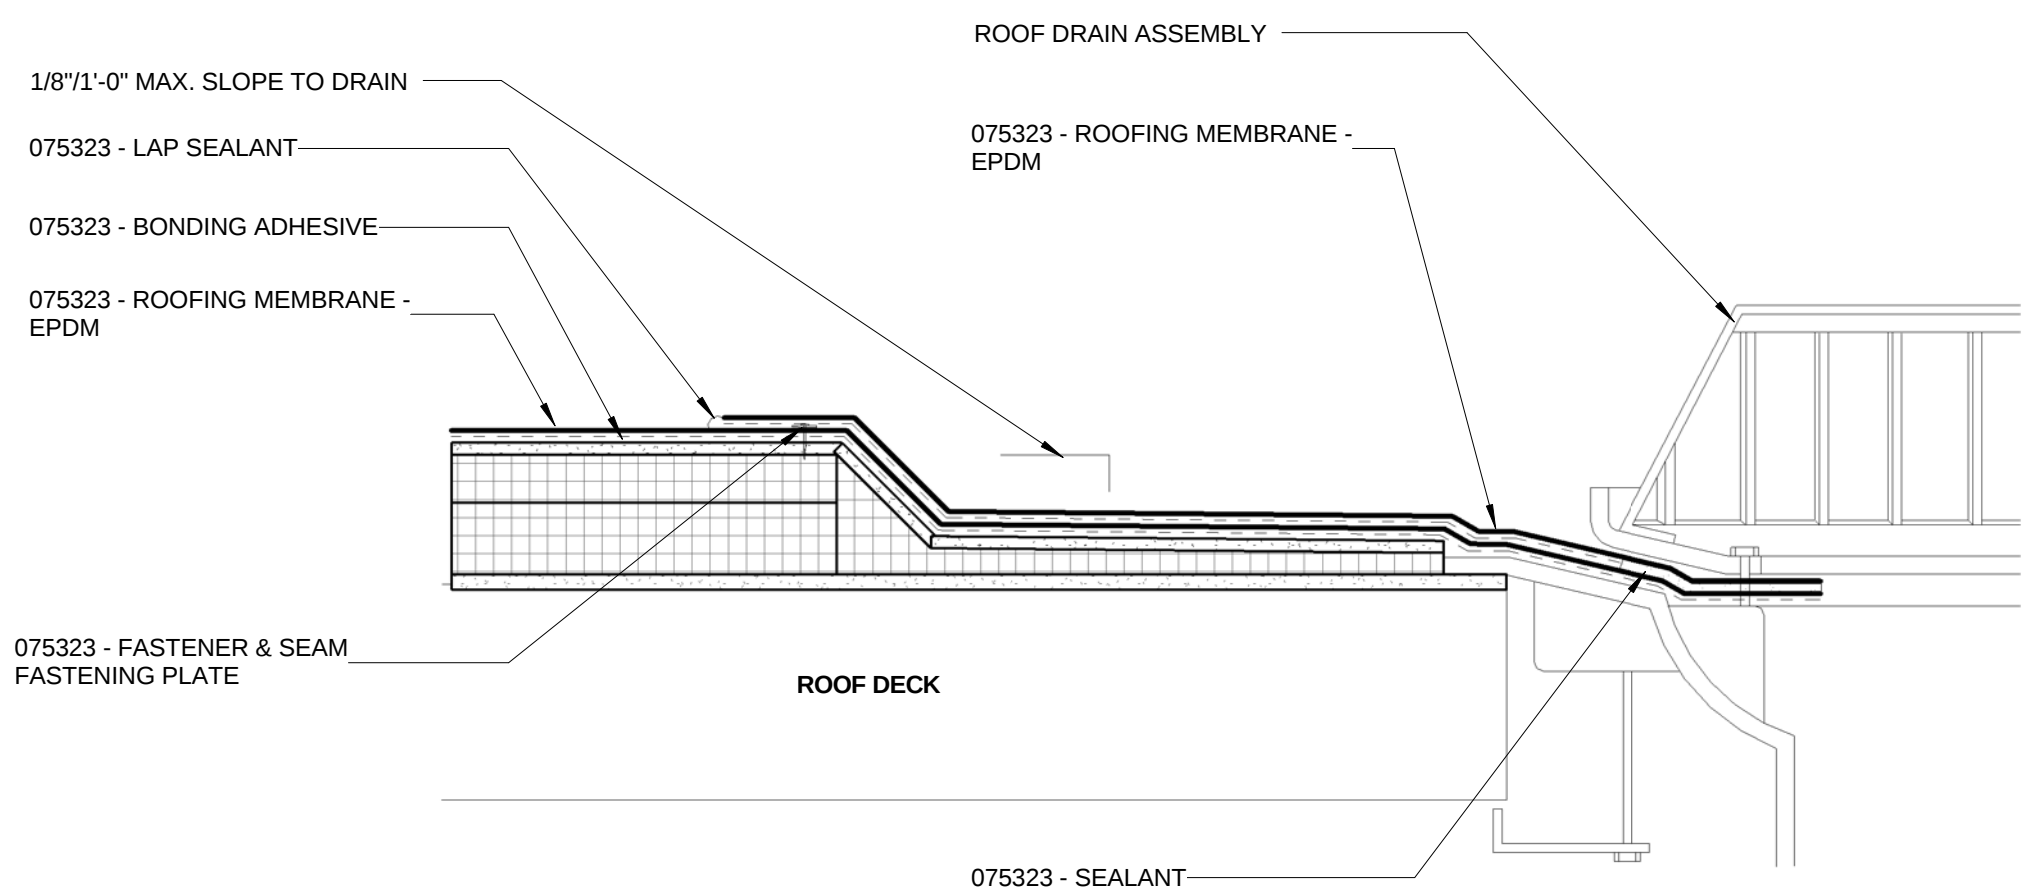

1 ENLARGED DETAIL - ROOF DRAIN
1 1/2" = 1'-0"

NOTES:
1. WHERE SEAMS RUN WITHIN 18" OF DRAIN INSTALL A 4'-0" X 4'-0" EPDM PATCH ON TOP OF
MEMBRANE ASSURING SEAM IS COVERED, OR STRIP-IN SEAM WITH 6" & 12" WIDE MEMBRANE