


KEYED NOTES: (THIS SHEET ONLY)


- 1 PROVIDE CONCEALED DRY-PENDANT SPRINKLER HEAD AT THIS LOCATION. COORDINATE INSTALLATION WITH ROOM CONSTRUCTION.
- 2 COORDINATE LOCATION OF SPRINKLER HEADS WITH SUSPENDED LUMINARIES. REFER TO THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
- 3 THIS AREA IS DESIGNATED AS ORDINARY HAZARD, GROUP 1.
- 4 THIS AREA IS DESIGNATED AS EXTRA HAZARD, GROUP 2.
- 5 PROVIDE A SPRINKLER HEAD IN THIS ROOM WITH A TEMPERATURE RATING OF 200°F OR GREATER. COORDINATE LOCATION OF THE SPRINKLER HEAD AND PIPING WITH THE EQUIPMENT LAYOUT, OVERHEAD CABLE TRAY AND RACEWAY. HOLD PIPING AS HIGH AS POSSIBLE.
- 6 FIRE SERVICE RISER. DRAIN PIPE TO BE RUN PARALLEL WITH SUPPLY RISER.
- 7 EXPOSED 2.5 INCH ANGLE FIRE DEPARTMENT HOSE VALVE, CAP AND CHAIN.
- 8 FIRE SPRINKLER TO EXTEND TO SERVE THIS LEVEL. PROVIDE MONITORED FLOOR ZONE CONTROL VALVE AND WATER FLOW SWITCH. REFER TO DRAWING FP0501, DETAIL 3 FOR PIPING CONFIGURATION AND REQUIREMENTS. PROVIDE ACCESS PANEL IN CEILING AS REQUIRED.

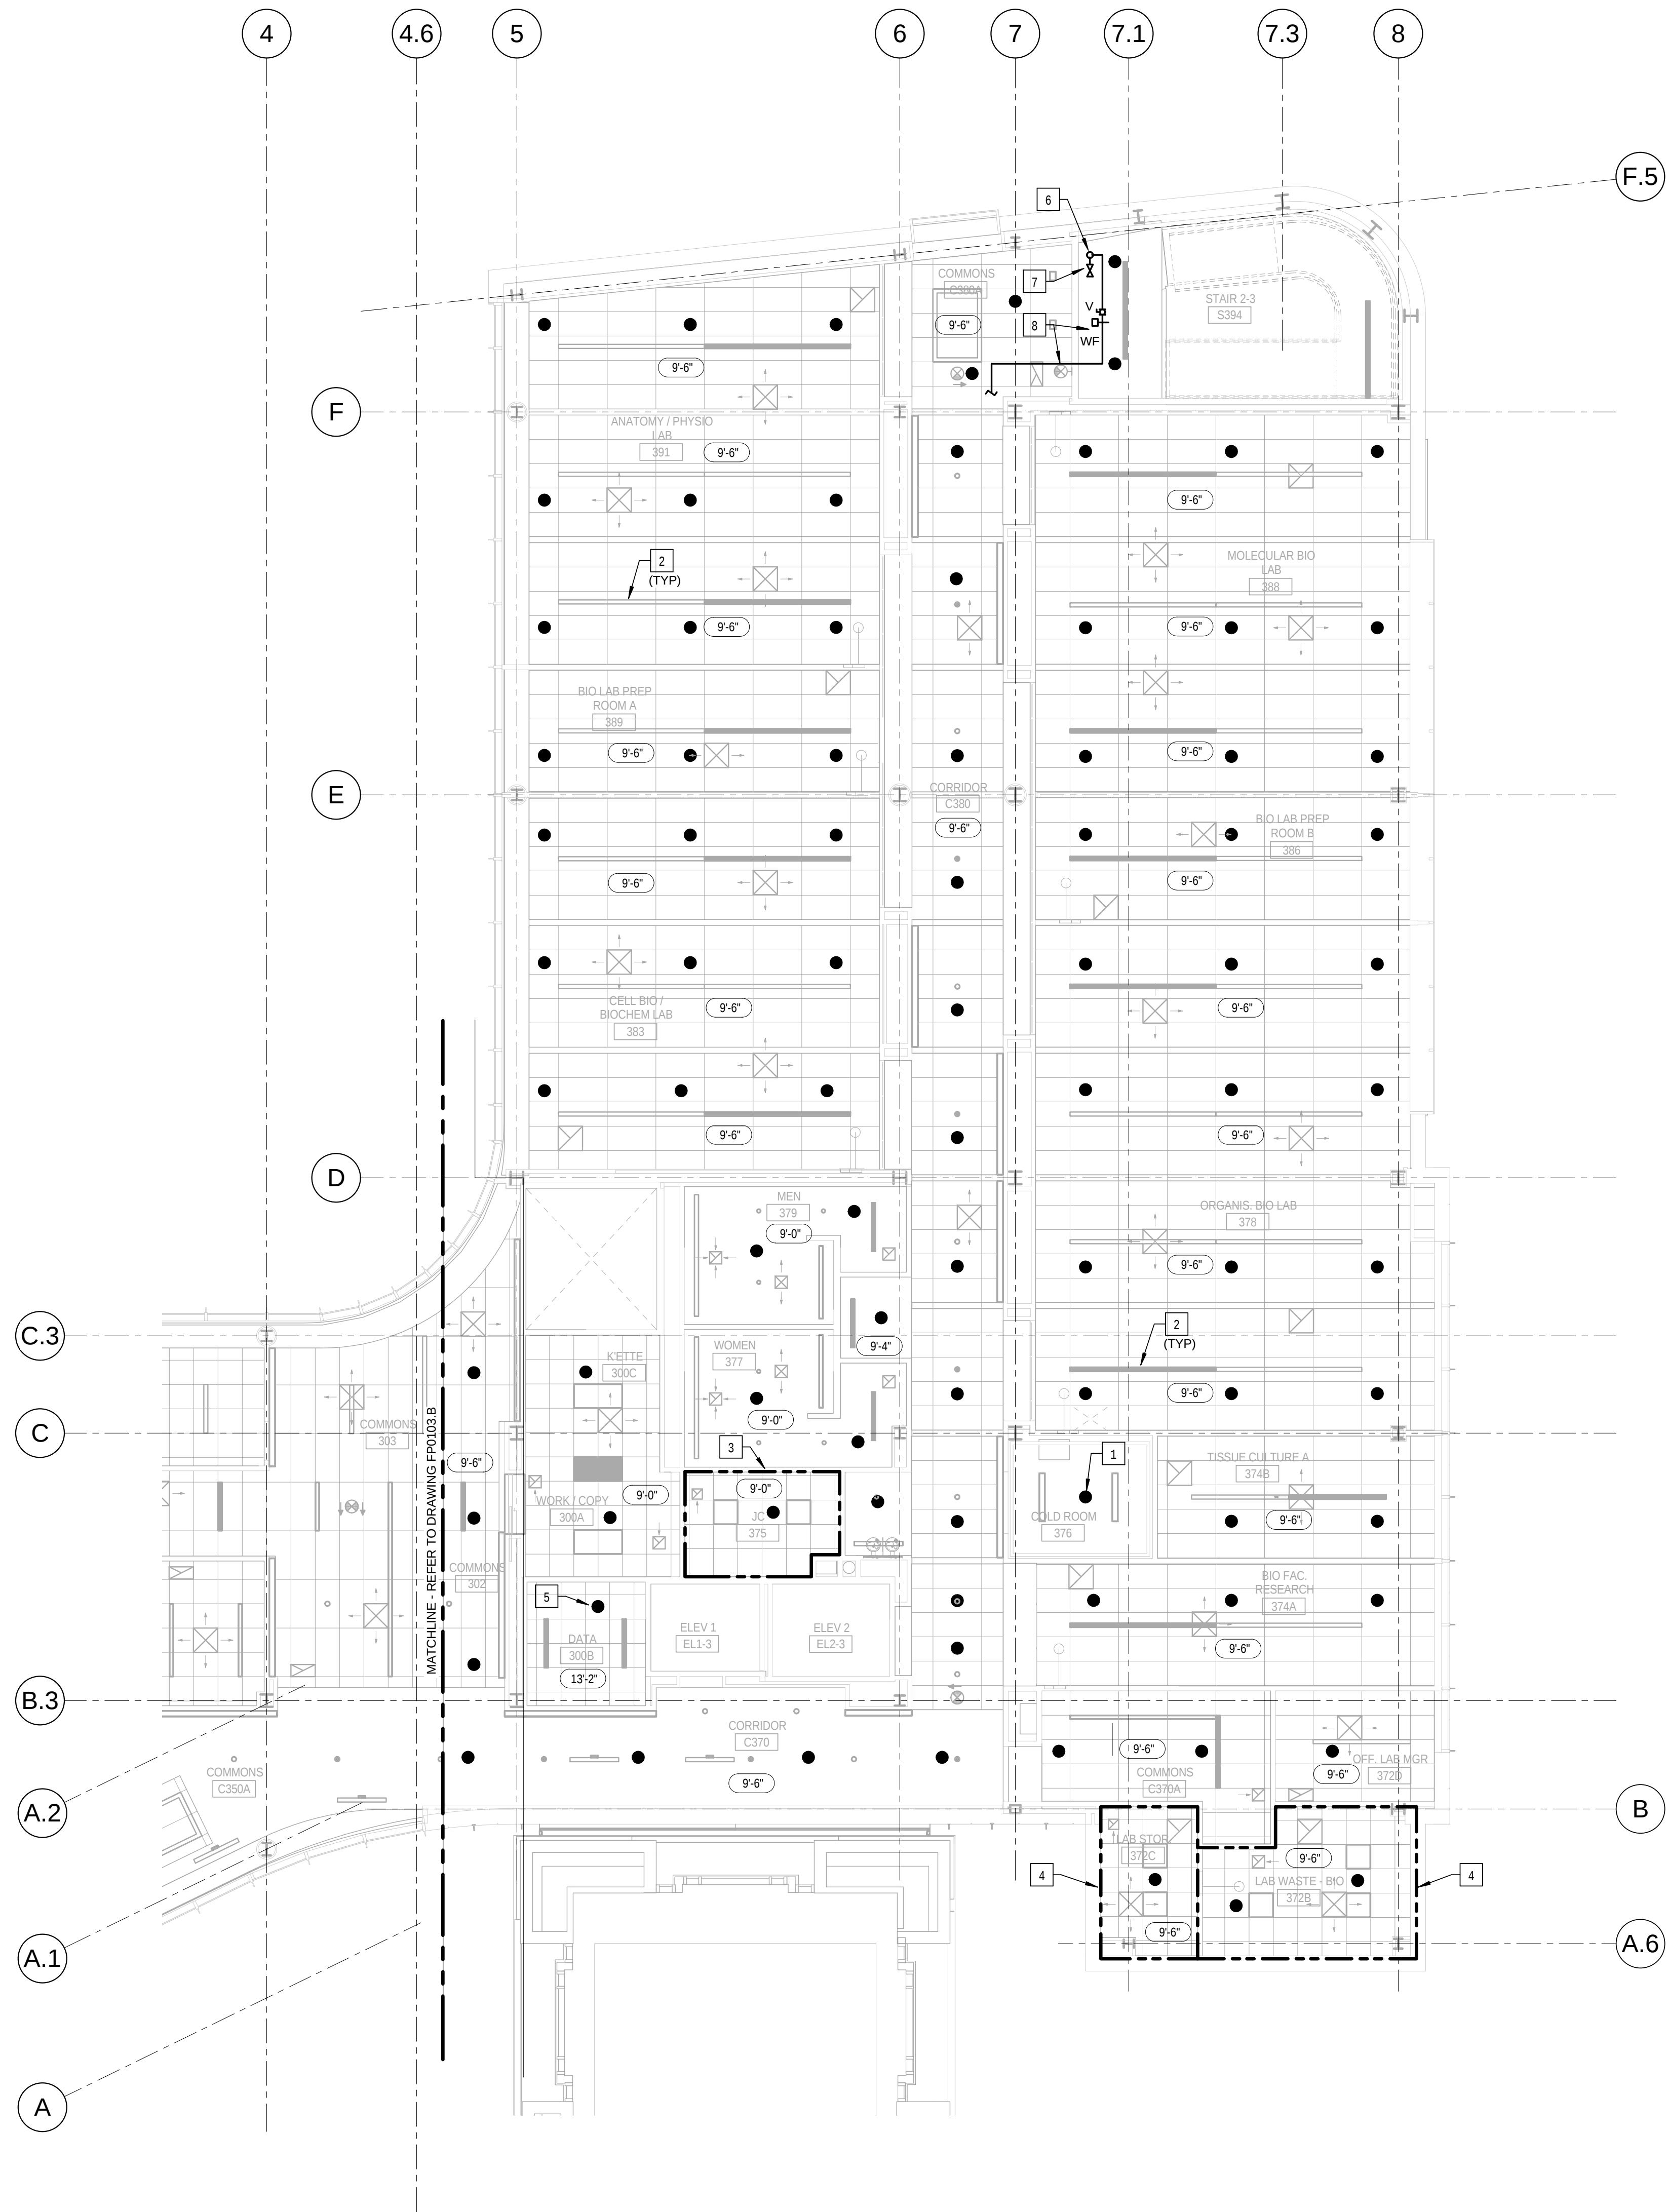

1 LEVEL 03 AREA A FLOOR PLAN - FIRE PROTECTION
1/8" = 1'-0"

CONFORMED SET 01 JUL 2016

ISSUED FOR CONSTRUCTION (BP2) 01 MAR 2016
No. Description Date

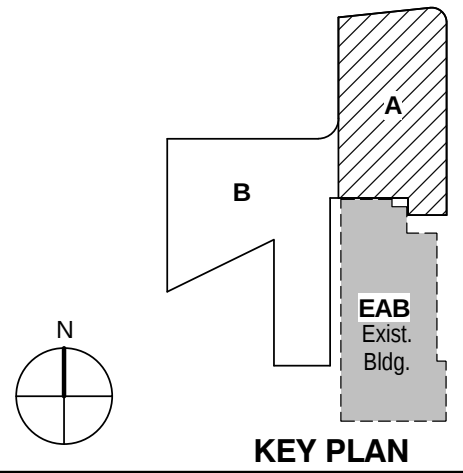

KEY PLAN

LEVEL 03 AREA A FLOOR
PLAN - FIRE PROTECTION

Project No.: 04561.01 Checked by:

FP0103.A