


CONFORMED SET 01 JUL 2016

ISSUED FOR CONSTRUCTION (BP2) 01 MAR 2016
No. Description Date

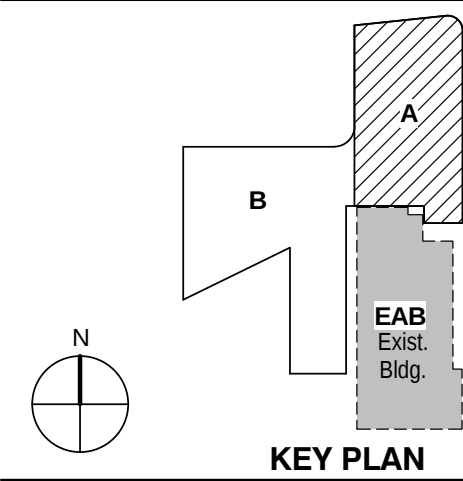


KEY PLAN

Drawing Title:

LEVEL 04 AREA A FLOOR
PLAN - FIRE PROTECTION

Project No.: 04561.01 Checked by:

FP0104.A

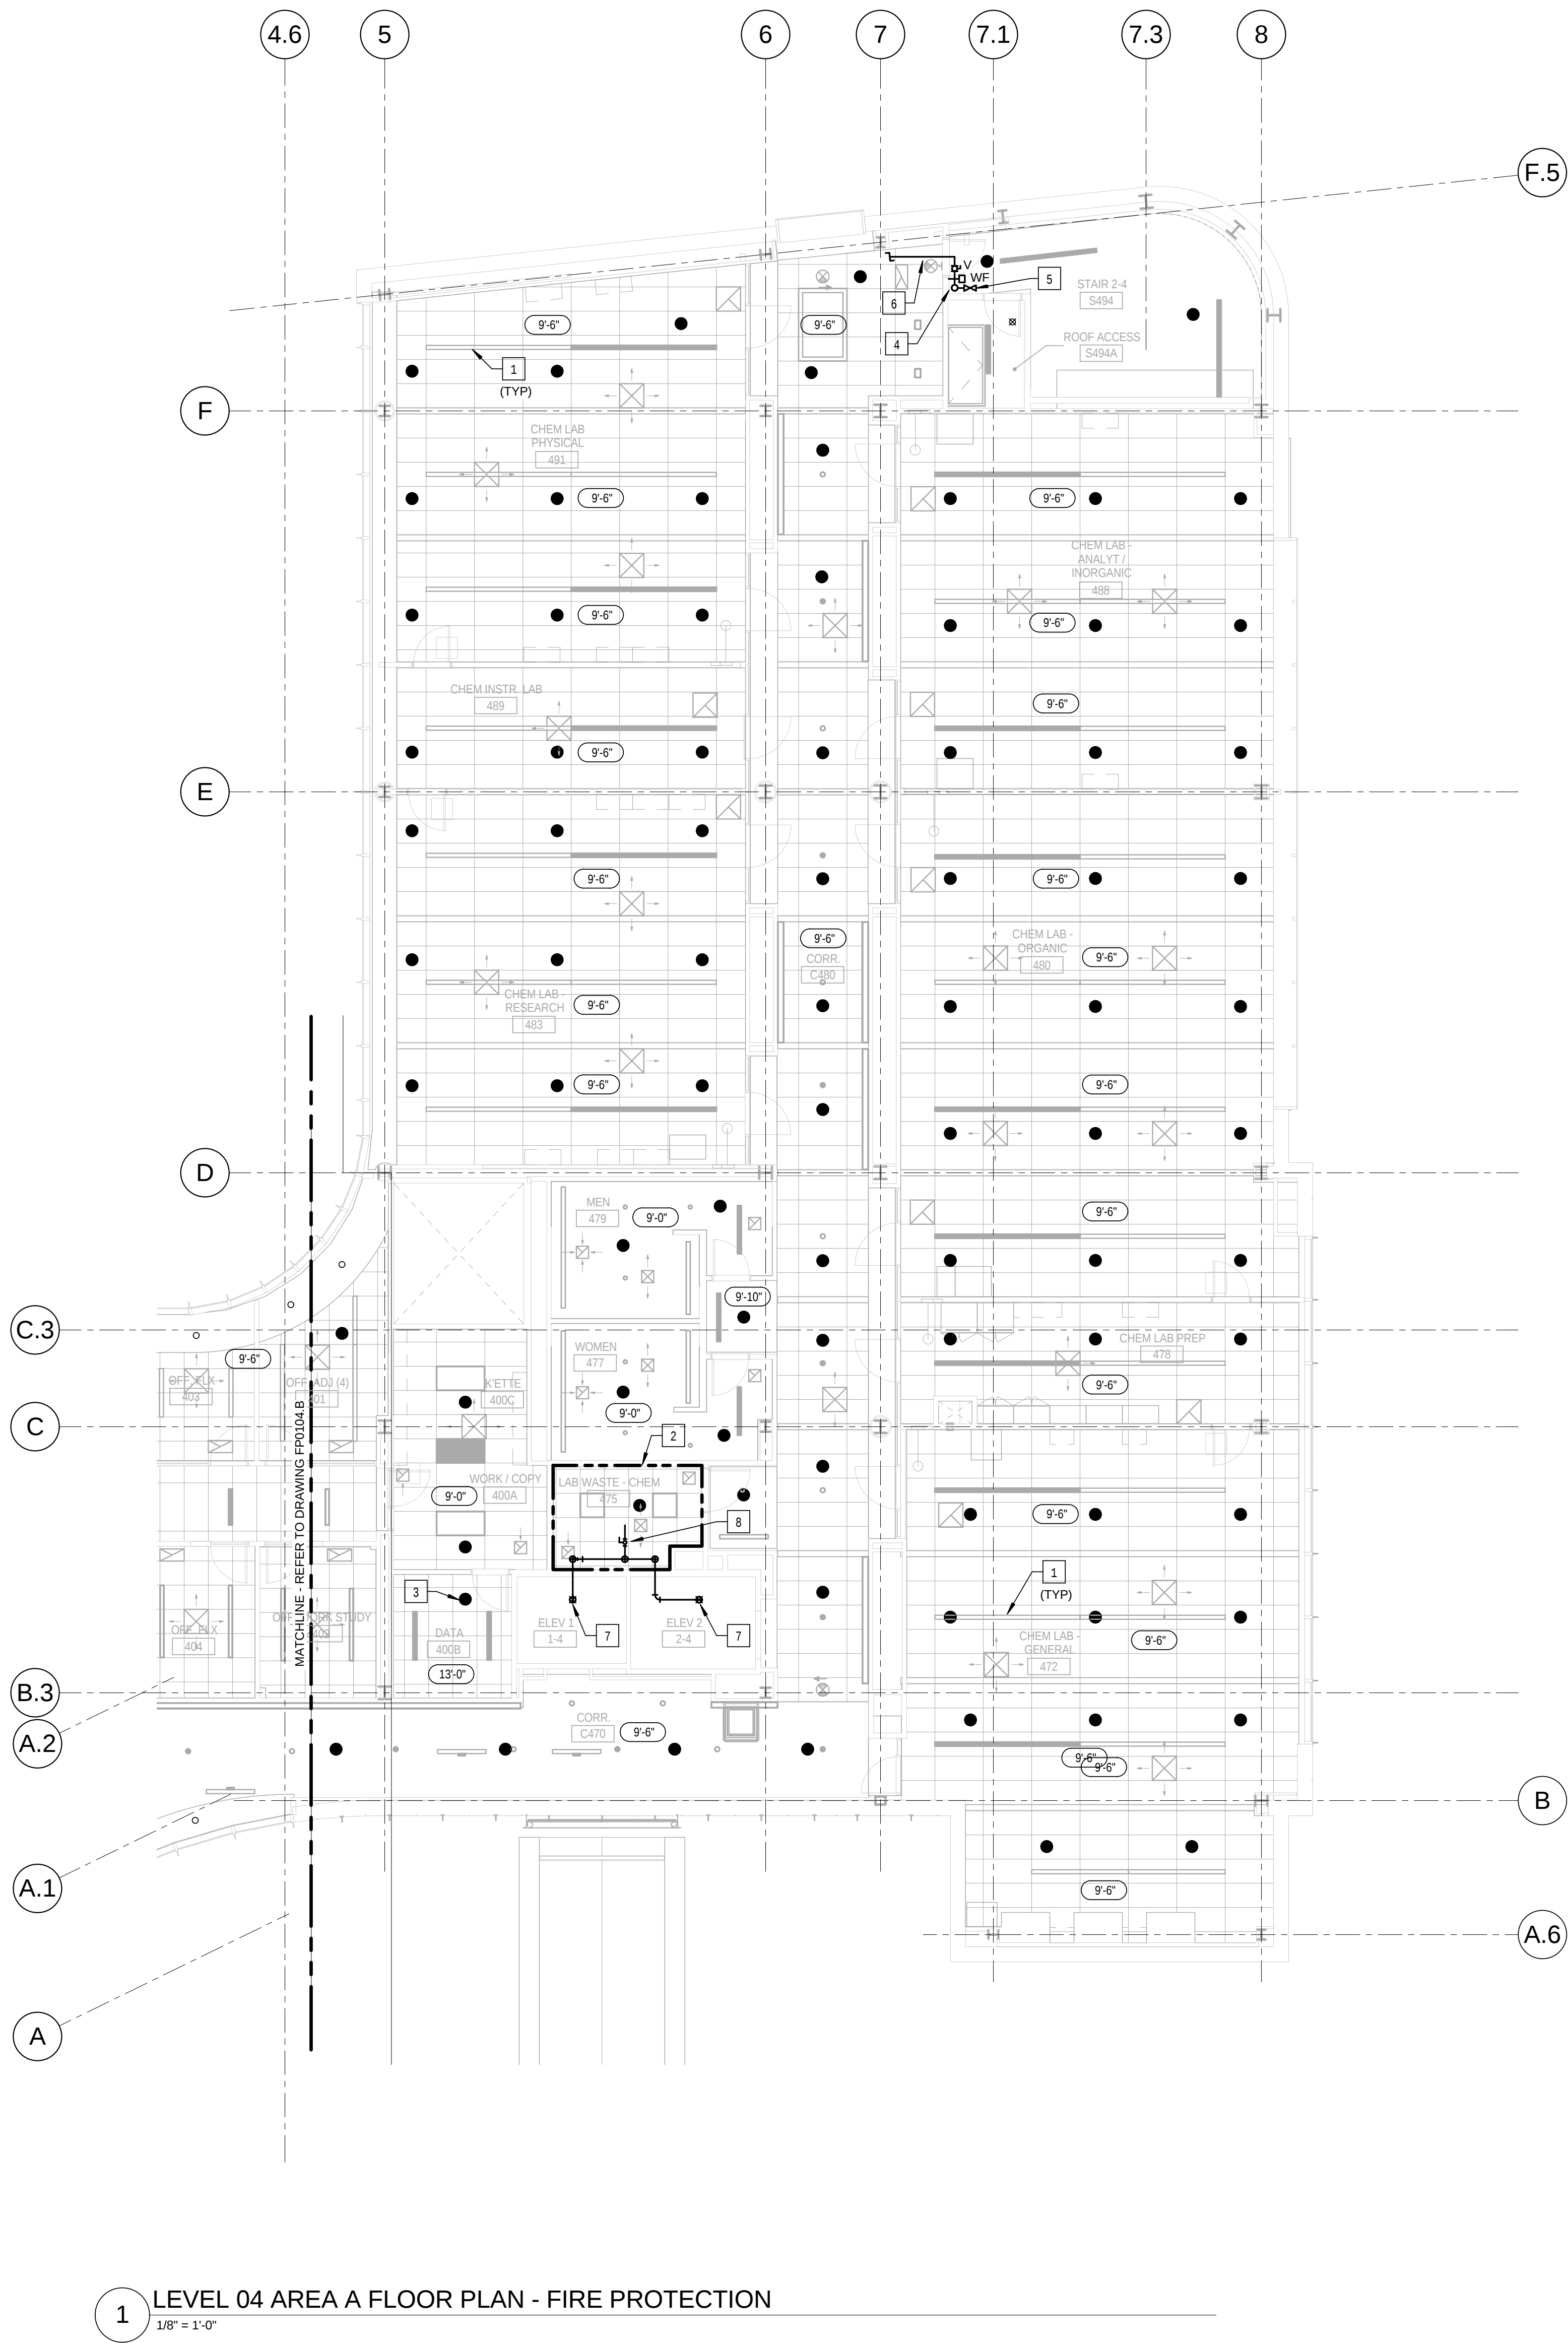

1 LEVEL 04 AREA A FLOOR PLAN - FIRE PROTECTION
1/8" = 1'-0"

KEYED NOTES: (THIS SHEET ONLY)

- COORDINATE LOCATION OF SPRINKLER HEADS WITH SUSPENDED LUMINARIES. REFER TO THE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS.
- THIS AREA IS DESIGNATED AS EXTRA HAZARD, GROUP 2.
- PROVIDE A SPRINKLER HEAD IN THIS ROOM WITH A TEMPERATURE RATING OF 200°F OR GREATER. COORDINATE LOCATION OF THE SPRINKLER HEAD AND PIPING WITH THE EQUIPMENT LAYOUT, OVERHEAD CABLE TRAY AND RACEWAY. HOLD PIPING AS HIGH AS POSSIBLE.
- FIRE SERVICE RISER, DRAIN PIPE TO BE RUN PARALLEL WITH SUPPLY RISER.
- EXPOSED 2.5 INCH ANGLE FIRE DEPARTMENT HOSE VALVE, CAP AND CHAIN.
- FIRE SPRINKLER TO EXTEND TO SERVE THIS LEVEL. PROVIDE MONITORED FLOOR ZONE CONTROL VALVE AND WATER FLOW SWITCH. REFER TO DRAWING FP0501, DETAIL 3 FOR PIPING CONFIGURATION AND REQUIREMENTS. PROVIDE ACCESS PANEL IN CEILING AS REQUIRED.
- SPRINKLER HEAD AT TOP OF ELEVATOR HOISTWAY. COORDINATE WITH GENERAL CONTRACTOR FOR THE LOCATION FO THE SPRINKLER HEAD ROUTING OF PIPING AND PIPE PENETRATION OF THE HOISTWAY.
- MONITORED ISOLATION VALVE ABOVE CEILING.