



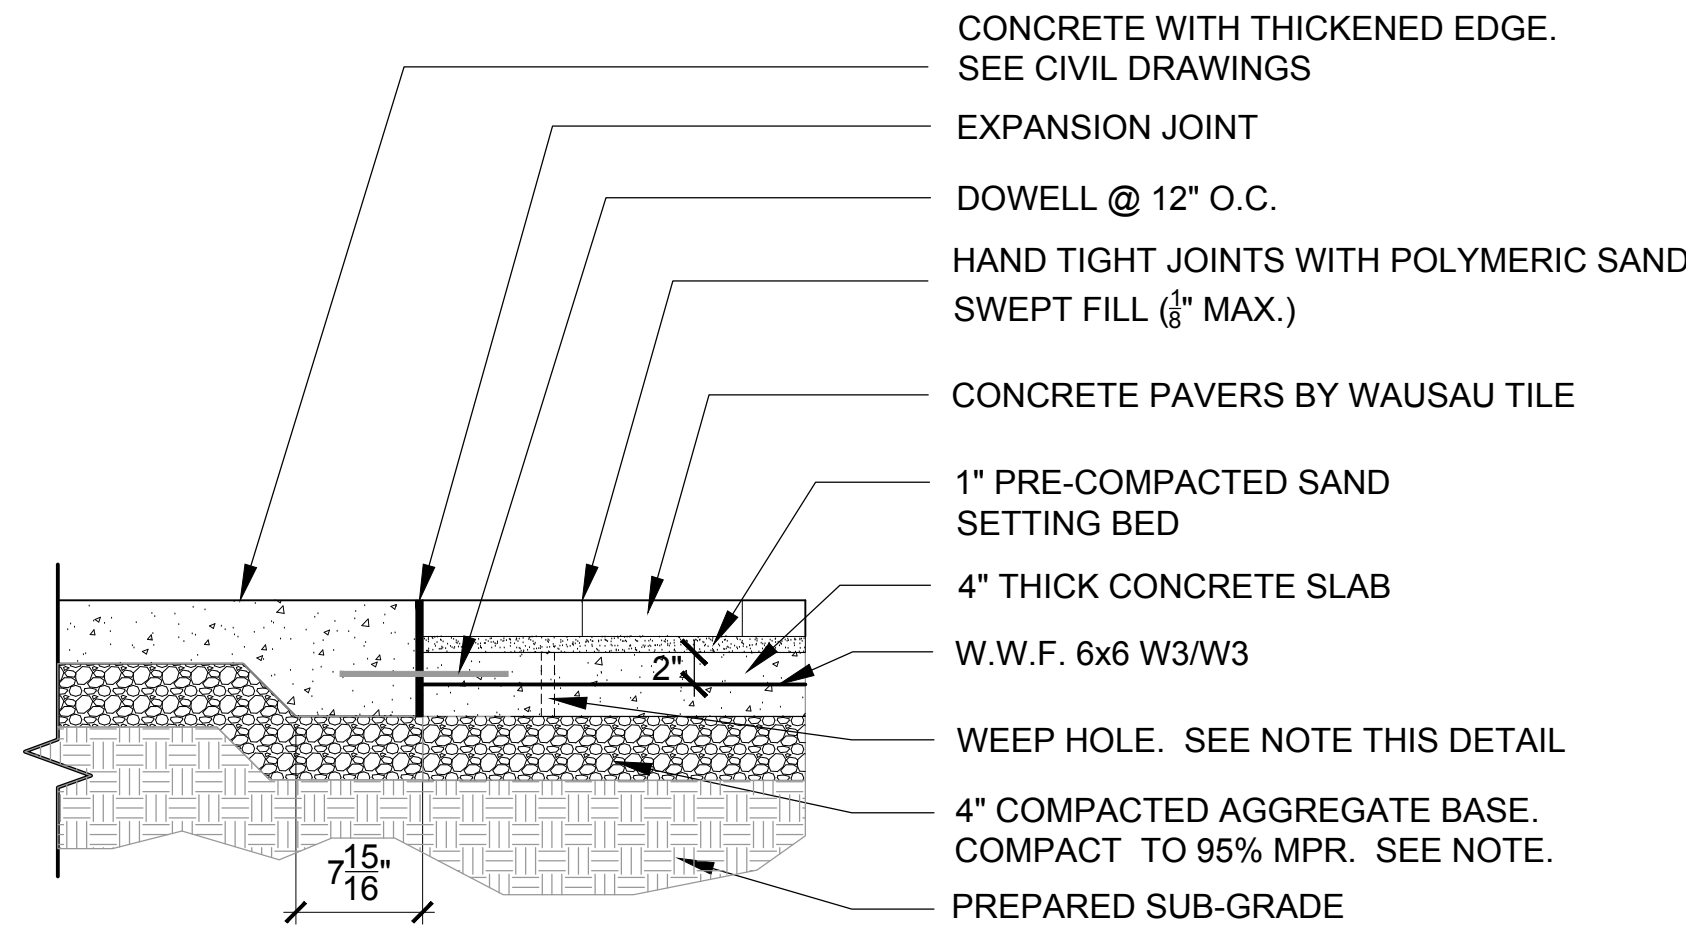


- NOTES:
1. SLOPE TOP OF CONCRETE BASE IN ACCORDANCE WITH GRADING PLAN
 2. PROVIDE $\frac{3}{4}$ " WEEPS AT LOW POINTS 24" O.C. AND/OR 5' O.C. EACH WAY, COVER WEEPS WITH FILTER FABRIC. CONTRACTOR TO PROVIDE LAYOUT FOR APPROVAL
 3. SEE LAYOUT PLAN WHERE CONCRETE IS ADJACENT TO PAVERS.
 4. MPR = MATERIALS MODIFIED PROCTOR - ASTM D 1557 - MAXIMUM DRY DENSITY (TYP.)

A PAVERS ON CONCRETE BASE
NTS

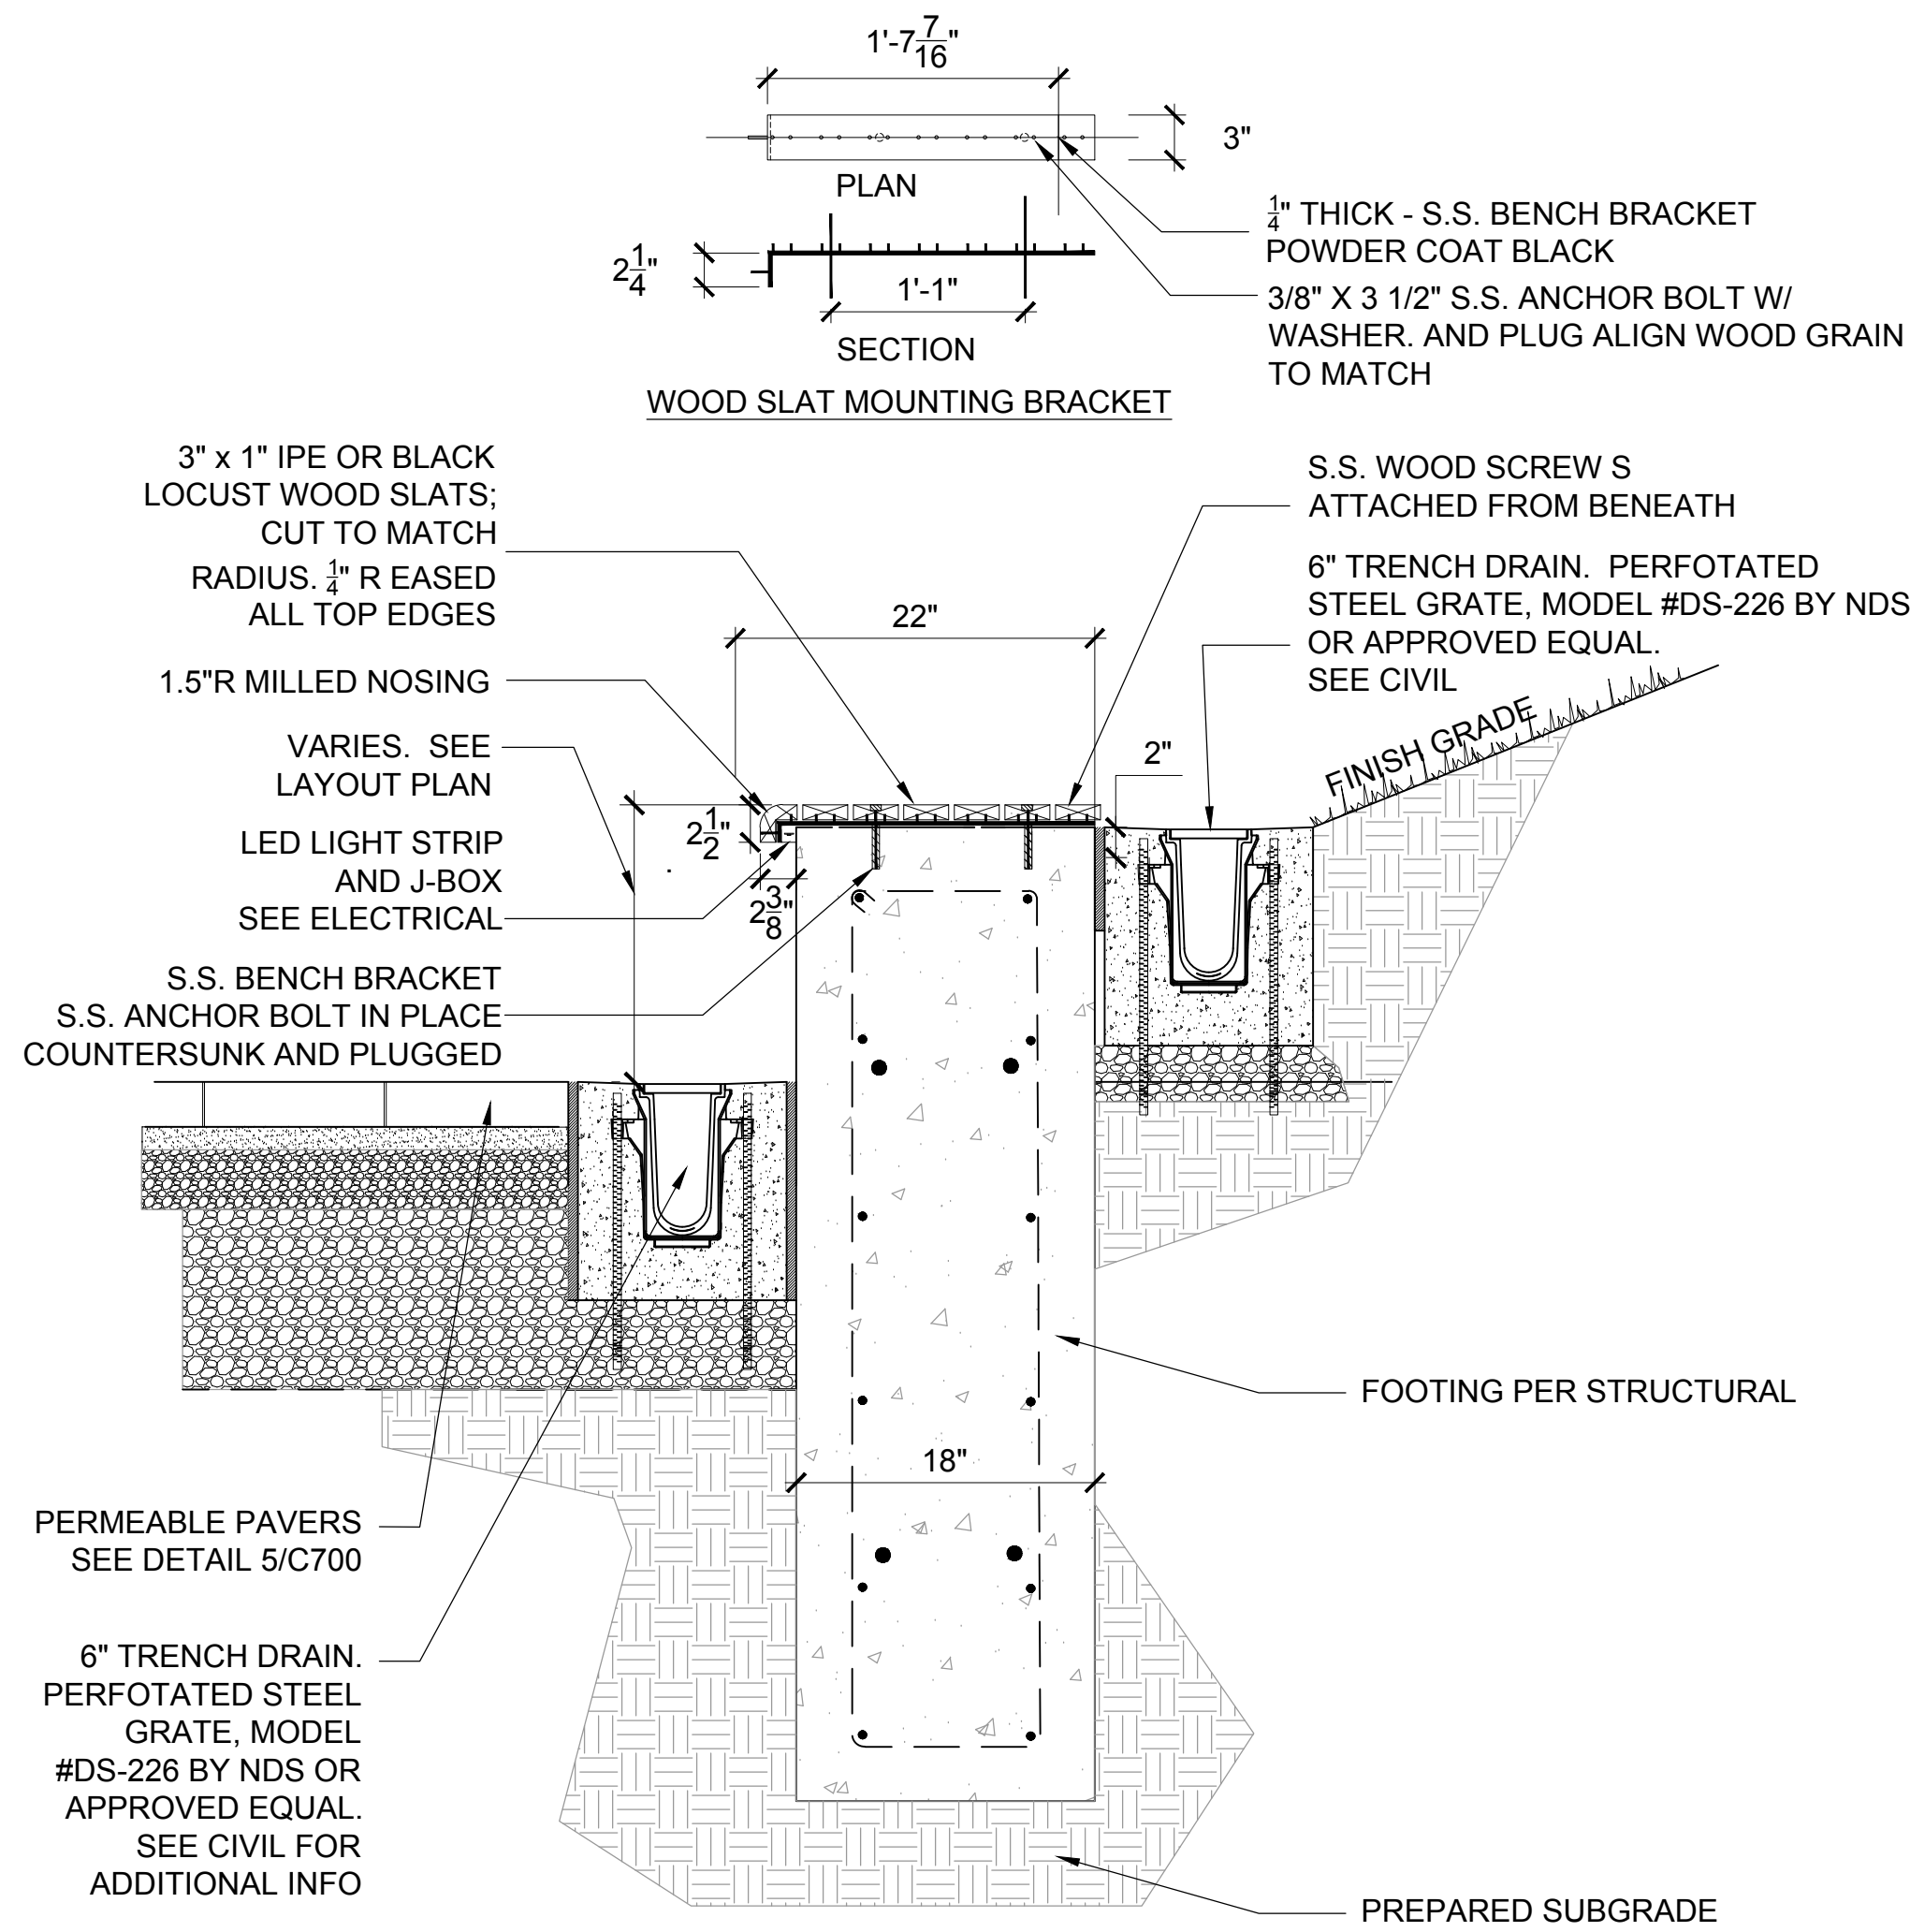


- NOTES:
1. PROVIDE SHOP DRAWINGS.
 2. PREPARED SUBGRADE IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL ENGINEERING REPORT.
 3. MPR = MATERIALS MODIFIED PROCTOR - ASTM D 1557 - MAXIMUM DRY DENSITY (TYP.)
 4. ALL GLUE UPS FOR OUT DOOR INSTALLATIONS SHALL BE WATERPROOF GLUES.
 5. ALL WOOD TO BE FURNISHED 4 SIDES.


D SEATWALL WITH WOOD TOP
NTS

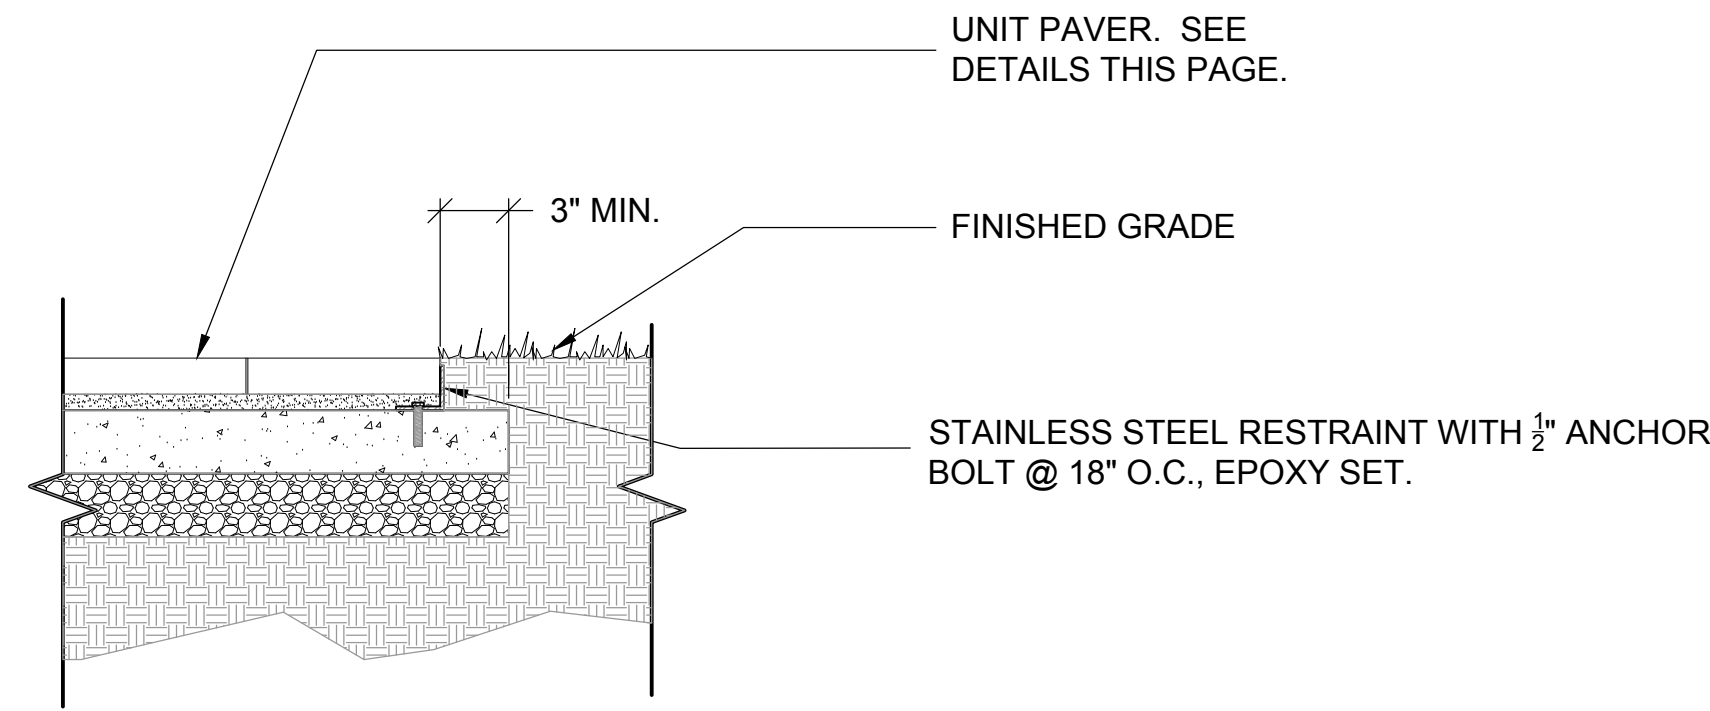

B PAVERS EDGE RESTRAINT
NTS

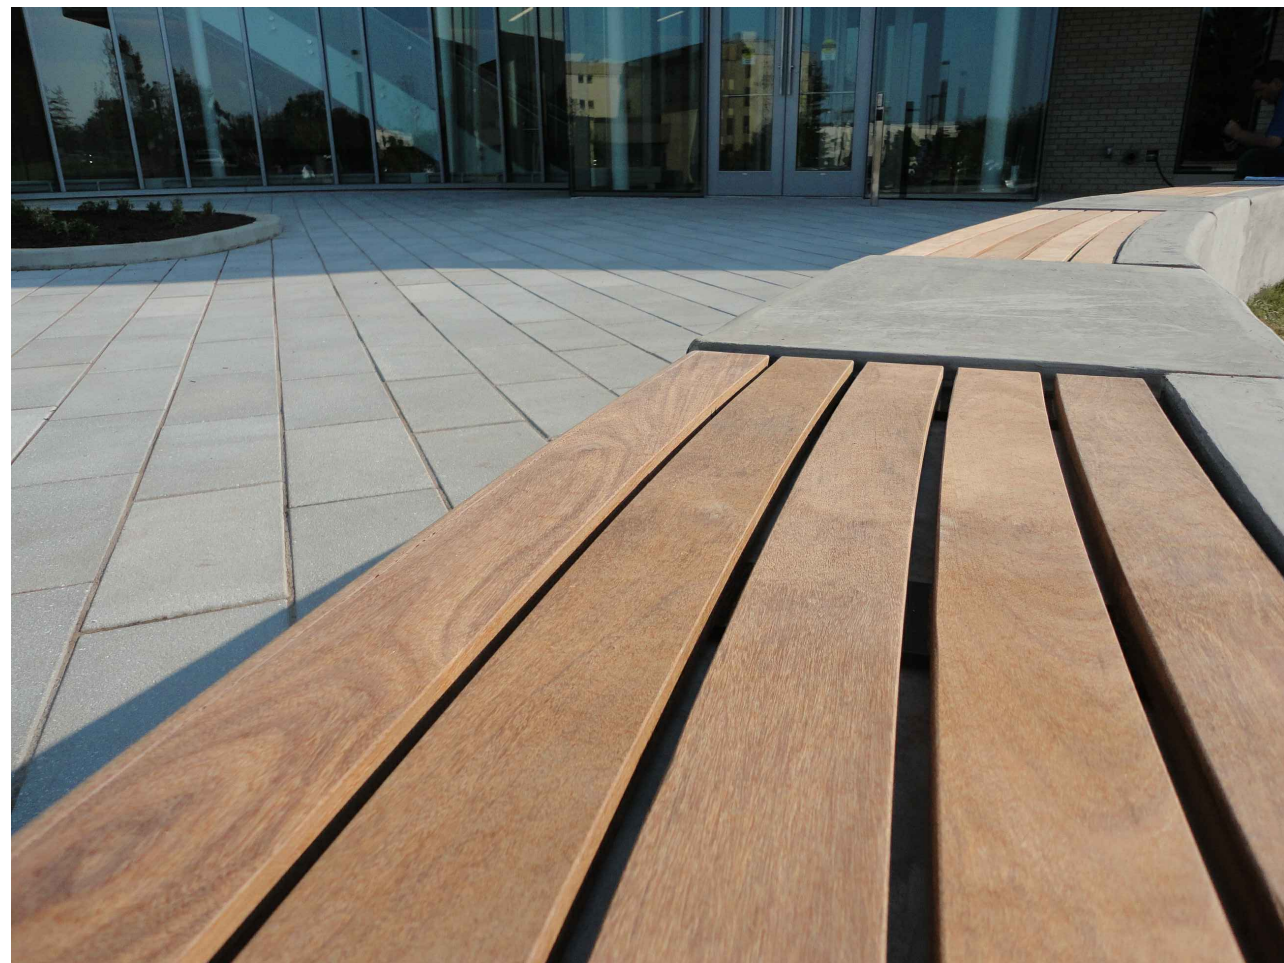


E SEATWALL CHARACTER IMAGES (FOR REFERENCE ONLY)
NTS

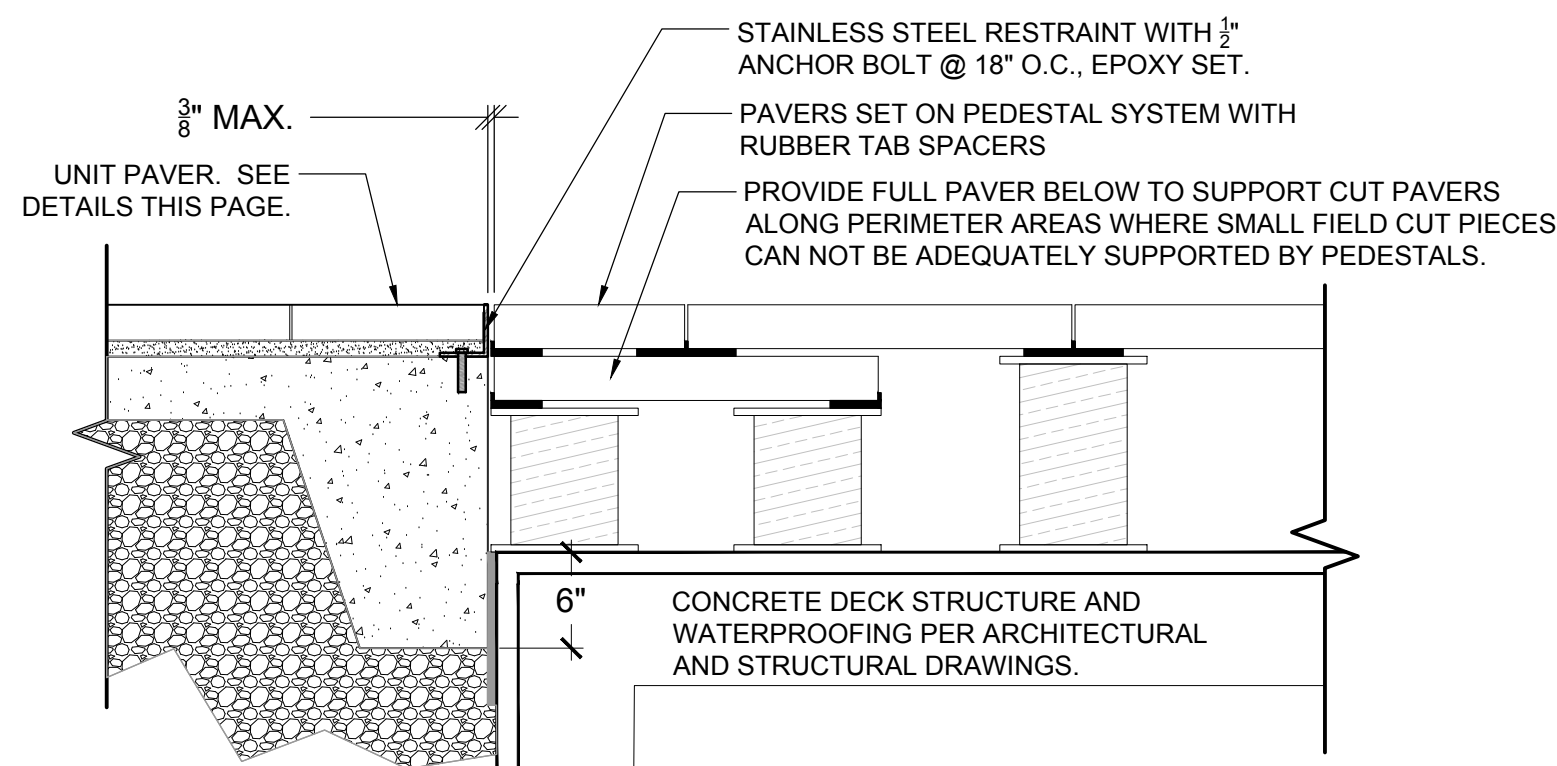


F PAVER JOINT AT BUILDING EDGE BELOW GRADE
NTS



C PAVERS CHARACTER IMAGE (FOR REFERENCE ONLY)
NTS

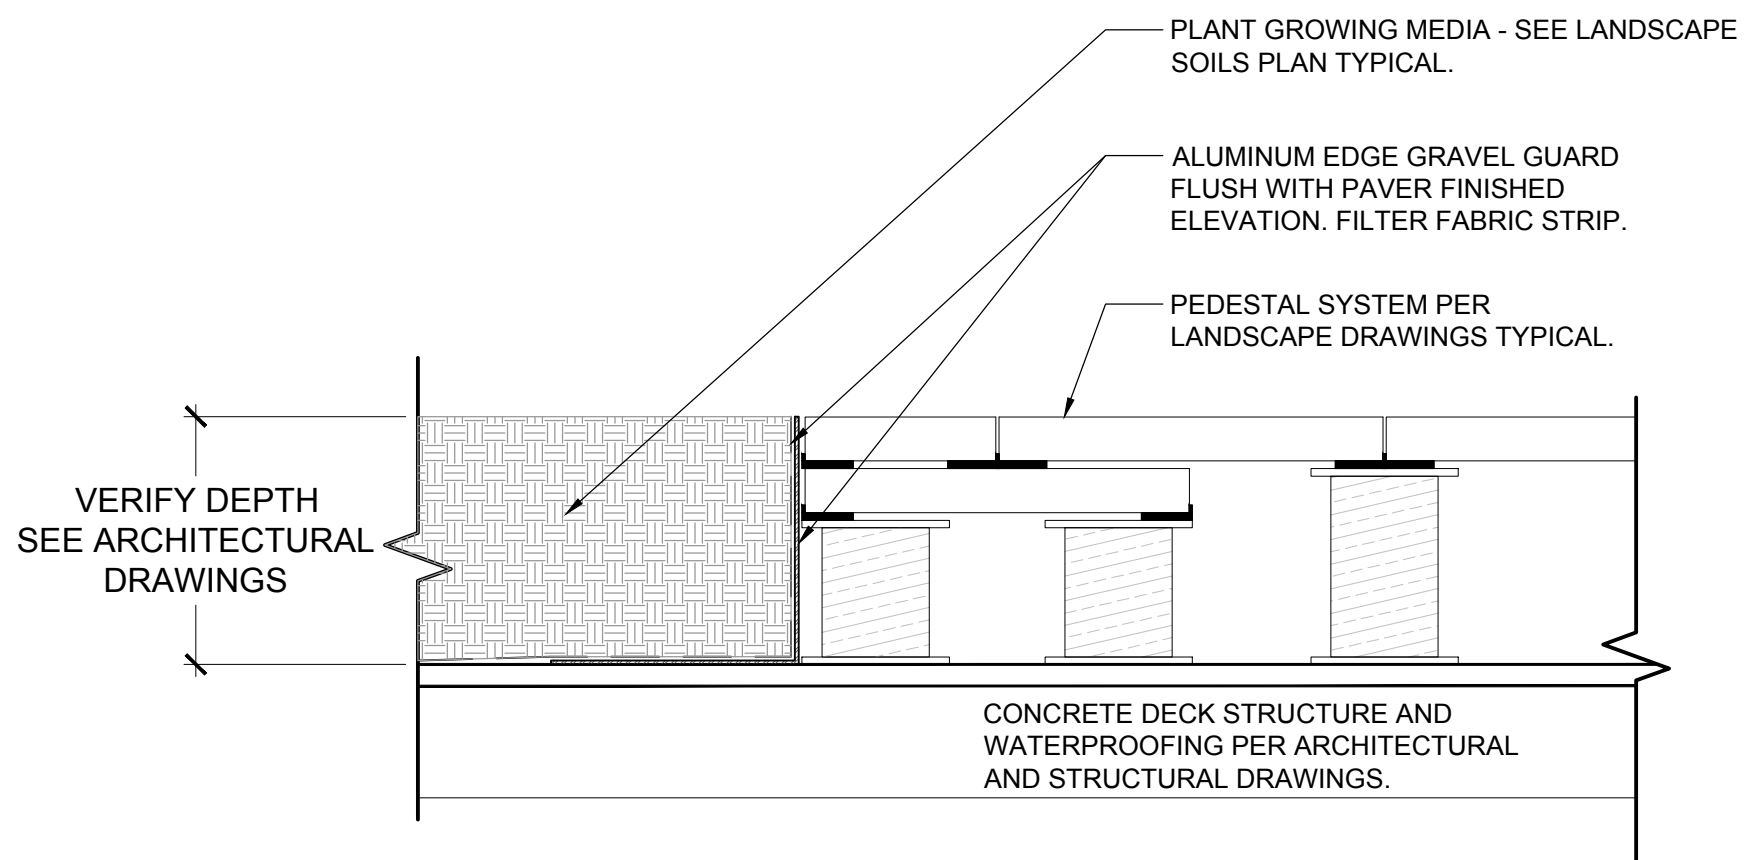

G PAVER JOINT AT BUILDING EDGE BELOW GRADE
NTS

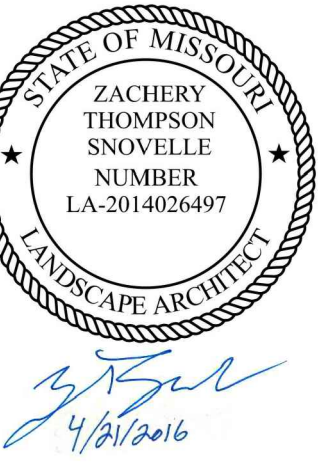

CONFORMED SET 01 JUL 2016

1	ADDENDUM 3-3	21 APR 2016
-	ISSUED FOR CONSTRUCTION (BP3)	15 MAR 2016
No.	Description	Date

Drawing Title:

SITE DETAILS

SWT Project No.: 20018.01 Checked by:

L501