
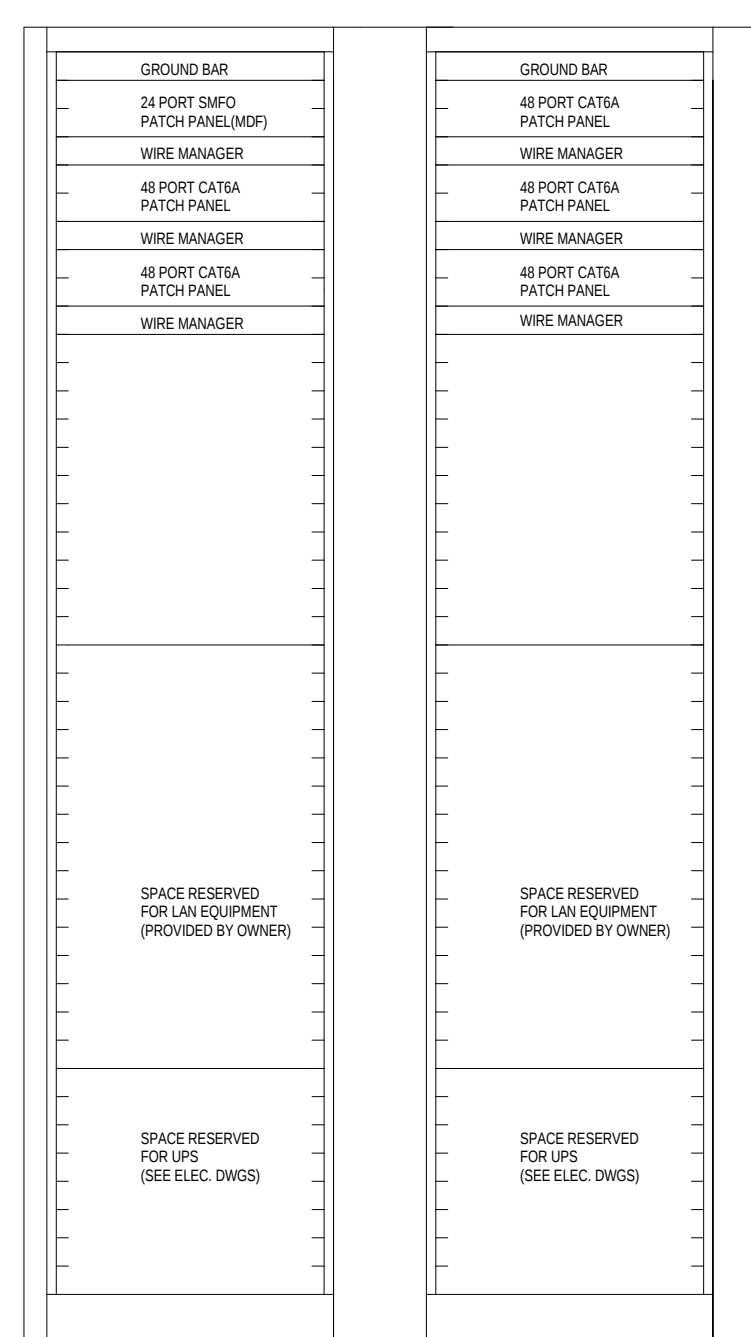
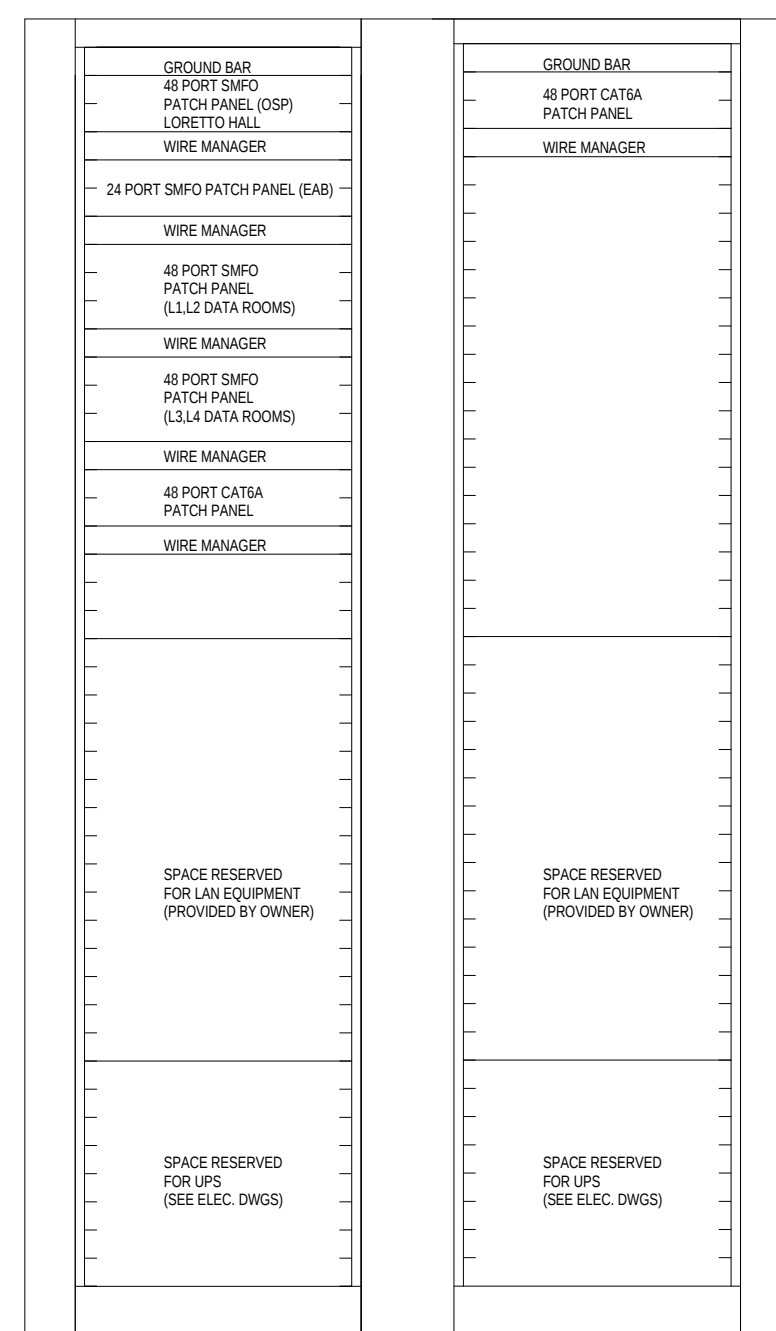
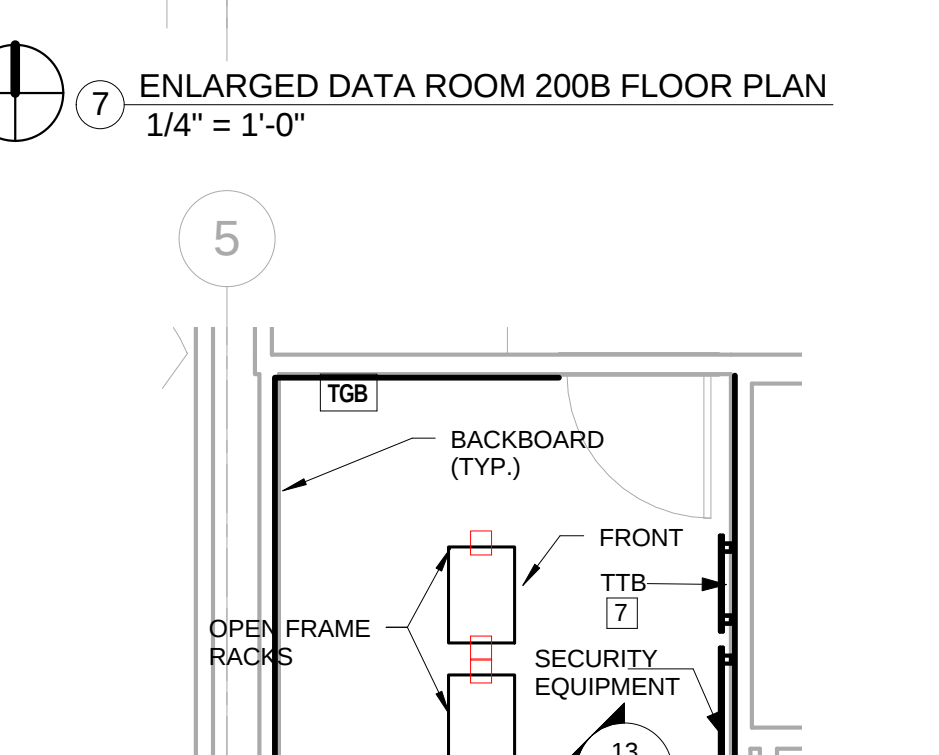
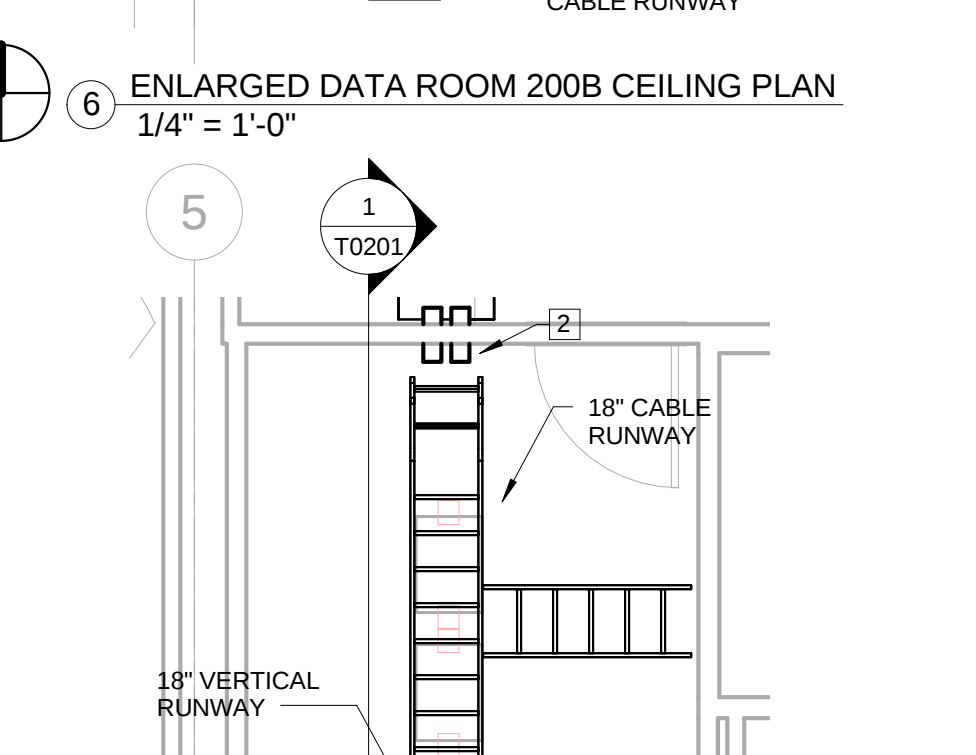
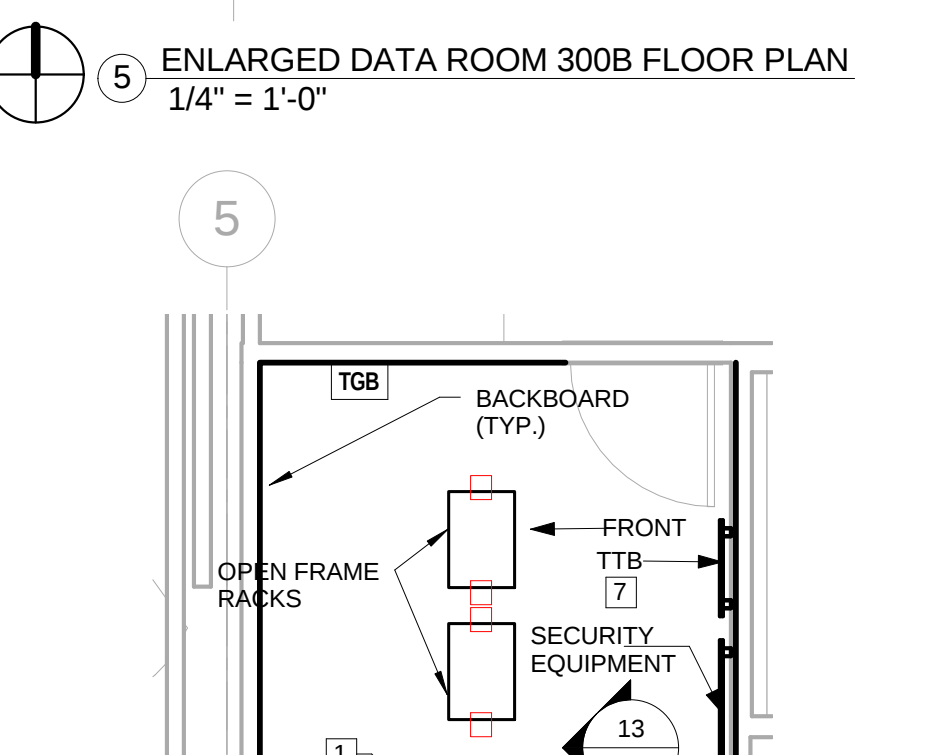
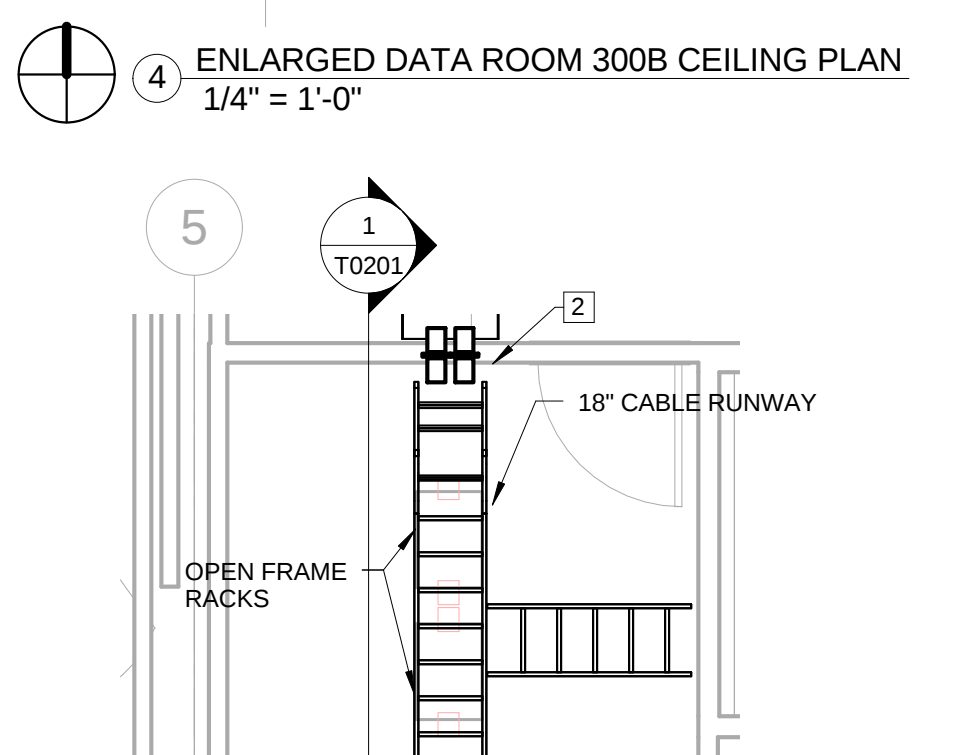
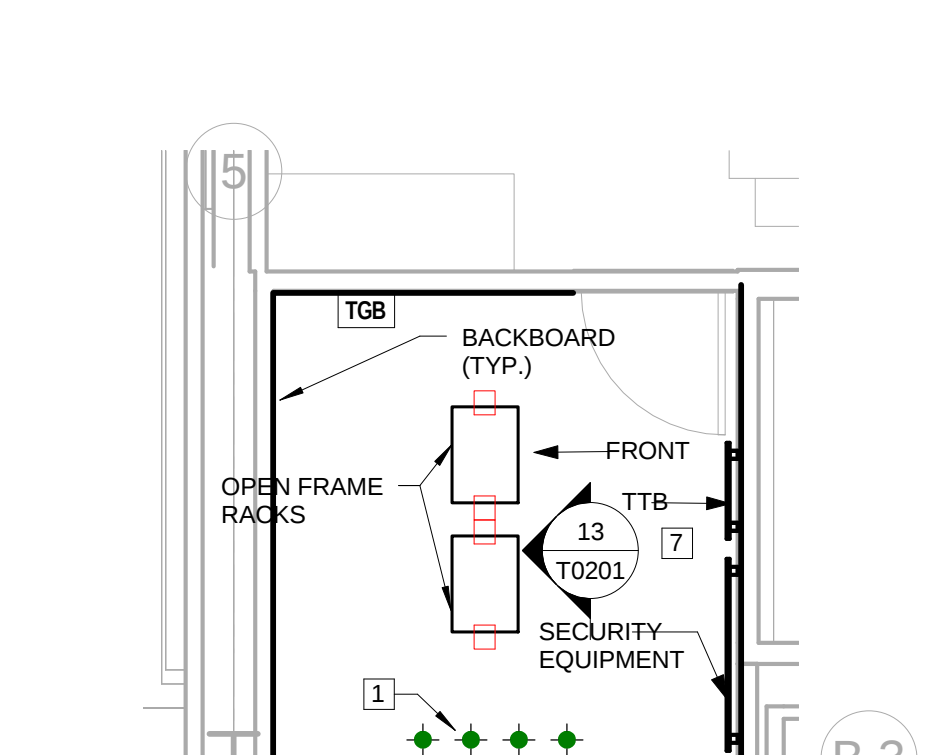
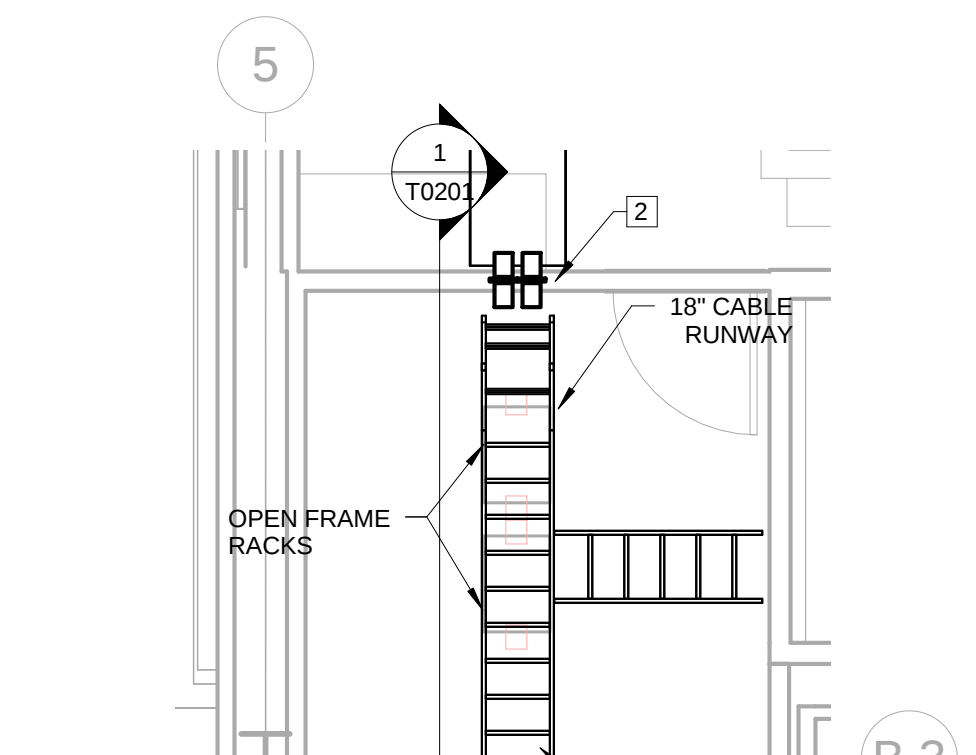
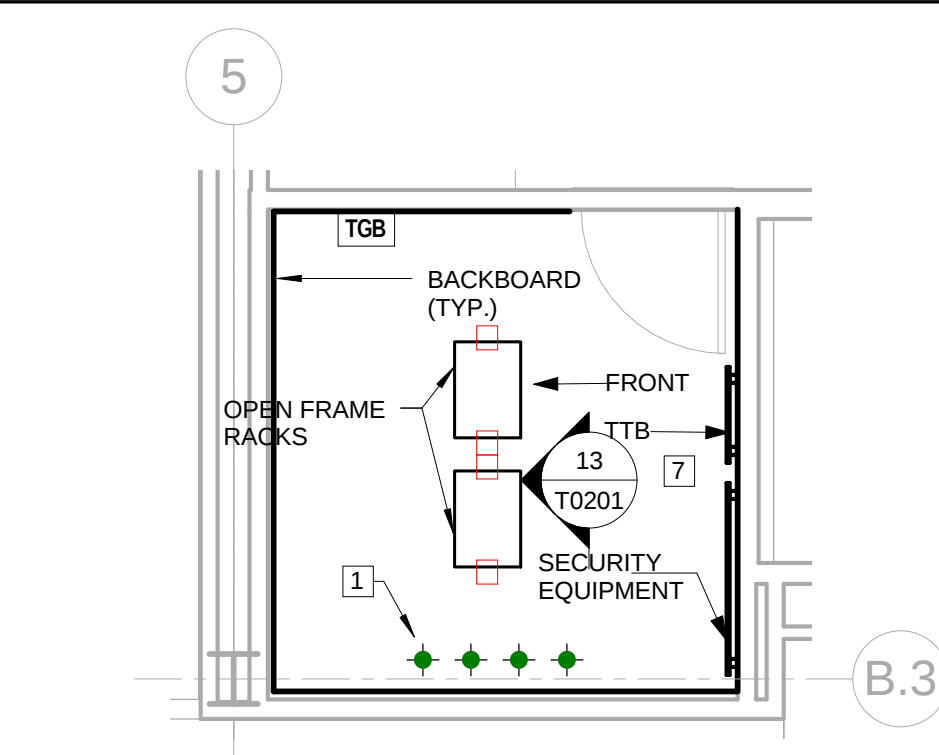
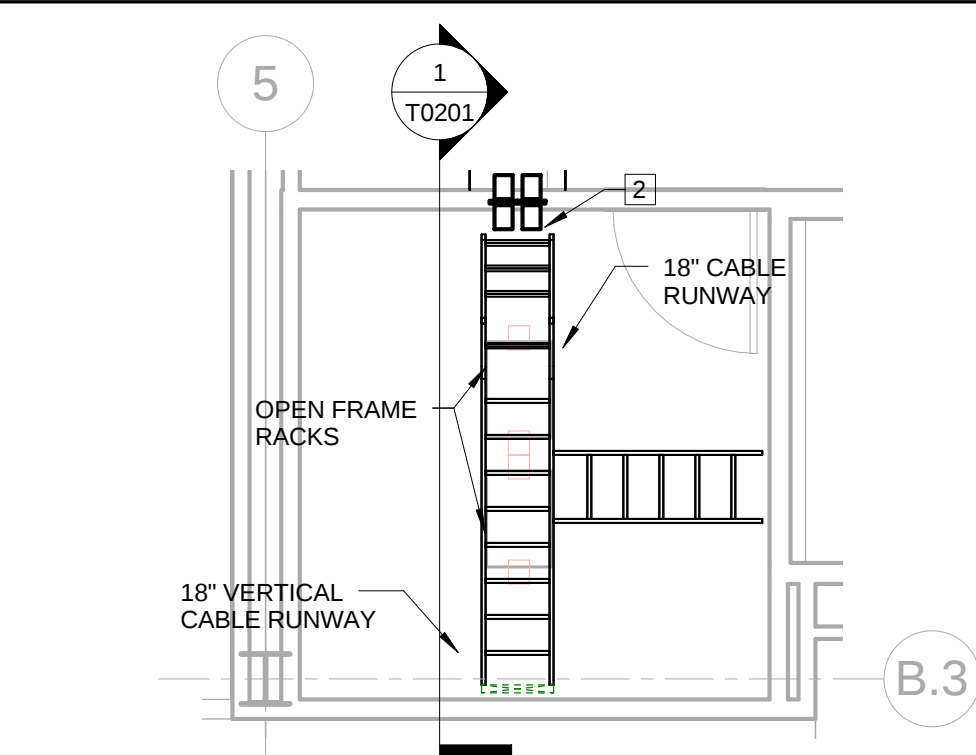


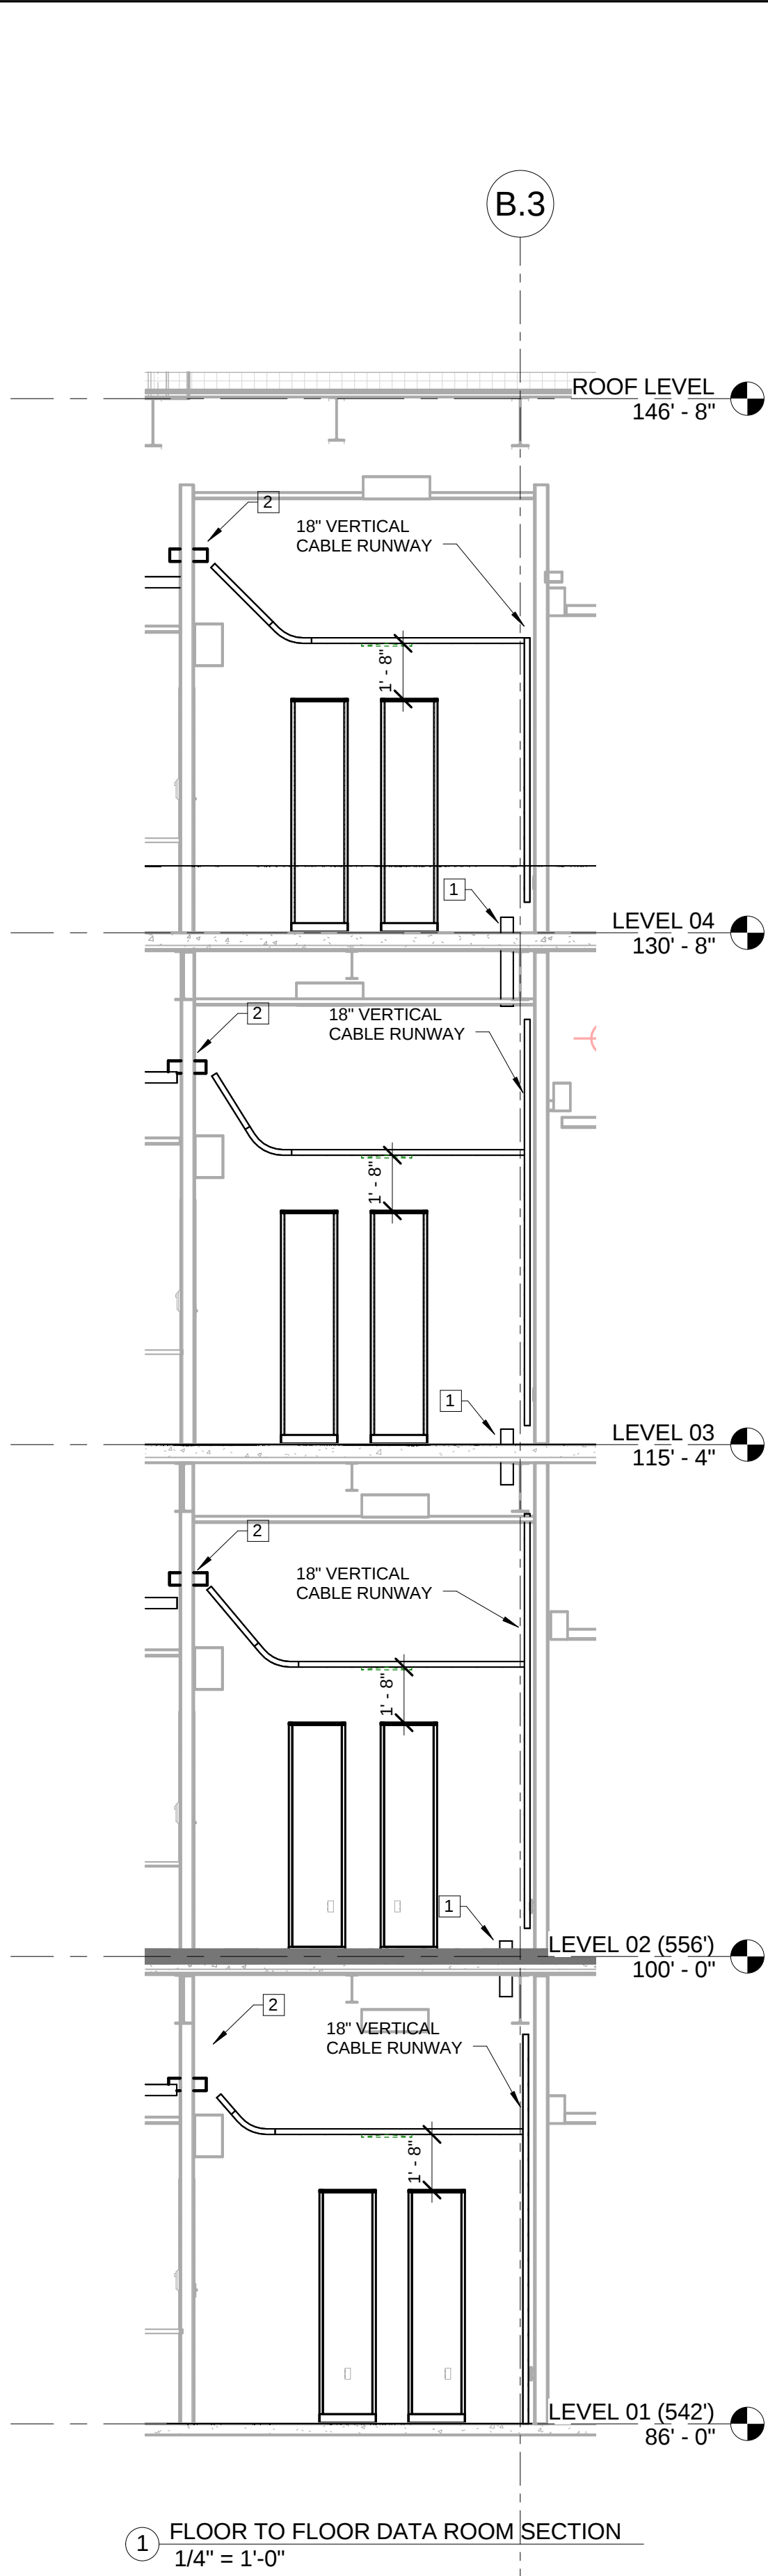

GENERAL NOTES:





THIS SHEET ONLY

1. CONFIRM LOCATION OF ALL COPPER AND FIBER PATCH PANELS WITH WEBSTER UNIVERSITY IT DEPARTMENT PRIOR TO INSTALLATION.
2. PROVIDE 3/4" THICK FIRE RATED PLYWOOD BACKBOARDS ON ALL WALLS OF THE MDF ROOM AND DATA ROOMS. BACKBOARD SHALL STAND 6" A.F.F. AND EXTEND 8'-0" HIGH. PAINT ALL SIX (6) SIDES BACKBOARD WITH WHITE FIRE RETARDANT PAINT LEAVING FIRE RATED LABELS EXPOSED.

KEYED NOTES:

THIS SHEET ONLY

1. PROVIDE FLOOR MOUNTED FIRE RATED PATHWAYS. SEE SPECIFICATION SECTION 078413 FOR MORE INFORMATION.
2. PROVIDE WALL MOUNTED FIRE RATED PATHWAYS. SEE SPECIFICATION SECTION 078413 FOR MORE INFORMATION.
3. PROVIDE QUAZITE #PG3636A36 (TIER 22) HAND HOLE WITH A #PG3636HA00 HEAVY DUTY COVER. LOGO SHALL READ "COMMUNICATION".
4. PROVIDE (4) 4" SCHEDULE 40 PVC CONDUITS. PROVIDE STEEL SLEEVES FOR EACH CONDUIT PENETRATION THROUGH THE WALL. PROVIDE WATER TIGHT SEAL. PROVIDE (3) 1 1/4" INNERDUCTS WITH PULL STRINGS IN ONE OF THE CONDUITS. PROVIDE PULL STRINGS IN THE REMAINING (3) CONDUITS.
5. TO HANDHOLE #6. SEE SHEETS T0100 AND T0201 FOR MORE INFORMATION.
6. PROVIDE 48 PORT SMO WALL MOUNT PATCH PANEL (SEE "PDS BACKBONE CABLING DIAGRAM" ON SHEET T0801). ATTACH TO THE EXISTING PLYWOOD BACKBOARD. THE OWNER SHALL BE RESPONSIBLE FOR REMOVING ABANDONED WALL MOUNTED EQUIPMENT TO MAKE ROOM FOR THE PATCH PANEL. SECURE CABLE TO EXISTING PLYWOOD BACKBOARD EVERY 48" O.C. WITH VELCRO STRAPS. SEE DETAIL #3 ON SHEET T0801.
7. PROVIDE 50 PAIR 66M PUNCHDOWN BLOCK FOR TERMINATION OF ANALOG COPPER BACKBONE CABLING.
8. EXISTING 4" UNDERGROUND CONDUIT UP TO HANDHOLE #5. SEE SHEET T0100.

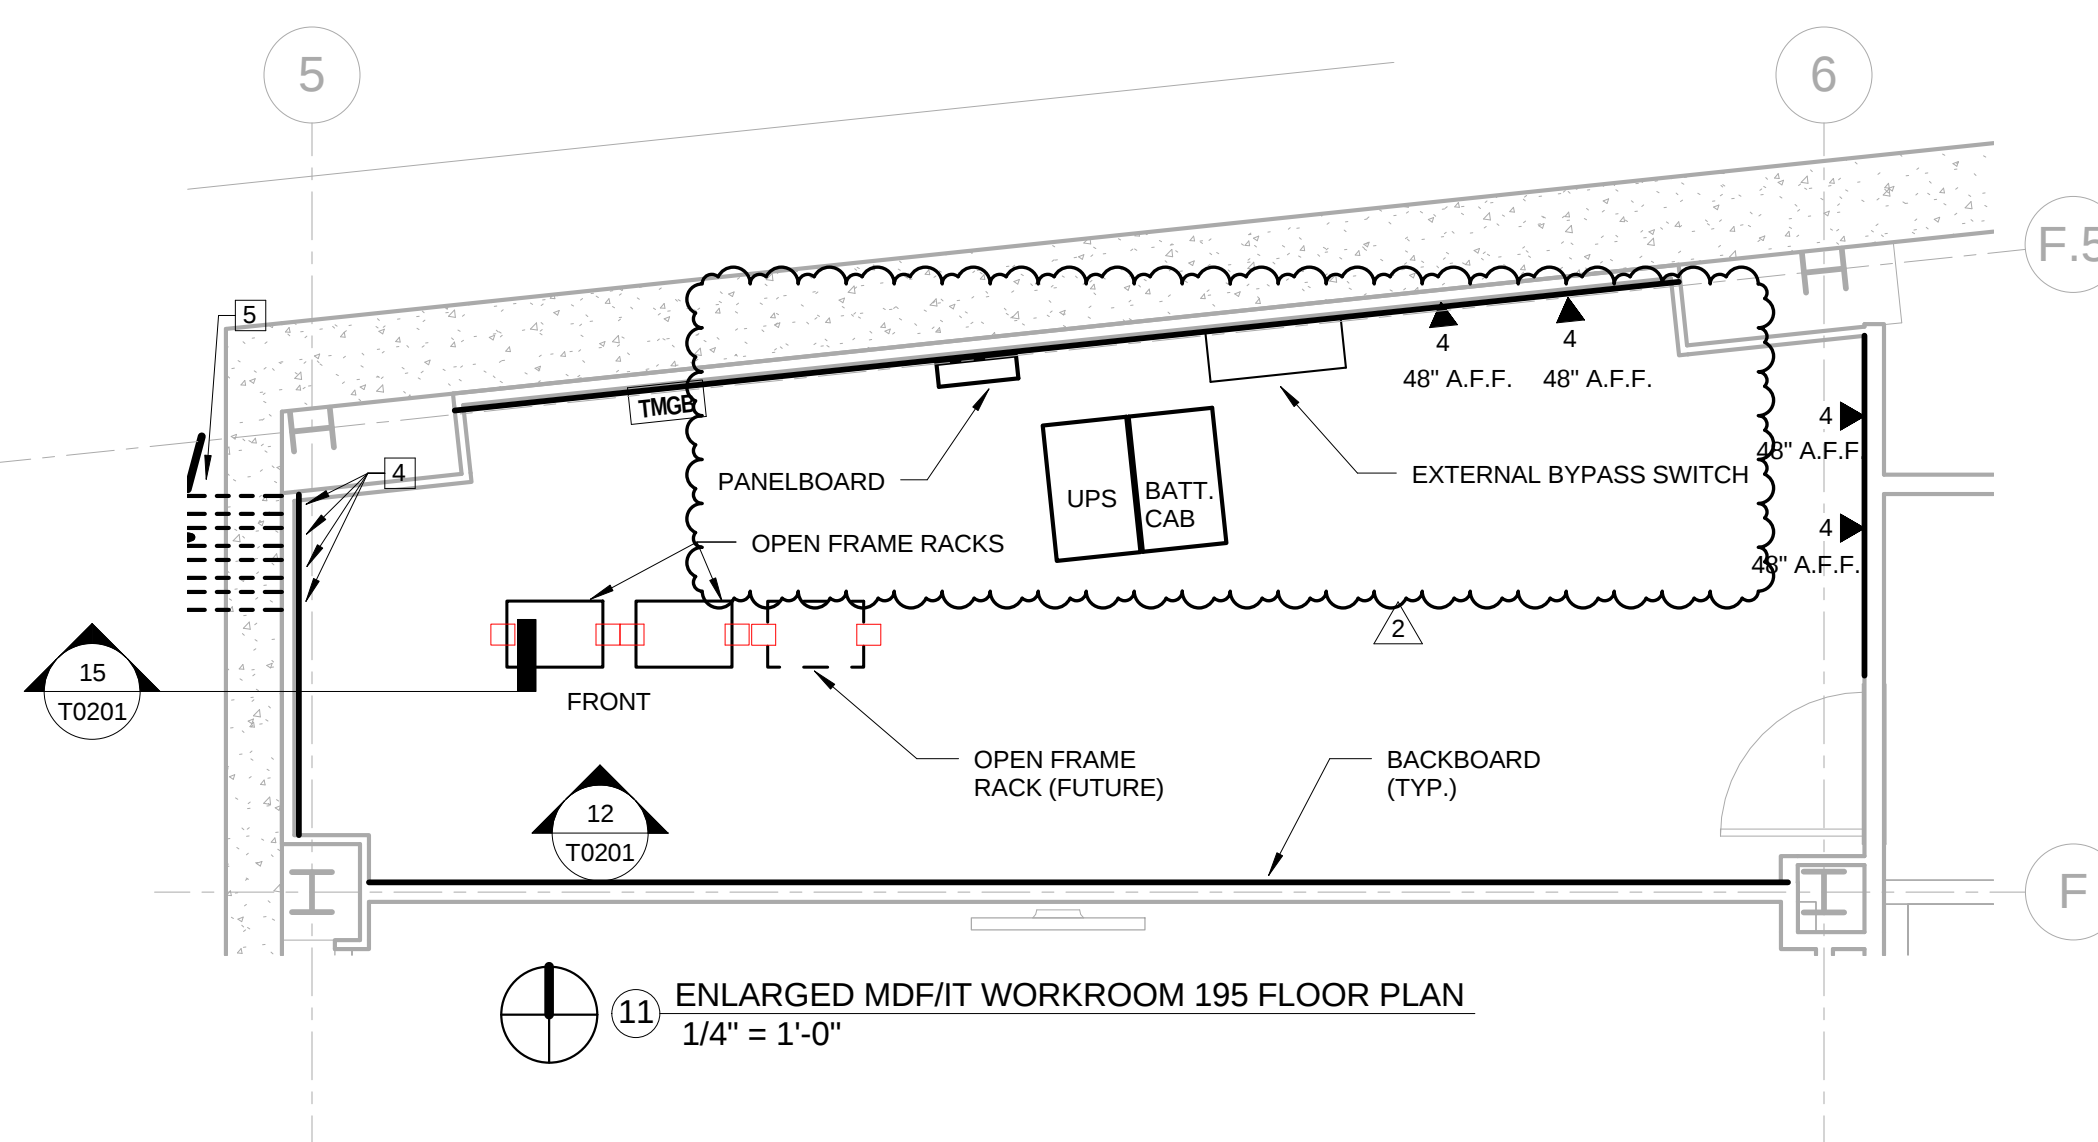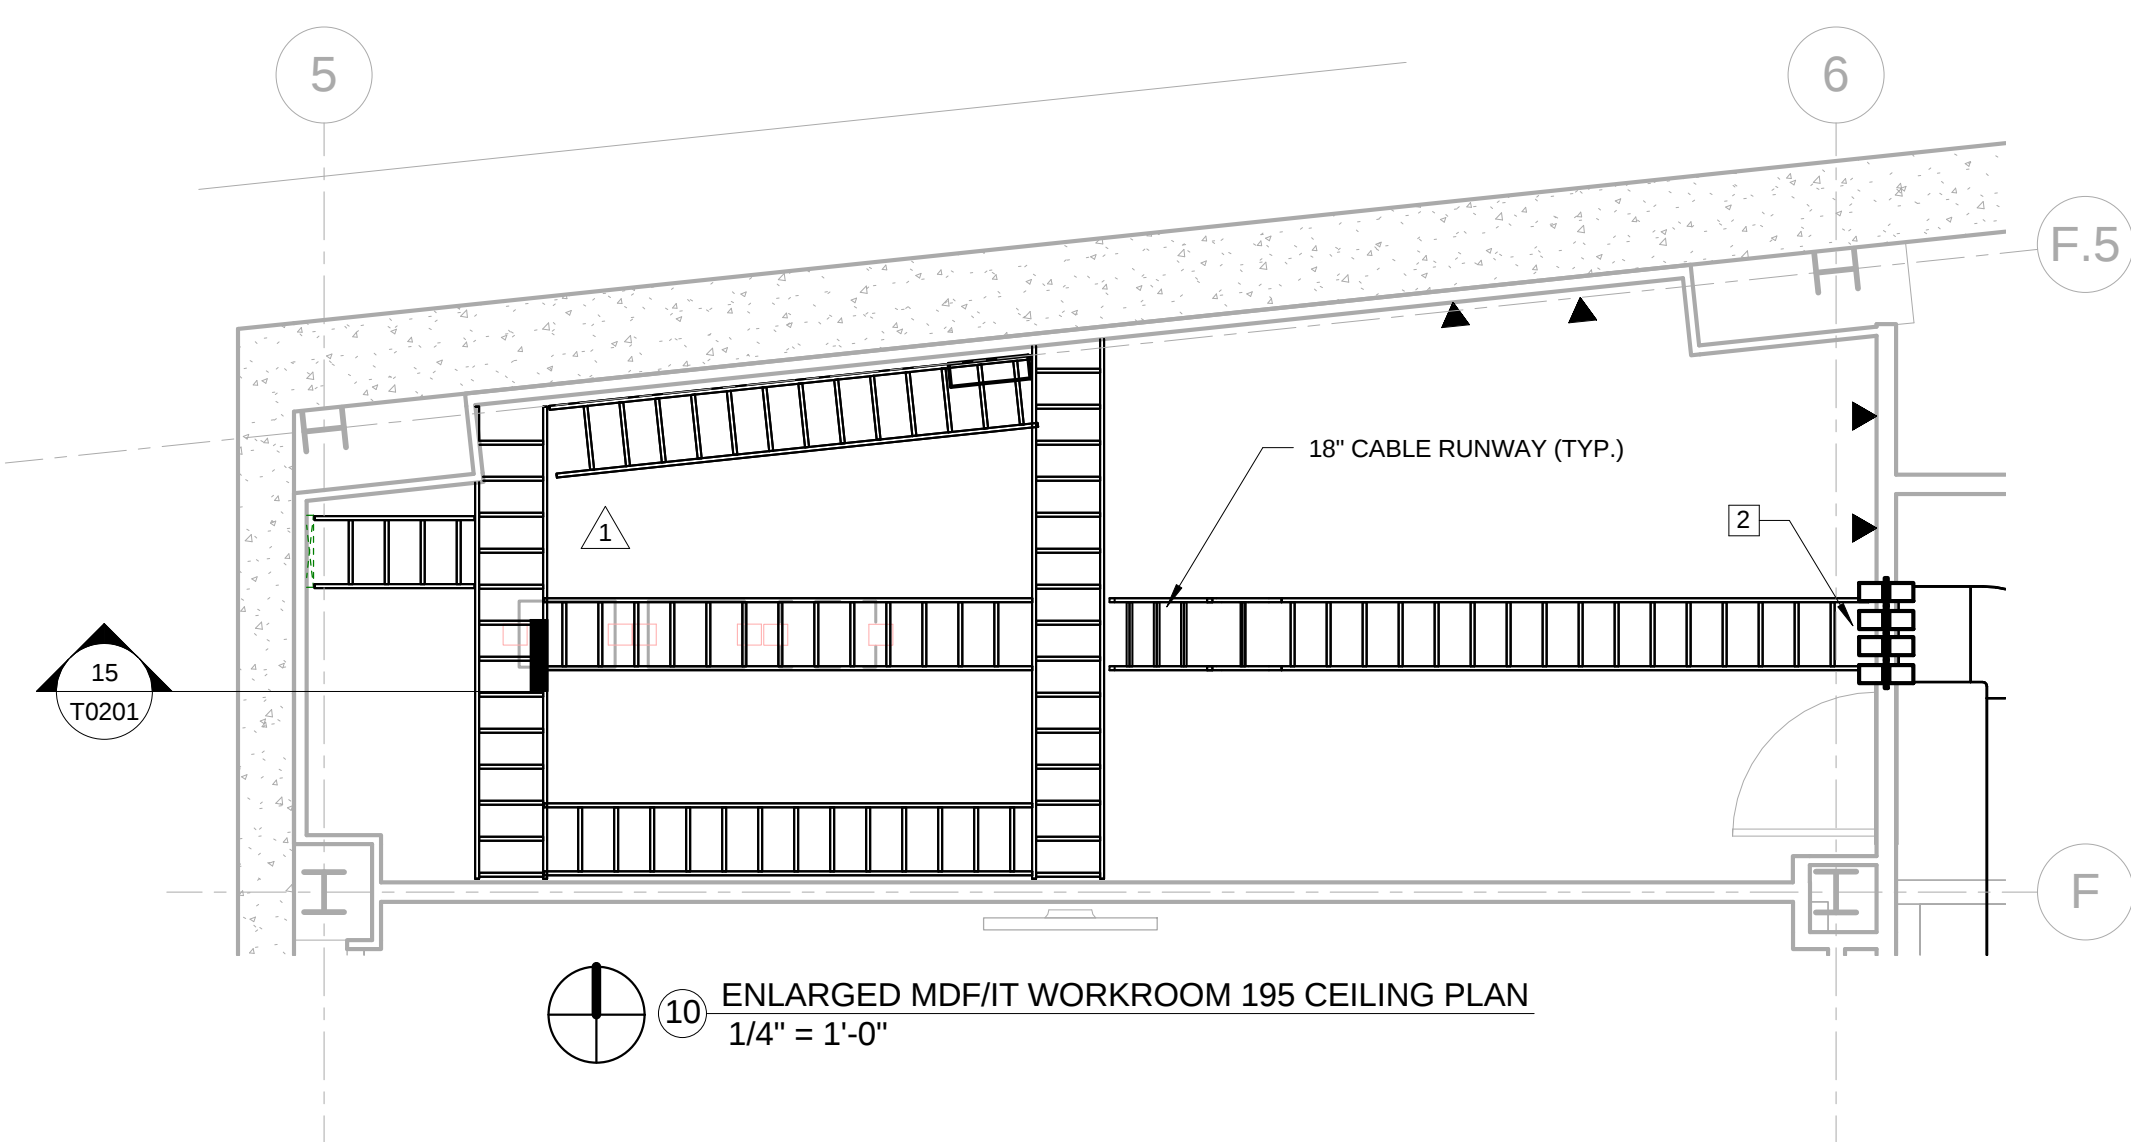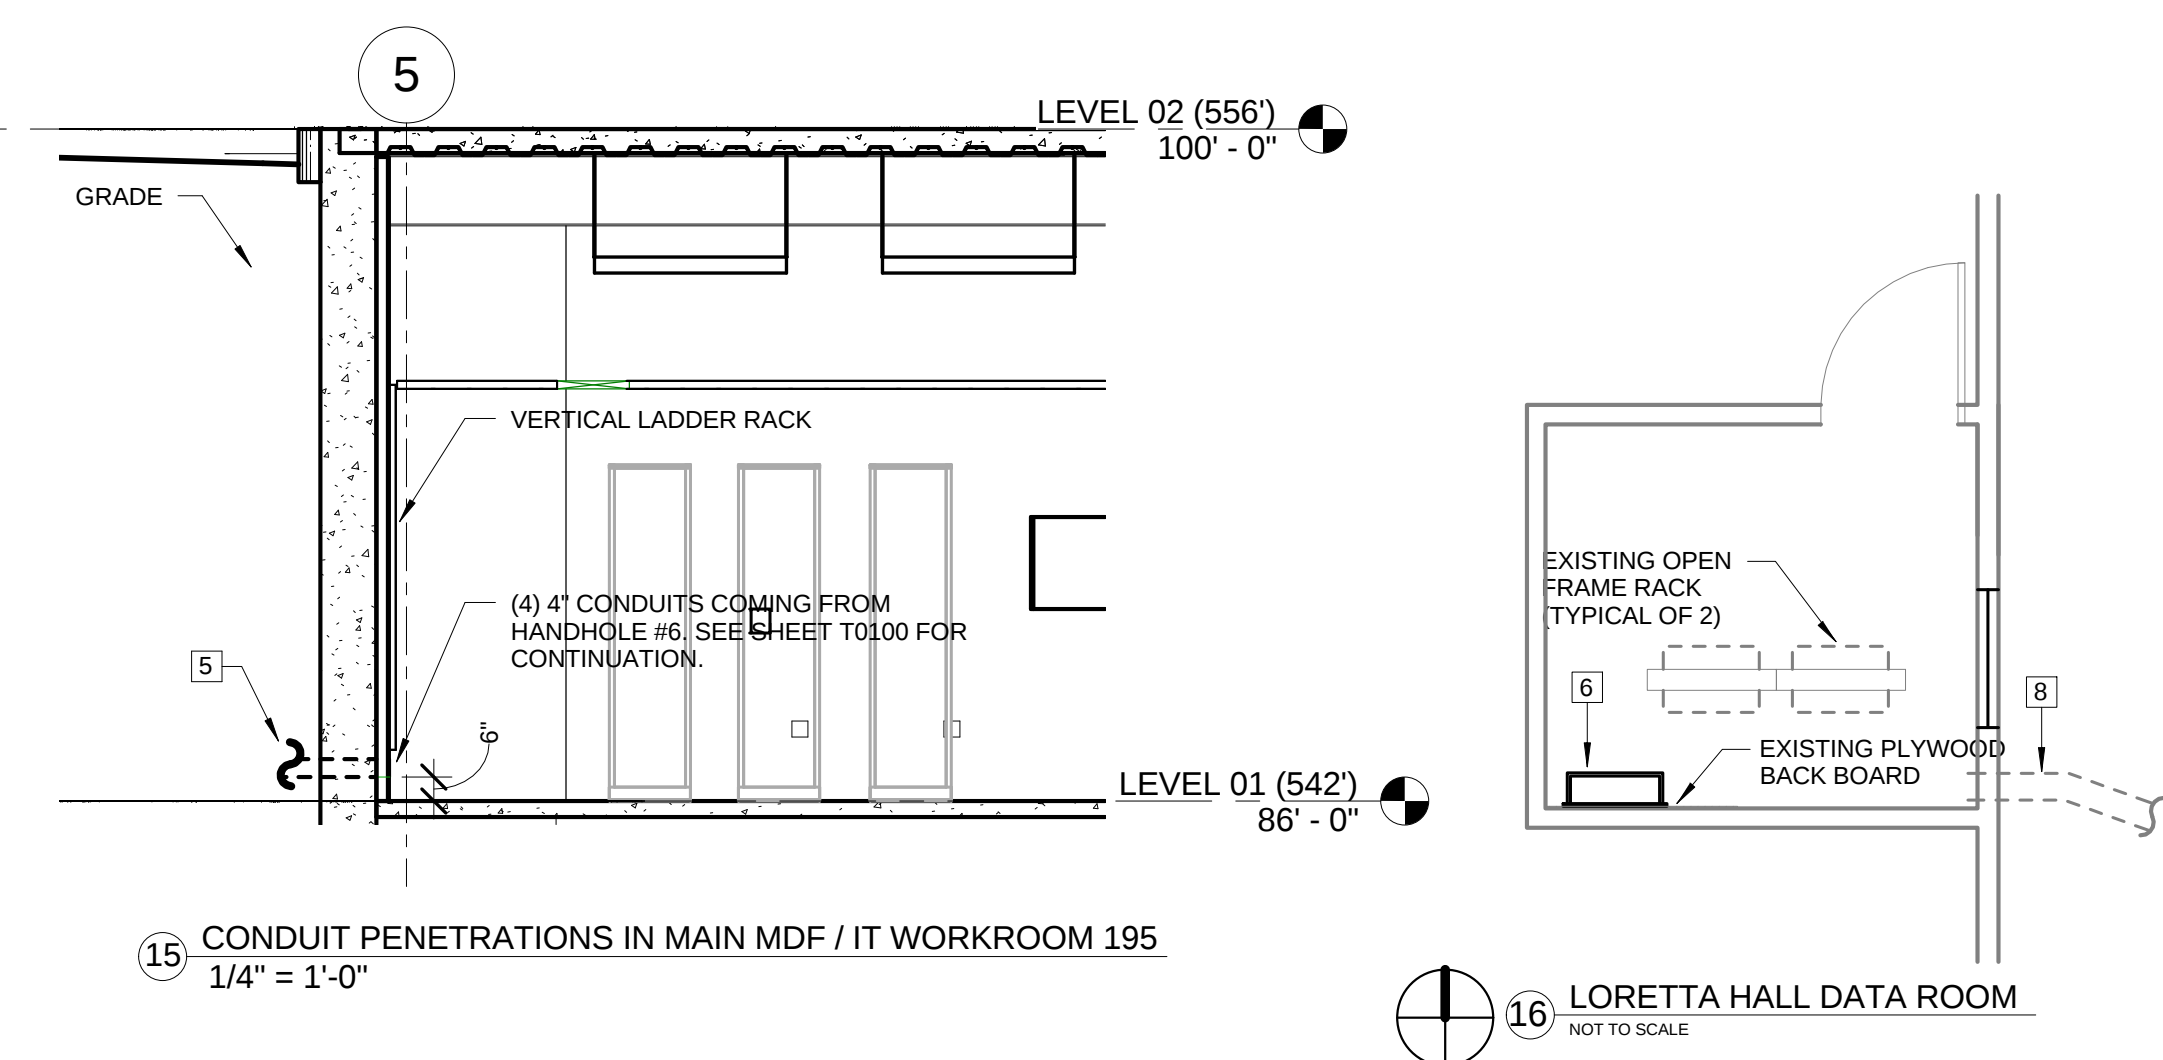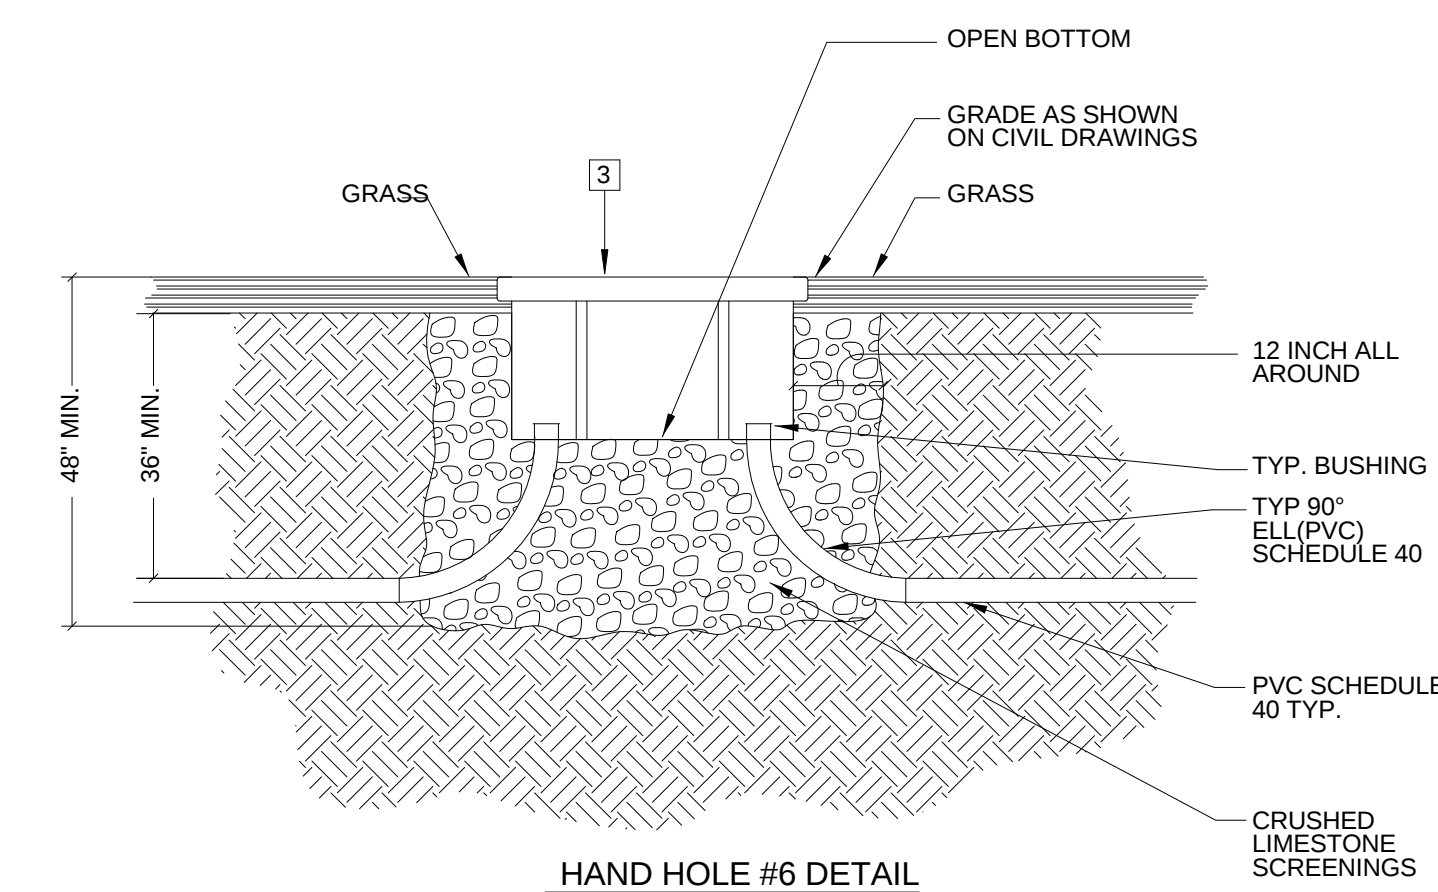

Webster University
Interdisciplinary Science Building

CANNONDESIGN

1100 Clark Avenue
St. Louis, Missouri 63102
T: 314.241.6250
F: 314.241.2570

William Tao & Associates, Inc.
ME/PE/FP Engineer
7955 Manchester Road, Suite 125
St. Louis, MO 63143
314-884-7600

David Mason & Associates, Inc.
Structural & Civil Engineer
800 South Vandeventer Avenue
St. Louis, MO 63110
314.534.1053

Faith Group
Technology
3101 S. Hanley Rd., Suite 100
St. Louis, MO 63143
314.991.2229

Kuhmann Leavitt, Inc.
Environmental Graphics & Signage
7400 Pershing Ave.
St. Louis, MO 63130
314.725.6616

KWA Architects
Architecture
9721 Litzinger Road
St. Louis, MO 63124
314.962.2560


Spellman Brady & Company
Interior Designer
8251 Maryland Avenue, Suite 300
St. Louis, MO 63105
314.862.0070

SWT Design
Landscape Architect
7722 Big Bend Blvd
St. Louis, MO 63119
314.644.5700

Webb Engineering Services, Inc.
Planning & Fire Protection
1400 S. 3rd Street, Suite 201
St. Louis, MO 63104
314.588.0600

CONFORMED SET 01 JUL 2016

2 ADDENDUM 2-2 19 APR 2016
1 ADDENDUM 2-1 17 MAR 2016
- ISSUED FOR CONSTRUCTION (BP2) 01 MAR 2016

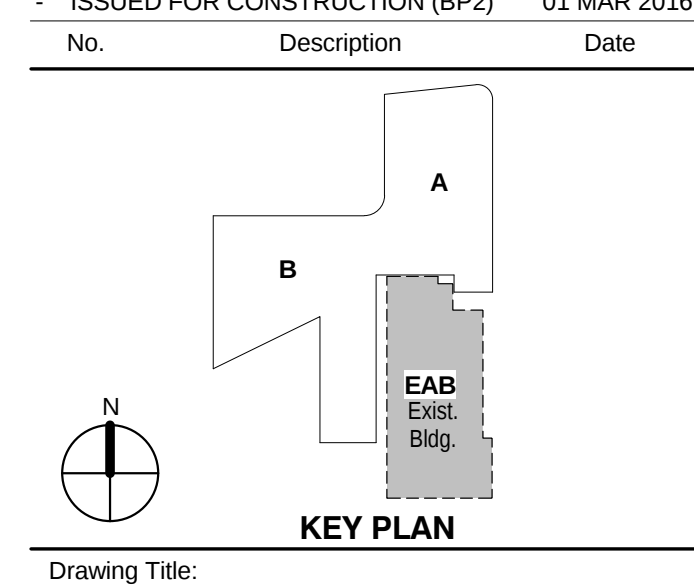

ENLARGED TECHNOLOGY FLOOR PLANS & RACK ELEVATIONS

Project No.: 04561.01 Checked by:

T0201

© Cannon Design 2015