



1501 N. 31st Avenue
Melrose Park, IL 60160-2911
800-621-4140 or 708-865-2403
FAX: 708-865-2640
www.heckmannanchors.com
Email: info@heckmannanchors.com


ARCHITECTURAL SPECIFICATION INFORMATION

THE ORIGINAL **Pos-I-Tie®** BRICK VENEER ANCHORING SYSTEM

1. Provides positive connections. The Barrel Section actually penetrates sheathing and makes a Positive Lateral Connection with the backup for transfer of compression and tension loads to structural backup.
2. EPDM washer completely seals the hole blocking ALL air and moisture penetration.
3. Offers speedy cost-saving installation. The screw is built-in to the barrel. No inferior screws can be substituted. Only one barrel needs to be installed, unlike other systems which require two screws for installation.
4. Slotted Barrel allows for differential movement due to temperature variations. Tie design provides for allowable ACI 530 code vertical adjustment of 1-1/4" above & below the barrel.
5. Allows for use of 4' x 8' insulation sheets. The Pos-I-Tie® holds the insulation in place!
6. Pos-I-Tie® Barrel section is made of highly corrosion resistant Zamac 3, a 92% zinc alloy.
7. Pos-I-Tie® system fully complies with the ACI 530 Code. The barrel and screw install as one unit. No more plates, screws and gaskets. Installs in seconds.
8. The Pos-I-Tie® conforms with the Energy Conservation Requirements of the Massachusetts State Building Code (780 CMR 13 Envelope).


**Pos-I-Tie® Products are ONLY
Available Through
Heckmann Building Products!**

Steel Stud Backup Wall Application

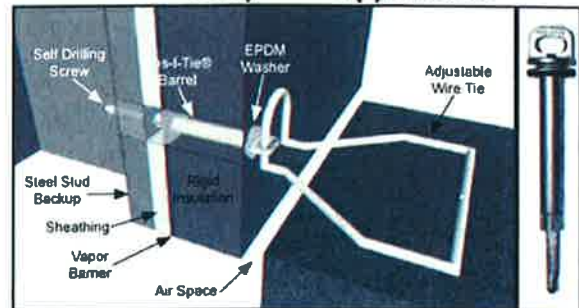


- Drills directly through insulation, vapor barrier and dens glass to the steel stud backup.
- EPDM washer completely seals the hole blocking ALL air and moisture penetration.

Concrete/CMU Backup Wall Application

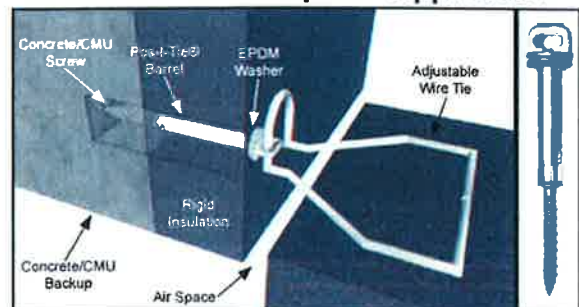

- This application can be used with Concrete, CMU, ICF, Wood, and Brick backup walls.
- Pre-drill pilot hole using the Con-Drive® Adapter and drill bit as explained on the reverse side of information sheet.

Structural Steel Backup Wall Application

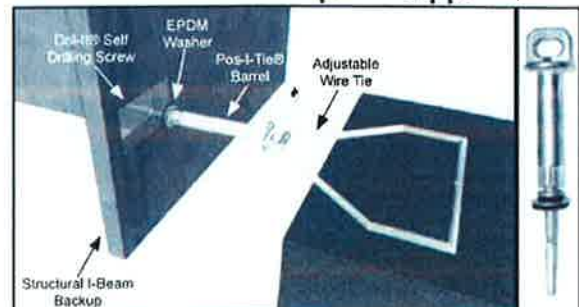

- Use the Drill-It® Self Drilling Screw for Structural Steel I-Beams. No pre-drilling required for up to 1/2" thick steel. Steel thicker than 1/2" may require a pre-drilled pilot hole.



1501 N. 31st Avenue
Melrose Park, IL 60160-2911
800-621-4140 or 708-865-2403
FAX: 708-865-2640
www.heckmannanchors.com
Email: info@heckmannanchors.com

should be 1/4" per 042000

WIRE TIES



Triangular Wire Tie



Seismic Wire Tie



Single Wire Tie

- Ties are 3/16" diameter x 3", 3 1/2", 4" or 5" Long in Hot Dip Galvanized, Mill Galvanized and Stainless Steel. Special Lengths available.

3/16" Diameter
is acceptable

0 Code allows for the use of single pintle ties.

- Due to the limitations on adjustable anchor tolerances in the ACI-530 Masonry Code, 1/4" diameter wire ties are not available for the Pos-I-Tie® system.

BARRELS

Nine Barrel lengths available for insulation/gypsum board sizes and combinations:

1/2", 5/8", 1", 1-1/2", 2", 2-1/2", 3", 3-1/2", 4", and 4-1/2"



WA-B2 will require 2-1/2" barrel
WA-B1 will require 3" barrel

SCREWS

Three screw types available for backup walls of steel stud, concrete, CMU, ICF, wood, brick and structural steel. Screws and Barrels are factory-assembled.

EASY INSTALLATION

Use a drill with a depth sensitive nose piece or a variable clutch adjustment. The barrel end of the Pos-I-Tie® is placed into the reusable chuck adapter.

For steel studs, drill the Pos-I-Tie® through the exterior insulation and into the metal stud. Use a drill with 1500 - 2000 RPM.

For structural steel, center punch prior to drilling. (High tensile steel or very thick steel may require pre-drilling a 3/16" (4.76 mm) hole.)

For concrete, CMU or brick, use the Con-Drive® Adapter with drill bit. Pre-drill a 3/16" (4.76 mm) hole to a depth of 2" (51 mm). Slide the Con-Drive® Sleeve over the drill bit and insert the CMU/Concrete Screw into the chuck adapter. Torque screw into the pre-drilled hole. The reusable chuck adapter and sleeve tool are available from Heckmann.



Chuck Adapter



Sleeve Tool



16 Gage welded **Seismic Hook Tab** available for Single and Triangle Pos-I-Tie® Wires for areas in Seismic Zones.



Stainless Steel Pos-I-Tie® Stone Anchors: Available 3/16" or 1/8" thick. Specify length, width, and bend type (Split-bend shown above, straight bend, or pin type available).

All stone anchors should be engineered by a licensed structural engineer on a job-by-job basis.

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

PROJECT NAME	
ADDRESS	
NUMBER	
OWNER	
ARCHITECT / ENGINEER	
SUBMITTED BY	
CONTRACTOR / CM SUBMITTAL NO.	CANNON DESIGN SUBMITTAL NO.
DRAWING / DETAIL REFERENCE	SPECIFICATION SECTION / PARAGRAPH
MANUFACTURER / SUPPLIER	ITEM / PRODUCT ID
REQUIRED DATE	PRIORITY
☐ CRITICAL	

To be completed by Reviewer

CANNON DESIGN SUBMITTAL NUMBER
RECEIVED DATE

- ☐ **A. No Exceptions Taken**
No further review of submittal is required.
- ☐ **B. Make Corrections Noted**
Incorporate corrections in work;
resubmission is not required.
- ☐ **C. Revise and Resubmit**
Revise as noted, and resubmit for review.
- ☐ **D. Rejected**
Submittal is not in compliance with Contract Documents;
provide new submittal.
- ☐ **E. For Record / Information Only**
Submittal was reviewed for Record / Information
purposes only.
- ☐ **F. Not Required for Review**
Submittal is not required by Contract Documents
and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

ITEM BEING SUBMITTED (check only one)

- ☐ Shop Drawings
☐ Samples
 (_____ copies)
☐ LEED Submittal
☐ Other
- ☐ Certification /
 Qualifications
☐ Record Documents
☐ Product Data
- ☐ Coordination Drawing
☐ Calculations
☐ Schedules
☐ O&M Manuals

ITEM BEING SUBMITTED FOR (check only one)

- ☐ Action ☐ Information Only ☐ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION
(SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)

PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

Ry:

By:
Devin D. Gates

REVIEWED BY	DATE

A/E COMMENTS

- ☐
- See attached sheet(s) for additional comments

REVIEWED BY	DATE



77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0127

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 07/08/2016

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

RE: Clay Face Brick Product Data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:		SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings		☒ Approval	☐ Approved as Submitted
☐ Letter		☐ Your Use	☐ Approved as Noted
☐ Prints		☐ As Requested	☐ Returned After Loan
☐ Change Order		☐ Review and Comment	☐ Resubmit
☐ Plans			☐ Submit
☐ Samples		SENT VIA:	☐ Returned
☐ Specifications		☐ Attached	☐ Returned for Corrections
☒ Other: Product Data		☐ Separate Cover Via:	☐ Due Date:

Item	Package	Code	Rev.	Copies	Date	Description	Status
Submittal		042000-015	1		07/08/2016	Clay Face Brick Product Data	Submitted

NOTES:

CC:

Signed: _____
Devin Gates

TRANSMITTAL LETTER



Leonard Masonry, Inc.

5925 Fee Fee Road
St. Louis, MO 63042

Transmittal # **945-02**

Date: 7/7/2016
Phone: (314) 731-5500
Fax: (314) 731-3366

Project Name: Webster University Interdisciplinary Science Building

Project #: 945

To: Paric Corporation
Attn: Devin Gates
77 Westport Plaza Drive
Suite 250
St. Louis, MO 63146

Items listed are being sent

- ☒ Enclosed
☐ Under Separate Cover
☐ Via

SUBJECT: Submittal 945-02, Rev #0 Masonry materials

Phone: (636) 561-9500 **Fax:** (636) 561-9501

We are transmitting the following to you:

- ☒ Product Data
☐ Architectural Drawings
☐ Engineering Drawings
☐ Samples
☐ Letters
☐ Change Order Requests

- ☒ Submittals: Submittal 945-02, Rev #0 Masonry materials
☐ Shop Drawings
☐ Specifications
☐ O & M Manuals
☐ Prints
☐ Plans
☐ Addenda
☐

Submittal: Masonry materials - Rev#0


Code/Spec	Copies	For	Product #	Summary Item
042000-2.3	1	Approval		Face brick test report
042000-2.4	1	Approval		Type N mortar certification
042000-2.4	1	Approval		Type S mortar certification
042000-2.4E	1	Approval		Mortar color product data
042000-2.6C	1	Approval		Veneer anchor product data
042000-2.7	1	Approval		Flashing product data
042000-2.8A	1	Approval		Compressible filler product data
042000-2.8B	1	Approval		Bond-breaker product data
042000-2.8C	1	Approval		Weep vent product data
042000-2.8D	1	Approval		Cavity drainage material product data
042000-2.8	1	Approval		Termination bar product data
042000-2.9A	1	Approval		Cavity wall insulation product data
042000-2.9B	1	Approval		Insulation adhesive product data
042000-3.12E.5	1	Approval		Masonry cleaner product data

Remarks:

Specified veneer tie is not available with 1/4" diameter ties per manufacturers data sheet.

Potable water is to be supplied by owner/GC. No submittal provided.

TRANSMITTAL LETTER



Leonard Masonry, Inc.

5925 Fee Fee Road
St. Louis, MO 63042

Transmittal # **945-02**

Date: 7/7/2016
Phone: (314) 731-5500
Fax: (314) 731-3366

Project Name: Webster University Interdisciplinary Science Building

Project #: 945

To: Paric Corporation
Attn: Devin Gates
77 Westport Plaza Drive
Suite 250
St. Louis, MO 63146

Items listed are being sent

- ☒ Enclosed
- ☐ Under Separate Cover
- ☐ Via

SUBJECT: Submittal 945-02, Rev #0 Masonry materials

Phone: (636) 561-9500 **Fax:** (636) 561-9501

We are transmitting the following to you:

- ☒ Product Data
- ☐ Architectural Drawings
- ☐ Engineering Drawings
- ☐ Samples
- ☐ Letters
- ☐ Change Order Requests

☒ Submittals: Submittal 945-02, Rev #0 Masonry materials

- ☐ Shop Drawings
- ☐ Specifications
- ☐ O & M Manuals
- ☐ Prints
- ☐ Plans
- ☐ Addenda

COPIES TO:

By: Ken Westhoff
Project Manager

Received by: _____ Date: _____