



CABINETS ALTA VALVE CABINETS

Model/Series No.

**8000
SERIES**

SPECIFICATIONS

BOX

Cold rolled steel with an electrostatically applied, thermally-fused polyester coating with recoatable white finish, and a continuous hinge.

DOOR AND FRAME

Model 8020-8029: **Steel** - Cold rolled steel with recoatable white polyester finish

Model 8040-8049: **Aluminum** - Clear anodized finish

Model 8060-8069: **Stainless Steel** - #304 Stainless steel with #4 finish

Model 8060-8089: **Brass** - Polished finish, clear polyester coated



MODEL 8020 (Shown)

MODEL SELECTION

STEEL

- ☐ 8020 Recessed
- ☐ 8021 Trimless
- ☐ 8022 Semi-Recessed
- ☐ 8024 Surface
- ☐ 8025 Recessed
- ☐ 8026 Trimless
- ☐ 8027 Semi-Recessed
- ☐ 8029 Surface

ALUMINUM

- ☐ 8040 Recessed
- ☐ 8041 Trimless
- ☐ 8042 Semi-Recessed
- ☐ 8044 Surface
- ☐ 8045 Recessed
- ☐ 8046 Trimless
- ☐ 8047 Semi-Recessed
- ☐ 8049 Surface

MODEL SELECTION (cont.)

STAINLESS STEEL

- ☐ 8060 Recessed
- ☐ 8061 Trimless
- ☐ 8062 Semi-Recessed
- ☐ 8064 Surface
- ☐ 8065 Recessed
- ☐ 8066 Trimless
- ☐ 8067 Semi-Recessed
- ☐ 8069 Surface

BRASS

- ☐ 8080 Recessed
- ☐ 8081 Trimless
- ☐ 8082 Semi-Recessed
- ☐ 8084 Surface
- ☐ 8085 Recessed
- ☐ 8086 Trimless
- ☐ 8087 Semi-Recessed
- ☐ 8089 Surface

Call Potter Roemer - Fire Pro for current listings and approvals. Dimensions are subject to manufacturer's tolerance and may change without notice. Potter Roemer - Fire Pro assumes no responsibility for use of void or superseded data. © Copyright Potter Roemer - Fire Pro, Member of Morris Group International™ Please visit potterroemer.com for most current specifications.

8000 SERIES

Date: 11/04/14

MEMBERSHIP

 FIRE EQUIPMENT
MANUFACTURERS'
ASSOCIATION

ONFSA
NATIONAL FIRE SPRINKLER ASSOCIATION, INC.


POTTER ROEMER/FIRE PRO

Headquarters:
P.O. Box 3527
City of Industry, CA
91744 U.S.A.
Los Angeles Area
800-366-3473
626-855-4890

Also in:
New York (800) 526-4592
Chicago (800) 547-3473
Atlanta (800) 762-0542
Miami (866) 961-3473
Dallas (866) 644-3473

www.potterroemer.com

PRODUCT OPTIONS

DOOR STYLES:

- ☐ -A Full Glass, w/ Tempered Safety Glass
- ☐ -B Break-Glass, w/lock & Break Rite® Handle
- ☐ -D Duo-Panel w/ Tempered Safety Glass
- ☐ -DV Duo-Vertical Panel w/ Tempered Safety Glass
- ☐ -DVL Duo-Vertical Panel w/ Lock, TSG & Break Rite® Handle.
- ☐ -E Tempered Safety Glass (25 sq. in.) w/ Break Rite® Handle
- ☒ -F Solid Flush Metal
- ☐ -FS Solid Flush Metal w/ lock

**NOTE: ALL GLASS DOOR STYLES PROVIDED WITH CLEAR TEMPERED SAFETY GLASS IN COMPLIANCE WITH ANSI Z97-1-1984

GLAZING MATERIAL:

- ☐ -1 TS Bronze Tempered Safety Glass
- ☐ -2 TS Smoke Tempered Safety Glass
- ☐ -4 TS Obscure Tempered Safety Glass
- ☒ -6 1/8" Clear Acrylic
- ☐ -7 1/8" Bronze Acrylic
- ☐ -8 1/8" White Acrylic
- ☐ -9 1/8" Smoke Acrylic
- ☐ -10 1/8" Red Acrylic

DOOR AND FRAME FINISHES:

- ☐ -STEEL: Any polyester paint color, if available; Provide mfg. name and color number
- ☐ -ALUMINUM: Light, Medium or Dark duranodic
- ☐ -STAINLESS STEEL: Number 304 Stainless, with #8 mirror finish
- ☐ -BRONZE: U.S. # 10 Satin finish with clear coating, or dark oxidized, oil rubbed; specify
- ☐ -RED: For Red Polyester Finish, Add This Suffix
- ☐ -RR: For Rolled Radius Return, Add This Suffix
- ☐ CUSTOM _____

PRODUCT OPTIONS (cont.)

FIRE EXTINGUISHER LETTERING:

- ☐ -HW Horizontal White
- ☐ -HB Horizontal Black
- ☐ -HR Horizontal Red
- ☐ -VW Vertical White
- ☐ -VB Vertical Black
- ☐ -VR Vertical Red
- ☐ -VAW Vertical Ascending White
- ☐ -VAB Vertical Ascending Black
- ☐ -VAR Vertical Ascending Red

FIRE DEPT. VALVE LETTERING:

- ☐ -WH White
- ☒ -BH Black
- ☐ -RH Red

Door style
to be solid

Lettering
to be
black

Color to match
Sherwin Williams
SW7004 Snowbound

Call Potter Roemer - Fire Pro for current listings and approvals. Dimensions are subject to manufacturer's tolerance and may change without notice. Potter Roemer - Fire Pro assumes no responsibility for use of void or superseded data. © Copyright Potter Roemer - Fire Pro, Member of Morris Group International™ Please visit potterroemer.com for most current specifications.

8000 SERIES

Date: 11/04/14

MEMBERSHIP



FIRE EQUIPMENT
MANUFACTURERS'
ASSOCIATION



ONFSA
NATIONAL FIRE SPRINKLER ASSOCIATION, INC.



POTTER ROEMER/FIRE PRO

Headquarters:
P.O. Box 3527
City of Industry, CA
91744 U.S.A.
Los Angeles Area
800-366-3473
626-855-4890


Also in:
New York (800) 526-4592
Chicago (800) 547-3473
Atlanta (800) 762-0542
Miami (866) 961-3473
Dallas (866) 644-3473

www.potterroemer.com

MODEL DIMENSIONS

Model No.		Wall Mounting	Inside Box Dimensions			Overall Frame		Wall Opening Required			Trim	Inlet Location			Shelf	For Use With	ADA
Steel / Stainless Steel	Aluminum / Brass		K	L	M	N	O	W I D T H	H E I G H T	D E P T H		T	X	Y			
8020	8060	Recessed	18	18	8	21-3/4	21-3/4	19	19	8-1/2	-	4	4	9	-		Yes
8021	8061	Trimless	18	18	8-3/4	21	21	19	19	9-1/4	-	4	4	9	-	2-1/2" Angle Valves	Yes
8022	8062	Semi-Recessed	18	18	8	21-1/2	21-1/2	19	19	6-1/2	2	4	4	9	-		Yes
8024	8064	Surface	20	20	9-1/4	-	-	-	-	-	-	-	-	-	-		No
8025	8065	Recessed	14	40	8	17-3/4	43-3/4	15	41	8-1/2	-	4	4	9	12	Up to 20lb. Dry Chem Fire Ext. & 2-1/2" Angle Valves	Yes
8026	8066	Trimless	14	40	8-3/4	17	43	15	41	9-1/4	-	4	4	9	12		Yes
8027	8067	Semi-Recessed	14	40	8	17-1/2	43-1/2	15	41	6-1/2	2	4	4	9	12		Yes
8029	8069	Surface	16	42	9-1/4	-	-	-	-	-	-	-	-	-	12		No
8040	8080	Recessed	18	18	8	21-3/4	21-3/4	19	19	8-1/2	-	4	4	9	-	2-1/2" Angle Valves	Yes
8041	8081	Trimless	18	18	8-3/4	21	21	19	19	9-1/4	-	4	4	9	-		Yes
8042	8082	Semi-Recessed	18	18	8	21-1/2	21-1/2	19	19	6-1/2	2	4	4	9	-		Yes
8044	8084	Surface	20	20	9-1/4	-	-	-	-	-	-	-	-	-	-		No
8045	8085	Recessed	14	40	8	17-3/4	43-3/4	15	41	8-1/2	-	4	4	9	12	Up to 20lb. Dry Chem Fire Ext. & 2-1/2" Angle Valves	Yes
8046	8086	Trimless	14	40	8-3/4	17	43	15	41	9-1/4	-	4	4	9	12		Yes
8047	8087	Semi-Recessed	14	40	8	17-1/2	43-1/2	15	41	6-1/2	2	4	4	9	12		Yes
8049	8089	Surface	16	42	9-1/4	-	-	-	-	-	-	-	-	-	12		No

ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED

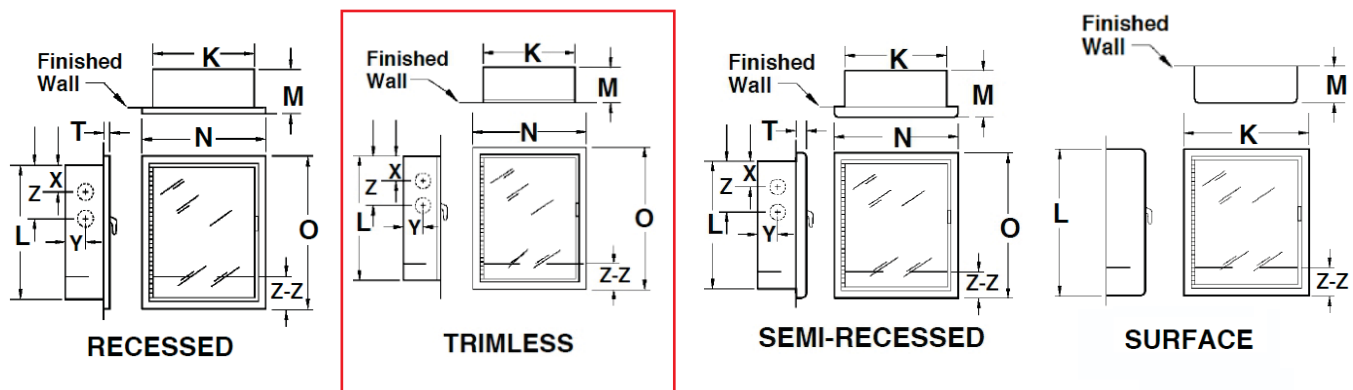

Call Potter Roemer - Fire Pro for current listings and approvals. Dimensions are subject to manufacturer's tolerance and may change without notice. Potter Roemer - Fire Pro assumes no responsibility for use of void or superseded data. © Copyright Potter Roemer - Fire Pro, Member of Morris Group International™ Please visit potterroemer.com for most current specifications.

8000 SERIES

Date: 11/04/14

MEMBERSHIP



FIRE EQUIPMENT
MANUFACTURERS'
ASSOCIATION



ONFSA
NATIONAL FIRE SPRINKLER ASSOCIATION, INC.



POTTER ROEMER/FIRE PRO

Headquarters:
P.O. Box 3527
City of Industry, CA
91744 U.S.A.
Los Angeles Area
800-366-3473
626-855-4890

Also in:
New York (800) 526-4592
Chicago (800) 547-3473
Atlanta (800) 762-0542
Miami (866) 961-3473
Dallas (866) 644-3473

www.potterroemer.com

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

WEBSTER UNIVERSITY ISB	
PROJECT NAME	
8274 BIG BEND BLVD	
ADDRESS	
NUMBER	
WEBSTER UNIVERSITY	
OWNER	
CANNON DESIGN	
ARCHITECT / ENGINEER	
Joe Voypick	
SUBMITTED BY	
104413-004	
CONTRACTOR / CM SUBMITTAL NO.	CANNON DESIGN SUBMITTAL NO.
	104413
DRAWING / DETAIL REFERENCE	SPECIFICATION SECTION / PARAGRAPH
Self Perform	
MANUFACTURER / SUPPLIER	ITEM / PRODUCT ID
REQUIRED DATE	PRIORITY
	CRITICAL

ITEM BEING SUBMITTED (check only one)

- | | | |
|---|--|--|
| ☐ Shop Drawings | ☐ Certification / Qualifications | ☐ Coordination Drawing |
| ☐ Samples (____ copies) | ☐ Record Documents | ☐ Calculations |
| ☐ LEED Submittal | ☒ Product Data | ☐ Schedules |
| ☐ Other _____ | | ☐ O&M Manuals |

ITEM BEING SUBMITTED FOR (check only one)

- ☒ Action ☐ Information Only ☐ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION (SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)

 PARIC CORPORATION SUBMITTAL STAMP THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents. By: Devin D. Gates
--

Joe Voypick	2/2/17
REVIEWED BY	DATE

To be completed by Reviewer

10 4413-004
CANNON DESIGN SUBMITTAL NUMBER
2/2/17
RECEIVED DATE

- ☐ A. No Exceptions Taken
No further review of submittal is required.
- ☒ B. Make Corrections Noted
Incorporate corrections in work; resubmission is not required.
- ☐ C. Revise and Resubmit
Revise as noted, and resubmit for review.
- ☐ D. Rejected
Submittal is not in compliance with Contract Documents; provide new submittal.
- ☐ E. For Record / Information Only
Submittal was reviewed for Record / Information purposes only.
- ☐ F. Not Required for Review
Submittal is not required by Contract Documents and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

A/E COMMENTS ☐ See attached sheet(s) for additional comments

GC TO COORDINATE WITH WOOD PANEL CONTRACTOR.
DESIGN INTENT IS TO EITHER REPLACE THE DOOR WITH WOOD PANEL TO MATCH ADJACENT WOOD PANELS OR ATTACH MATCHING WOOD PANEL ON THE CABINET DOOR. HARDWARE WILL NEED TO BE REATTACHED TO MAINTAIN FUNCTIONALITY. PICK A OPTION WHICH IS ACCEPTABLE TO FIRE DEPARTMENT. FIRE DEPARTMENT APPROVAL REQUIRED.
FINISHED DOOR SURFACE (WOOD PANEL) TO BE FLUSH WITH ADJACENT WOOD PANELS.
FIRE DEPARTMENT VALVE - LETTERING WILL REQUIRED ON THE FINISHED DOOR SURFACE.

Kelvin Patel	2/23/17
REVIEWED BY	DATE

Digitally signed by Kelvin Patel
DN: C=US, E=kpatel@cannondesign.com, O=Cannon Design,
OU=Architect, CN=Kelvin Patel
Date: 2017.02.23 17:14:02 -06'00'



77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0472

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 02/02/2017

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

Fax;
314-241-2203

RE: Hose Valve Cabinets Product Data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:	SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings	☒ Approval	☐ Approved as Submitted
☐ Letter	☐ Your Use	☐ Approved as Noted
☐ Prints	☐ As Requested	☐ Returned After Loan
☐ Change Order	☐ Review and Comment	☐ Resubmit
☐ Plans		☐ Submit
☐ Samples	SENT VIA:	☐ Returned
☐ Specifications	☐ Attached	☐ Returned for Corrections
☒ Other: Prodcut Data	☐ Separate Cover Via:	☐ Due Date:

<i>Item</i>	<i>Package</i>	<i>Code</i>	<i>Rev.</i>	<i>Copies</i>	<i>Date</i>	<i>Description</i>	<i>Status</i>
Submittal		104413-004	1		02/02/2017	Hose Valve Cabinets Product Data	Submitted

NOTES:

CC:

Signed: _____
Devin Gates