55L-60 — MODEL —

Pressure Relief Valve/ Pump Casing Relief Valve

Available in a wide range of materials including nickel aluminum bronze and stainless steel. Certified to meet low lead requirements

- **UL Listed**
- **Factory Mutual Approved**
- **UL Listed/FM Approved for use as a fire pump casing relief valve**
- **Direct Acting - Precise Pressure Control**
- **Positive Dependable Opening**
- **Drip Tight Closure**
- **No Packing Glands or Stuffing Boxes**
- **Sensitive to Small Pressure Variations**

The Cla-Val Model 55L-60 **(UL Listed, FM approved)** Pressure Relief Valve is a direct-acting, spring loaded, diaphragm type relief valve. The valve may be installed in any position and will open and close within very close pressure limits. The bottom plug may be removed and installed in the inlet to convert it to an angle pattern flow path.

The Model 55L-60 is normally held closed by the force of the compression spring above the diaphragm. When the controlling pressure applied under the diaphragm exceeds the spring setting, the disc is lifted off its seat, permitting flow through the control. When control pressure drops below the spring setting, the spring forces the control back to its normally closed position. The controlling pressure is applied to the chamber beneath the diaphragm through an internal passage. Gauge Port is provided for accurate pressure setting.

Pressure adjustment is done by turning the adjusting screw to vary the spring load on the diaphragm. The 55L-60 is available in pressure ranges suited to agency approval tests. To prevent tampering, the adjustment cap can be wire sealed by using the lock wire holes provided in the cap and cover.

UL LISTED

FM APPROVED

Fire Protection System Service
The **Model 55L-60** is typically used in a fire protection system to trim water pressure, thus preventing pressure build-up whenever line pressure exceeds the setting of the spring.

The 55L-60 will relieve excess pressure to atmosphere to prevent damage to the distribution network.

NOTE: Model 55L-60 is not suitable for discharging the full-rated pump capacity of a fire pump. See Model 50B-4KG1 Fire Pump Relief Valve for such applications.

Typical Application for Fresh Water or Seawater Service

Fire Pump Casing Relief Valve

Specifications

Size	3/4" Threaded NPT
Temperature Range	Water, Air: to 180°F Max.
Materials	
Body & Cover:	Cast Bronze UNS C87850 Stainless Steel ASTM A743-CF-16Fa
Trim:	303 Stainless Steel
Rubber:	Buna-N® Synthetic Rubber
Pressure Ratings	Cast Bronze 400 psi Max. Stainless Steel 400 psi Max.
Other Materials	Available on special order
Adjustment Ranges	
UL Listed & FM Approved	0 to 75 psi 20 to 200 psi 100 to 300 psi
UL Listed	20 to 175 psi

UL Listed/FM Approved 55L-60 Range psi	Approximate Increase for Each Clockwise Turn of Adjusting Screw
0 to 75	8.5 psi
20 to 200	28.0 psi
100 to 300	18.0 psi

Pressure Drop Chart (Full Open Valve)

Valve Size	C_V Factor	Flow of Water - Gallons Per Minute				
		5	10	16	20	30
1/2"	6	0.7	2.7	6	11	--
3/4"	8.5	0.3	1.4	3.1	5.5	12.2

When Ordering, Please Specify

1. Catalog No. 55L-60
2. Valve Size
3. Adjustment Range Desired
4. Optional Materials

Dimensions: 0 to 75 and 20 to 200 psi design

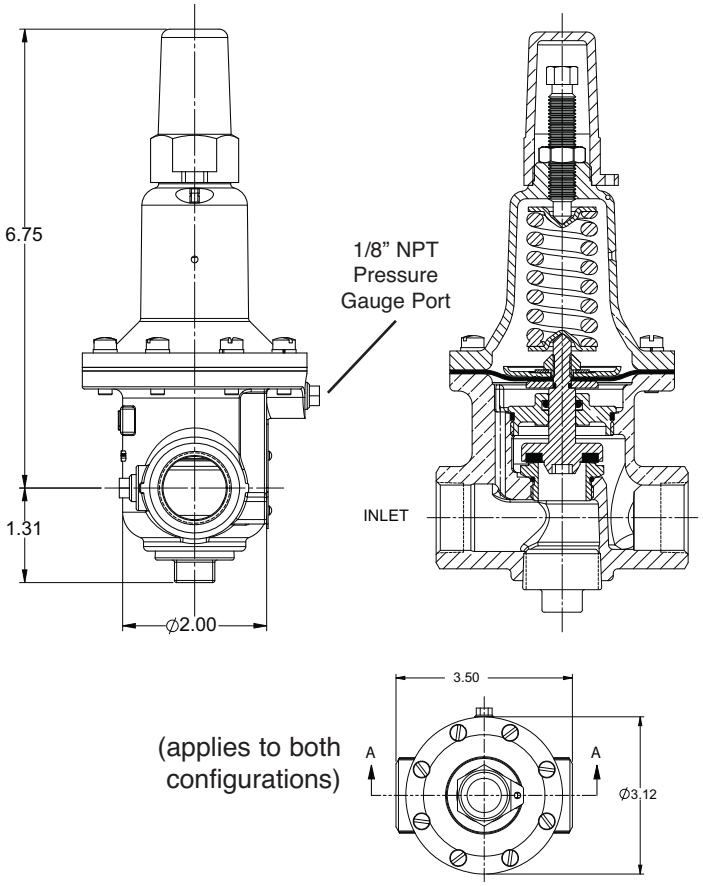

(applies to both configurations)

Dimensions: 100 - 300 psi design

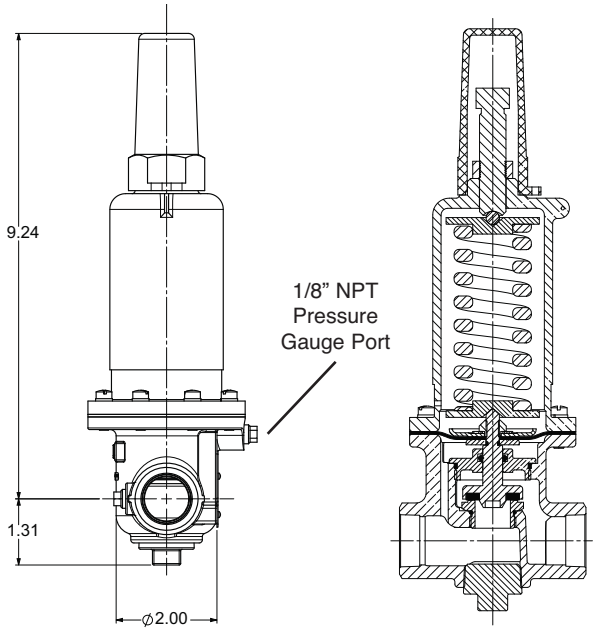

CLA-VAL

PO Box 1325 Newport Beach CA 92659-0325

800-942-6326 • Fax: 949-548-5441 • Web Site: cla-val.com • E-mail: claval@cla-val.com

CLA-VAL CANADA
4687 Christie Drive
Beamsville, Ontario
Canada L0R 1B4
Phone: 905-563-4963
Fax: 905-563-4040
E-mail sales@cla-val.ca

CLA-VAL EUROPE
Chemin des Mésanges 1
CH-1032 Romanel/
Lausanne, Switzerland
Phone: 41-21-643-15-55
Fax: 41-21-643-15-50
E-mail: cla-val@cla-val.ch

CLA-VAL UK
Dainton House, Goods Station Road
Tunbridge Wells
Kent TN1 2 DH England
Phone: 44-1892-514-400
Fax: 44-1892-543-423
E-mail: info@cla-val.co.uk

CLA-VAL FRANCE
Porte du Grand Lyon 1
ZAC du Champ du Périer
France - 01700 Neyron
Phone: 33-4-72-25-92-93
Fax: 33-4-72-25-04-17
E-mail: cla-val@cla-val.fr

CLA-VAL PACIFIC
45 Kennaway Road
Woolston, Christchurch, 8023
New Zealand
Phone: 64-39644860
Fax: 64-39644786
E-mail: gnuthall@cla-val.com

E-55L-60 (R-05/2014)

COPYRIGHT CLA-VAL 2014 Printed in USA Specifications subject to change without notice.

WM TAO & ASSOCIATES
CONSULTING ENGINEERS

Shop Drawing Submittal Review

Transmitted To: Cannon Design

Date: December 15, 2016

Attention: **stl-cac@cannondesign.com**

Contact Person / WTA Field Inspector: Patrick Garner

Project Name: Webster University-**ISB**

Reviewed by: Mike Whitworth (WES)

Project No. WT 14127.01
WES 607

[ ] UPS [ ] Courier [X] **Email**

Copies	No.	Description
1 PDF	210523F01	(Submittal No.'s:)
		(Cannon #210523-002) - (Paric #15051-0353) – (WES #607)
		➢ **Valves for Fire Protection Piping Product Data**

*Remarks: See Submittal Review from Webb Enginnering.

c: **Kelvin Patel**
Kpatel@cannondesign.com

[X] ***Reviewed**

[X] ***No Exceptions Taken**

[ ]

[ ] *Make Corrections As Noted, No Resubmittal Required

Corrections or comments made on shop drawings during this review do not relieve contractor from compliance with requirements of drawings and specifications. This check is only for review of general conformance with the design concept of project and general compliance with information given in contract documents. Contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating his work with that of all other trades; and performing his work in a safe and satisfactory manner.

WEBB ENGINEERING SERVICES INC.

1400 S. 3rd Street, Suite 201
St. Louis, Missouri 63104
Phone: (314) 588-0600
Fax: (314) 588-0604

Letter of Transmittal

To: wtashop@wmtao.com

From: Mike Whitworth

Date: December 11, 2016

Re: Webster University ISB

WES No: 607

☐ For your Files ☐ For Review ☐ Please Comment ☐ Please Reply

Item No.	Description	No. of Copies	Date
1	Shop Drawing Review – (210523-002) 210523 General Duty Valves for Water-Based Fire-Suppression Piping	1	12/11/16

•Signature: Mike Whitworth

WEBB ENGINEERING SERVICES INC.
1400 S. 3rd Street, Suite 201 • St. Louis, Missouri 63104 • 314.588.0600 • *fax* 314.588.0604
www.webb-engineering.com

The review of this submittal is limited to the general conformance with the designated design concept and intent of this project and with the general compliance of the information provided in the contract documents. All comments, remarks and notations made on the submittal(s) as a result of this review do not relieve the contractor from full compliance with requirements of the contract documents. Approval for a specific item shall not include approval of an assembly of which the item is not a component. The contractor is solely responsible for rough-in and installation confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordination of this work with that of other trades on this project; and in a safe and satisfactory manner. All work shall be installed in full compliance with the manufacturer's recommendation, Federal, State and Local rules and regulation and the Authority Having Jurisdiction (AHJ) and applicable adopted codes and standards.

PROJECT NAME:	Webster University ISB
LOCATION:	St. Louis Missouri
CLIENT PROJ. NO.:	N/A
WES PROJ. NO.:	607
SPECIFICATION SECTION:	210523 General Duty Valves for Water Based Fire-Suppression Piping
SUBMITTAL ITEM:	See Below -

CONTRACTOR:	J.F. Ahern Co.
CTR. SUBMITTAL #:	21 0523-002
SUBMITTAL DATE:	November 29, 2016
DATE RECEIVED:	December 07, 2016
RECEIVED VIA:	E-Mail
RECEIVED FROM:	WTA
DATE RETURNED:	DECEMBER 11, 2016
RETURNED VIA:	E-MAIL
RETRURNED TO:	WTASHOP@WMTAO.COM

STATUS KEY:

NO EXCEPTION TAKEN
MAKE CORRECTIONS NOTED, NO RESUBMITTAL:
AMEND AND RESUBMIT
REJECTED, SEE REMARKS:
REVIEWED ONLY

NEC	MCN	AAR	REJ	REV	ITEM	REMARKS
X					Iron Body Gate Valves NIBCO Model - F-607-RW	
X					Butterfly Valves Victaulic Model - Fire Lock Style 705	
X					Swing Check Valve Viking Model - D-1 & G-1	
X					Bronze Gate Valves NIBCO Model - T-104-0	
X					Bronze Angle Valves NIBCO Model - T-301-W	
X					Bronze Globe Valves NIBCO Model – KT-65-UL	
X					Bronze Globe Valves NIBCO Model – KT-211-W-UL	

WEBB ENGINEERING SERVICES INC.
1400 S. 3rd Street, Suite 201 • St. Louis, Missouri 63104 • 314.588.0600 • *fax* 314.588.0604
www.webb-engineering.com

X					Bronze Side Outlet Globe Valves NIBCO Model – KT-291-W3	
X					Bronze Check Valves NIBCO Model – KT-403-W	
X					Bronze Ball Valves NIBCO Model – KT-585-70-UL and KT-580-70-UL	
X					Fire Lock Ball Valve Victaulic Model - Fire Lock Series 728	
X					Butterball Butterfly Valves Milwaukee Valve Model - Various	
X					Calibrated Pressure Relief Valves Watts Model – Series 530C	
X					Test and Drain Valve AGF Manufacturing Model – 1011A	
X					Double Check Valve Assembly Zurn Model - 350A	
X					Forged Brass Ball Valve KITZ Model - 58	
X					Pressure Relief Valve / Pump Casing Relief Valve CLA-VAL Model – 55L-60	
X					Air Release Valve Val-Matic Valve and Manufacturing Corp. Model – 22.9	

REVIEWED BY: Michael R. Whitworth DATE: December 11, 2016

THESE COMMENTS ARE TO BE ATTACHED TO ALL COPIES OF THE SHOP DRAWING REFERENCED ABOVE.

CANNONDESIGN

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

WEBSTER UNIVERSITY ISB
PROJECT NAME

8274 BIG BEND BLVD
ADDRESS

NUMBER

WEBSTER UNIVERSITY
OWNER

CANNON DESIGN
ARCHITECT / ENGINEER

Joe Voypick
SUBMITTED BY

210523-002
CONTRACTOR / CM SUBMITTAL NO.

CANNON DESIGN SUBMITTAL NO.

DRAWING / DETAIL REFERENCE

210523
SPECIFICATION SECTION / PARAGRAPH

Ahern Fire Protection
MANUFACTURER / SUPPLIER

ITEM / PRODUCT ID

REQUIRED DATE

PRIORITY

◯ CRITICAL

ITEM BEING SUBMITTED (check only one)

- ◯ Shop Drawings
- ◯ Samples (_____ copies)
- ◯ LEED Submittal
- ◯ Certification / Qualifications
- ◉ Record Documents
- ◯ Product Data
- ◯ Coordination Drawing
- ◯ Calculations
- ◯ Schedules
- ◯ O&M Manuals
- ◯ Other _____

ITEM BEING SUBMITTED FOR (check only one)

◉ Action ◯ Information Only ◯ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION
(SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)

PARIC

PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

By:
Devin D. Gates

Joe Voypick
REVIEWED BY

11/30/16
DATE

To be completed by Reviewer

21 0523-002
CANNON DESIGN SUBMITTAL NUMBER

11/30/16
RECEIVED DATE

- ◯ A. No Exceptions Taken
  No further review of submittal is required.
- ◯ B. Make Corrections Noted
  Incorporate corrections in work; resubmission is not required.
- ◯ C. Revise and Resubmit
  Revise as noted, and resubmit for review.
- ◯ D. Rejected
  Submittal is not in compliance with Contract Documents; provide new submittal.
- ◯ E. For Record / Information Only
  Submittal was reviewed for Record / Information purposes only.
- ◯ F. Not Required for Review
  Submittal is not required by Contract Documents and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

A/E COMMENTS ◯ See attached sheet(s) for additional comments

REVIEWED BY

DATE

77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0353

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 11/29/2016

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

Fax;
314-241-2203

RE: Valves for Fire Protection Piping Product Data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:	SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings	☑ Approval	☐ Approved as Submitted
☐ Letter	☐ Your Use	☐ Approved as Noted
☐ Prints	☐ As Requested	☐ Returned After Loan
☐ Change Order	☐ Review and Comment	☐ Resubmit
☐ Plans		☐ Submit
☐ Samples	**SENT VIA:**	☐ Returned
☐ Specifications	☐ Attached	☐ Returned for Corrections
☑ Other: Product Data	☐ Separate Cover Via:	☐ Due Date:

Item	*Package*	*Code*	*Rev.*	*Copies*	*Date*	*Description*	*Status*
Submittal		210523-002	1		11/29/2016	Valves for Fire Protection Piping Product Data	Submitted

NOTES:

CC:

Signed: _____

Devin Gates