210523 - Valves for Fire Protection Piping

250 PSI WWP Iron Body Gate Valves

Fire Protection Valve • Outside Screw and Yoke • **Resilient Wedge** • Epoxy Coated Interior/Exterior • Pre-Grooved Stem for Supervisory Switch • Drilled, Tapped and Plugged at Boss Location A**

250 PSI/17.2 Bar Non-Shock Cold Working Pressure (160° F/71° C max. operating temperature)

UL/ULC LISTED† • FM APPROVED •
AWWA C509 & 515 • NEW YORK CITY M.E.A. APPROVED 236-93E•
CERTIFIED LEAD-FREE* BY IAPMO R&T TO NSF/ANSI 372

F-607-RW
Flanged

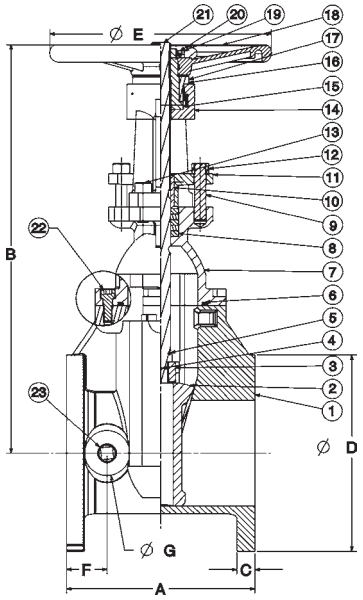

F-607-RW
Flg x Flg

MATERIAL LIST

	PART	SPECIFICATION
1.	Valve Body	Ductile Iron ASTM A536
2.	Resilient Wedge	Ductile Iron ASTM A536/EPDM ASTM D2000
3.	Wedge Nut	Bronze ASTM B584 UNS C83600
4.	Dowel Pin	Stainless Steel ASTM A276 UNS S42000 4" - 12" ASTM B584 UNS C92200 2½" - 3"
5.	Stem Back Seat O-Ring	EPDM ASTM D2000
6.	Bonnet Gasket	EPDM ASTM D2000
7.	Bonnet	Ductile Iron ASTM A536
8.	Stem Packing	EPDM ASTM D2000
9.	Threaded Rod	Carbon Steel Zinc Plated
10.	Gland Bushing	Bronze ASTM B584
11.	Gland	Cast Iron ASTM A126 Class B
12.	Gland Nut	Stainless Steel 18-8
13.	Yoke Screw	Alloy Steel ASTM A574M Zinc Plated
14.	Yoke	Cast Iron ASTM A126 Class B
15.	Yoke Bushing	Bronze ASTM B584
16.	Flat Point Set Screw	Alloy Steel ASTM F912M Black Oxide
17.	Yoke Bushing Retainer	Cast Iron ASTM A126 Class B
18.	Handwheel	Ductile Iron ASTM A536
19.	Handwheel Nut	Carbon Steel Zinc Plated
20.	Flat Head Screw	Carbon Steel Zinc Plated
21.	Stem	Bronze ASTM B150 UNS C61400
22.	Bonnet Screw	Alloy Steel ASTM A574M Zinc Plated
23.	NPT Pipe Plug	Malleable Iron ANSI B16.3 (Epoxy Coated)
24.	UL/FM Label (not shown)	Aluminum

NOTE: Electrostatically applied fusion-bonded epoxy coated inside and outside per AWWA C-550. Epoxy NSF and FDA certification

****Drilled, tapped and plugged at Position A with ½" valve sizes 2½"–4", ¾" on 6"–8", 1" on 10"–12".**

† Compliance with the Standard for Gate Valves for Fire Protection Service, UL 262, and the Canadian Requirements, ULC/ORD-C262.

NOTE: Flanged valve is consistent with ANSI B16.1 Class 125.

DIMENSIONS—WEIGHTS—QUANTITIES

Size		Dimensions A		B Open		B Closed		C		D		E		F		G		Bolt Circle		Flange	Turns	Weight	
In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	In.	mm.	Holes	To Open	Lbs.	Kg.
2½	65	7.5	190	17.8	453	14.9	378	0.69	17.5	7.0	178	7.9	200	1.50	38	1.6	40	5.50	140	4	8.8	45	20
3	80	8.0	203	19.7	500	15.9	405	0.75	19.0	7.5	191	7.9	200	1.73	44	2.1	54	6.00	152	4	10.5	53	24
4	100	9.0	229	21.0	534	16.6	422	0.94	24.0	9.0	229	10.2	260	2.13	54	2.1	54	7.50	191	8	10.4	94	43
6	150	10.5	267	29.3	744	22.9	581	1.00	25.4	11.0	279	12.4	315	2.24	57	2.5	64	9.50	241	8	15.7	154	70
8	200	11.5	292	37.0	939	28.5	724	1.13	28.6	13.5	343	14.8	375	2.48	63	2.8	70	11.75	298	8	17.2	247	112
10	250	13.0	330	44.8	1139	34.5	877	1.19	30.2	16.0	406	16.4	416	2.56	65	2.8	70	14.25	362	12	21.4	349	159
12	300	14.0	356	52.2	1326	39.9	1014	1.25	31.8	19.0	483	17.5	445	2.91	74	3.4	86	17.00	432	12	25.5	484	220

c UL LISTED FM APPROVED

*Weighted average lead content ≤ 0.25%

FREEZING WEATHER PRECAUTION: Subsequent to testing a piping system, valves should be left in an open position to allow complete drainage.

NIBCO INC. WORLD HEADQUARTERS • 1516 MIDDLEBURY ST. • ELKHART, IN 46516-4740 • USA • PH: 1.800.234.0227
TECH SERVICES PH: 1.888.446.4226 • FAX: 1.888.336.4226 • INTERNATIONAL OFFICE PH: +1.574.295.3327 • FAX: +1.574.295.3455
www.nibco.com

WM TAO & ASSOCIATES
CONSULTING ENGINEERS

Shop Drawing Submittal Review

Transmitted To: Cannon Design

Date: December 15, 2016

Attention: **stl-cac@cannondesign.com**

Contact Person / WTA Field Inspector: Patrick Garner

Project Name: Webster University-**ISB**

Reviewed by: Mike Whitworth (WES)

Project No. WT 14127.01
WES 607

[ ] UPS [ ] Courier [X] **Email**

Copies	No.	Description
1 PDF	210523F01	(Submittal No.'s:)
		(Cannon #210523-002) - (Paric #15051-0353) – (WES #607)
		➢ **Valves for Fire Protection Piping Product Data**

*Remarks: See Submittal Review from Webb Enginnering.

c: **Kelvin Patel**
Kpatel@cannondesign.com

[X] ***Reviewed**

[X] ***No Exceptions Taken**

[ ]

[ ] *Make Corrections As Noted, No Resubmittal Required

Corrections or comments made on shop drawings during this review do not relieve contractor from compliance with requirements of drawings and specifications. This check is only for review of general conformance with the design concept of project and general compliance with information given in contract documents. Contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating his work with that of all other trades; and performing his work in a safe and satisfactory manner.

WEBB ENGINEERING SERVICES INC.

1400 S. 3rd Street, Suite 201
St. Louis, Missouri 63104
Phone: (314) 588-0600
Fax: (314) 588-0604

Letter of Transmittal

To: wtashop@wmtao.com

From: Mike Whitworth

Date: December 11, 2016

Re: Webster University ISB

WES No: 607

☐ For your Files ☐ For Review ☐ Please Comment ☐ Please Reply

Item No.	Description	No. of Copies	Date
1	Shop Drawing Review – (210523-002) 210523 General Duty Valves for Water-Based Fire-Suppression Piping	1	12/11/16

•Signature: Mike Whitworth

WEBB ENGINEERING SERVICES INC.
1400 S. 3rd Street, Suite 201 • St. Louis, Missouri 63104 • 314.588.0600 • *fax* 314.588.0604
www.webb-engineering.com

The review of this submittal is limited to the general conformance with the designated design concept and intent of this project and with the general compliance of the information provided in the contract documents. All comments, remarks and notations made on the submittal(s) as a result of this review do not relieve the contractor from full compliance with requirements of the contract documents. Approval for a specific item shall not include approval of an assembly of which the item is not a component. The contractor is solely responsible for rough-in and installation confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordination of this work with that of other trades on this project; and in a safe and satisfactory manner. All work shall be installed in full compliance with the manufacturer's recommendation, Federal, State and Local rules and regulation and the Authority Having Jurisdiction (AHJ) and applicable adopted codes and standards.

PROJECT NAME:	Webster University ISB
LOCATION:	St. Louis Missouri
CLIENT PROJ. NO.:	N/A
WES PROJ. NO.:	607
SPECIFICATION SECTION:	210523 General Duty Valves for Water Based Fire-Suppression Piping
SUBMITTAL ITEM:	See Below -

CONTRACTOR:	J.F. Ahern Co.
CTR. SUBMITTAL #:	21 0523-002
SUBMITTAL DATE:	November 29, 2016
DATE RECEIVED:	December 07, 2016
RECEIVED VIA:	E-Mail
RECEIVED FROM:	WTA
DATE RETURNED:	DECEMBER 11, 2016
RETURNED VIA:	E-MAIL
RETRURNED TO:	WTASHOP@WMTAO.COM

STATUS KEY:

NO EXCEPTION TAKEN
MAKE CORRECTIONS NOTED, NO RESUBMITTAL:
AMEND AND RESUBMIT
REJECTED, SEE REMARKS:
REVIEWED ONLY

NEC	MCN	AAR	REJ	REV	ITEM	REMARKS
X					Iron Body Gate Valves NIBCO Model - F-607-RW	
X					Butterfly Valves Victaulic Model - Fire Lock Style 705	
X					Swing Check Valve Viking Model - D-1 & G-1	
X					Bronze Gate Valves NIBCO Model - T-104-0	
X					Bronze Angle Valves NIBCO Model - T-301-W	
X					Bronze Globe Valves NIBCO Model – KT-65-UL	
X					Bronze Globe Valves NIBCO Model – KT-211-W-UL	

WEBB ENGINEERING SERVICES INC.
1400 S. 3rd Street, Suite 201 • St. Louis, Missouri 63104 • 314.588.0600 • *fax* 314.588.0604
www.webb-engineering.com

X					Bronze Side Outlet Globe Valves NIBCO Model – KT-291-W3	
X					Bronze Check Valves NIBCO Model – KT-403-W	
X					Bronze Ball Valves NIBCO Model – KT-585-70-UL and KT-580-70-UL	
X					Fire Lock Ball Valve Victaulic Model - Fire Lock Series 728	
X					Butterball Butterfly Valves Milwaukee Valve Model - Various	
X					Calibrated Pressure Relief Valves Watts Model – Series 530C	
X					Test and Drain Valve AGF Manufacturing Model – 1011A	
X					Double Check Valve Assembly Zurn Model - 350A	
X					Forged Brass Ball Valve KITZ Model - 58	
X					Pressure Relief Valve / Pump Casing Relief Valve CLA-VAL Model – 55L-60	
X					Air Release Valve Val-Matic Valve and Manufacturing Corp. Model – 22.9	

REVIEWED BY: Michael R. Whitworth DATE: December 11, 2016

THESE COMMENTS ARE TO BE ATTACHED TO ALL COPIES OF THE SHOP DRAWING REFERENCED ABOVE.

CANNONDESIGN

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

WEBSTER UNIVERSITY ISB
PROJECT NAME

8274 BIG BEND BLVD
ADDRESS

NUMBER

WEBSTER UNIVERSITY
OWNER

CANNON DESIGN
ARCHITECT / ENGINEER

Joe Voypick
SUBMITTED BY

210523-002
CONTRACTOR / CM SUBMITTAL NO.

CANNON DESIGN SUBMITTAL NO.

DRAWING / DETAIL REFERENCE

210523
SPECIFICATION SECTION / PARAGRAPH

Ahern Fire Protection
MANUFACTURER / SUPPLIER

ITEM / PRODUCT ID

REQUIRED DATE

PRIORITY

◯ CRITICAL

ITEM BEING SUBMITTED (check only one)

- ◯ Shop Drawings
- ◯ Samples (_____ copies)
- ◯ LEED Submittal
- ◯ Certification / Qualifications
- ◉ Record Documents
- ◯ Product Data
- ◯ Coordination Drawing
- ◯ Calculations
- ◯ Schedules
- ◯ O&M Manuals
- ◯ Other _____

ITEM BEING SUBMITTED FOR (check only one)

◉ Action ◯ Information Only ◯ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION
(SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)

PARIC

PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

By:
Devin D. Gates

Joe Voypick
REVIEWED BY

11/30/16
DATE

To be completed by Reviewer

21 0523-002
CANNON DESIGN SUBMITTAL NUMBER

11/30/16
RECEIVED DATE

- ◯ A. No Exceptions Taken
  No further review of submittal is required.
- ◯ B. Make Corrections Noted
  Incorporate corrections in work; resubmission is not required.
- ◯ C. Revise and Resubmit
  Revise as noted, and resubmit for review.
- ◯ D. Rejected
  Submittal is not in compliance with Contract Documents; provide new submittal.
- ◯ E. For Record / Information Only
  Submittal was reviewed for Record / Information purposes only.
- ◯ F. Not Required for Review
  Submittal is not required by Contract Documents and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

A/E COMMENTS ◯ See attached sheet(s) for additional comments

REVIEWED BY

DATE

77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0353

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 11/29/2016

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

Fax;
314-241-2203

RE: Valves for Fire Protection Piping Product Data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:	SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings	☑ Approval	☐ Approved as Submitted
☐ Letter	☐ Your Use	☐ Approved as Noted
☐ Prints	☐ As Requested	☐ Returned After Loan
☐ Change Order	☐ Review and Comment	☐ Resubmit
☐ Plans		☐ Submit
☐ Samples	**SENT VIA:**	☐ Returned
☐ Specifications	☐ Attached	☐ Returned for Corrections
☑ Other: Product Data	☐ Separate Cover Via:	☐ Due Date:

Item	*Package*	*Code*	*Rev.*	*Copies*	*Date*	*Description*	*Status*
Submittal		210523-002	1		11/29/2016	Valves for Fire Protection Piping Product Data	Submitted

NOTES:

CC:

Signed: _____

Devin Gates