

Mechanical-T® Bolted Branch Outlets

STYLES 920 AND 920N

211313 - Wet-Pipe Sprinkler System

Victaulic Mechanical-T® Outlet provides a direct branch connection at any location a hole can be cut in pipe. The hole is cut oversize to receive a "holefinder" locating collar which secures the outlet in position permanently. A pressure responsive gasket seals on the pipe O.D.

Cross-type connections can be achieved by utilizing two upper housings of the same style and size, with the same or differing branch size connections. NOTE: Style 920 and Style 920N housings cannot be mated to each other to achieve a cross connection.

Style 920 and Style 920N Mechanical-T outlets are available with grooved or female threaded outlet. Specify choice on order. Units are supplied painted with plated bolts. Galvanized housings are available, supplied with plated bolts.

All sizes of Style 920 and 920N are rated at 500 psi/3450 kPa working pressure on Schedule 10 and 40 carbon steel pipe. They may also be used on high density polyethylene or polybutylene (HDPE) pipe. Pressure ratings on HDPE are dependent on the pipe rating. Contact Victaulic for ratings on other pipe. **Style 920 and 920N are not recommended for use on PVC plastic pipe.**

Standard piping practices dictate that the Mechanical-T Styles 920 and 920N must be installed so that the main and branch connections are a true 90° angle when permanently attached to the pipeline surface.

Additionally, the Vic-Tap II® hole cutting tool, which allows for hole cutting capabilities on pressurized systems, utilizes the Style 920 Mechanical-T in conjunction with the Series 726 Vic-Ball Valve to create the Style 931 Vic-Tap II Mechanical-T unit. See page 8 for further information.



506



STYLES 920 AND 920N



STYLE 920 CROSS

PATENTED

MATERIAL SPECIFICATIONS

Housing/Coating: Ductile iron conforming to ASTM A-536, grade 65-45-12, with orange enamel coating. Ductile iron conforming to ASTM A-395, grade 65-45-15, is available upon special request.

- **Optional:** Hot dipped galvanized

Gasket: (Specify choice*)

- **Grade "E" EPDM**

EPDM (Green color code). Temperature range -30°F to +230°F/-34°C to +110°C.

Recommended for cold and hot water service within the specified temperature range plus a variety of dilute acids, oil-free air and many chemical services. UL Classified in accordance with ANSI/NSF 61 for cold +86°F/+30°C and hot +180°F/+82°C. NOT RECOMMENDED FOR PETROLEUM SERVICES.

- **Grade "T" nitrile**

Nitrile (Orange color code). Temperature range -20°F to +180°F/-29°C to +82°C.

Recommended for petroleum products, air with oil vapors, vegetable and mineral oils within the specified temperature range. Not recommended for hot water services over +150°F/+66°C or for hot dry air over +140°F/+60°C.

*Services listed are General Service Recommendations only. It should be noted that there are services for which these gaskets are not recommended. Reference should always be made to the latest Victaulic Gasket Selection Guide for specific gasket service recommendations and for a listing of services which are not recommended.

Bolts/Nuts: Heat-treated plated carbon steel, trackhead meeting the physical and chemical requirements of ASTM A-449 and physical requirements of ASTM A-183.

JOB/OWNER

System No. _____

Location _____

CONTRACTOR

Submitted By _____

Date _____

ENGINEER

Spec Sect _____ Para _____

Approved _____

Date _____

www.victaulic.com

VICTAULIC IS A REGISTERED TRADEMARK OF VICTAULIC COMPANY. © 2012 VICTAULIC COMPANY. ALL RIGHTS RESERVED.

REV_M




11.02_1

Mechanical-T® Bolted Branch Outlets


506

STYLES 920 AND 920N

DIMENSIONS

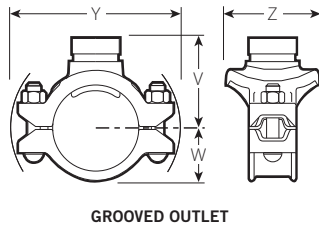

GROOVED OUTLET

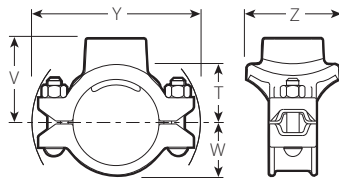

FEMALE THREADED OUTLET

- Provides a direct branch connection at any location where a hole can be cut in the pipe
- A pressure responsive gasket provides the seal
- Request Publication 11.03 for Mechanical-T cross assemblies
- Pressure rated up to 500 psi/3450 kPa on steel pipe; also available for use with HDPE pipe
- Sizes from 2 × ½"/50 × 15 mm through 8 × 4"/200 × 100 mm

IMPORTANT NOTES:

Style 920 and Style 920N housings cannot be mated to one another to achieve cross connections.

Size Run × Branch Nominal Size Inches mm	Style No. 920 or 920N	Max. Work Pressure@ psi kPa	Dimensions							Approx. Weight Each	
			Hole Diameter +0.13 -0.00 Inches mm	T** Inches mm	V † # Thd. Inches mm	V ‡ Grv. Inches mm	W Inches mm	Y Inches mm	Z Inches mm	Female Thd. Lbs. kg	Grv. Lbs. kg
2 50 × ½ (a) □	920N	500 3450	1.50 38.1	2.00 51	2.53 64	—	1.61 41	5.35 136	2.75 70	3.1 1.5	—
	920N	500 3450	1.50 38.1	1.97 50	2.53 64	—	1.61 41	5.35 136	2.75 70	3.1 1.5	—
	920N	500 3450	1.50 38.1	1.85 47	2.53 64	—	1.61 41	5.35 136	2.75 70	3.0 1.4	—
	920N	500 3450	1.75 44.5	2.05 52	2.75 70	3.00 76	1.61 41	5.35 136	3.00 76	3.5 1.7	3.2 1.5
	920N	500 3450	1.75 44.5	2.03 52	2.75 70	3.12 79	1.61 41	5.35 136	3.25 83	3.6 1.7	3.2 1.5
2 ½ 65 × ½ (a) § □	920N	500 3450	1.50 38.1	2.21 56	2.74 70	—	1.82 46	5.64 143	2.75 70	3.0 1.4	—
	920N	500 3450	1.50 38.1	2.18 55	2.74 70	—	1.82 46	5.64 143	2.75 70	3.0 1.4	—
	920N	500 3450	1.50 38.1	2.06 52	2.74 70	—	1.82 46	5.64 143	2.75 70	2.9 1.4	—
	920N	500 3450	1.75 44.5	2.30 58	3.00 76	3.25 83	1.82 46	6.29 160	3.00 76	3.5 1.7	3.2 1.5
	920N	500 3450	2.00 50.8	2.28 58	3.00 76	3.25 83	1.82 46	6.26 159	3.25 83	3.6 1.7	3.3 1.6
76.1 × ½ (a) □	920N	300 2065	1.50 38.1	2.22 56	2.75 70	—	2.25 57	6.46 164	3.18 81	3.9 1.8	—
	920N	300 2065	1.50 38.1	2.19 56	2.75 70	—	2.25 57	6.46 164	3.18 81	3.9 1.8	—
	920N	300 2065	1.50 38.1	2.07 53	2.75 70	—	2.25 57	6.46 164	3.18 81	3.8 1.7	—
	920N	500 3450	1.75 44.5	2.30 58	3.00 76	3.31 84	1.92 49	6.29 160	3.00 76	3.5 1.6	3.2 1.5
	920N	500 3450	2.00 50.8	2.28 58	3.00 76	3.31 84	1.92 49	6.29 160	3.25 83	3.5 1.6	3.3 1.5
3 80 × ½ (a) □	920N	500 3450	1.50 38.1	2.52 64	3.05 78	—	2.28 58	6.15 156	2.75 70	3.4 1.6	—
	920N	500 3450	1.50 38.1	2.49 63	3.05 78	—	2.28 58	6.15 156	2.75 70	3.4 1.6	—
	920N	500 3450	1.50 38.1	2.38 61	3.06 78	—	2.28 58	6.15 156	2.75 70	3.3 1.6	—
	920N	500 3450	1.75 44.5	2.55 65	3.25 83	3.56 90	2.28 58	6.15 156	3.00 76	3.8 1.8	3.7 1.8
	920N	500 3450	2.00 50.8	2.78 71	3.50 89	3.56 90	2.28 58	6.15 156	3.25 83	4.1 1.9	3.8 1.8
	920N	500 3450	2.50 63.5	2.75 70	3.50 89	3.56 90	2.28 58	6.75 172	3.88 99	4.9 2.3	4.6 2.1
3 ½ 90 × 2 50	920N	500 3450	2.50 63.5	3.00 76	—	3.75 95	2.44 62	6.72 171	3.88 99	—	3.8 1.8

TABLE CONTINUED ON PG. 3

** Center of run to engaged pipe end, female threaded outlet only (dimensions approximate).

† Available with grooved or female threaded outlet. Specify choice on order.

‡ Center of run to end of fitting.

Female threaded outlets are available to NPT and BSPT specifications.

@ See page 7 for Fire Protection approvals and pressure ratings.

(a) British Standard female pipe threaded outlet is available as listed. Specify "BSPT" clearly on order.

(b) For 76.1 mm threaded outlet, specify 2 ½" BSPT clearly on order.

§ Vds approved for fire protection services


□ LPCB approved for fire protection services

∅ Approved for use in China by Tianjin Approvals Company.


Mechanical-T® Bolted Branch Outlets

STYLES 920 AND 920N

DIMENSIONS

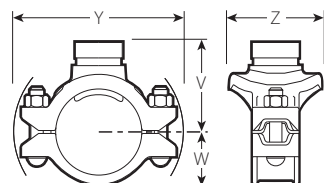

GROOVED OUTLET

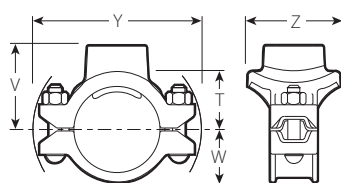

FEMALE THREADED OUTLET

- Provides a direct branch connection at any location where a hole can be cut in the pipe
- A pressure responsive gasket provides the seal
- Request Publication 11.03 for Mechanical-T cross assemblies
- Pressure rated up to 500psi/3450kPa on steel pipe; also available for use with HDPE pipe
- Sizes from 2 × ½"/50 × 15mm through 8 × 4"/200 × 100mm

IMPORTANT NOTES:

Style 920 and Style 920N housings cannot be mated to one another to achieve cross connections.

Size	Style No.	Max. Work Pressure®	Dimensions							Approx. Weight Each		
Run x Branch Nominal Size Inches mm	920 or 920N	psi kPa	Hole Diameter +0.13 -0.00	T** Inches mm	V ‡ # Thd. Inches mm	V ‡ Grv. Inches mm	W Inches mm	Y Inches mm	Z Inches mm	Female Thd. Lbs. kg	Grv. Lbs. kg	
TABLE CONTINUED FROM PAGE 2												
4 100 ×	½ (a) α 15	920N	500 3450	1.50 38.1	3.03 77	3.56 90	—	2.69 68	7.01 178	2.75 70	3.7 1.8	—
	¾ (a) α 20	920N	500 3450	1.50 38.1	3.00 76	3.56 90	—	2.69 68	7.01 178	2.75 70	3.7 1.8	—
	1 (a) α 25	920N	500 3450	1.50 38.1	2.88 73	3.56 90	—	2.69 68	7.01 178	2.75 70	3.6 1.8	—
	1¼ (a) †α 32 (b)	920N	500 3450	1.75 44.5	3.08 78	3.78 96	4.00 102	2.69 68	7.01 178	3.00 76	4.0 1.9	3.6 1.8
	1½ (a) †α 40 (b)	920N	500 3450	2.00 50.8	3.28 83	4.00 102	4.00 102	2.69 68	7.01 178	3.25 83	4.2 2.0	3.9 1.9
	2 (a) †α 50	920N	500 3450	2.50 63.5	3.25 83	4.00 102	4.00 102	2.69 68	7.01 178	3.88 99	5.0 2.3	4.6 2.1
	2½ (a) † 65	920	500 3450	2.75 69.9	2.88 73	4.00 102	4.00 102	2.69 68	7.34 186	4.63 118	5.8 2.6	5.0 2.3
	76.1 mm	920	500 3450	2.75 69.9	2.88 73	—	4.00 102	2.69 68	7.34 186	4.63 118	—	6.4 2.9
	3 (a) † 80	920	500 3450	3.50 88.9	3.31 84	4.50 114	4.12 105	2.69 68	7.73 196	5.12 130	8.4 3.8	6.4 2.9
108.0 ×	1¼ (a) α 32	920N	500 3450	1.75 44.5	3.08 78	3.78 96	—	2.63 67	7.64 194	3.05 78	5.0 2.3	—
	1½ (a) α 40	920N	500 3450	2.00 50.8	3.28 83	4.00 102	—	2.63 67	7.64 194	3.25 83	5.0 2.3	—
	2 (a) 50	920N	500 3450	2.50 63.5	3.25 83	4.00 102	—	2.63 67	7.64 194	4.00 102	4.0 1.9	—
	76.1 mm	920	500 3450	2.75 69.9	2.88 73	4.00 102	4.00 102	2.63 67	7.64 194	4.29 109	8.0 3.6	7.8 3.5
	3 (a) 80	920	500 3450	3.50 88.9	3.31 84	4.50 114	4.50 114	2.63 67	7.63 194	4.88 124	6.8 3.1	6.5 3.0
	5 125 ×	1½ (a) † 40	920	500 3450	2.00 50.8	4.03 102	4.75 121	4.75 121	3.16 80	9.70 246	3.69 94	7.4 3.4
2 (a) † 50		920	500 3450	2.50 63.5	4.00 102	4.75 121	4.75 121	3.16 80	9.70 246	4.38 111	8.2 3.7	8.0 3.6
2½ (a) † 65		920	500 3450	2.75 69.9	3.63 92	4.75 121	4.75 121	3.16 80	9.70 246	4.63 118	8.3 3.8	7.9 3.6
76.1 mm α		920	500 3450	2.75 69.9	3.75 95	—	4.75 121	3.16 80	9.70 246	4.63 118	—	8.0 3.6
3 (a) † 80		920	500 3450	3.50 88.9	3.81 97	5.00 127	4.63 118	3.16 80	9.70 246	5.31 135	8.4 3.8	8.8 4.0
133.0 ×		2 50	920N	500 3450	2.50 63.5	3.75 95	4.50 114	—	3.17 81	8.00 203	3.88 99	8.0 3.6
	3 80	920	500 3450	3.50 88.9	3.81 97	5.00 127	—	3.00 76	9.46 240	5.31 135	8.0 3.6	—
TABLE CONTINUED ON PG. 4												

TABLE CONTINUED ON PG. 4

** Center of run to engaged pipe end, female threaded outlet only (dimensions approximate).

‡ Available with grooved or female threaded outlet. Specify choice on order.

‡ Center of run to end of fitting.

Female threaded outlets are available to NPT and BSPT specifications.

@ See page 7 for Fire Protection approvals and pressure ratings.

(a) British Standard female pipe threaded outlet is available as listed. Specify "BSPT" clearly on order.

(b) For 76.1 mm threaded outlet, specify 2½" BSPT clearly on order.

§ Vds approved for fire protection services

‡ LPCB approved for fire protection services


Ø Approved for use in China by Tianjin Approvals Company.

Mechanical-T® Bolted Branch Outlets


506

STYLES 920 AND 920N

DIMENSIONS

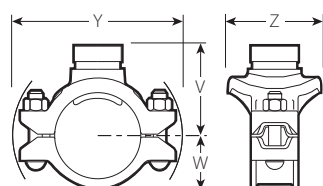

GROOVED OUTLET

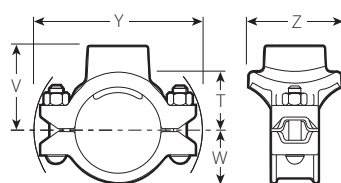

FEMALE THREADED OUTLET

- Provides a direct branch connection at any location where a hole can be cut in the pipe
- A pressure responsive gasket provides the seal
- Request Publication 11.03 for Mechanical-T cross assemblies
- Pressure rated up to 500 psi/3450 kPa on steel pipe; also available for use with HDPE pipe
- Sizes from 2 × ½"/50 × 15 mm through 8 × 4"/200 × 100 mm

IMPORTANT NOTES:

Style 920 and Style 920N housings cannot be mated to one another to achieve cross connections.

Size		Style No.	Max. Work Pressure®	Dimensions							Approx. Weight Each		
Run × Branch Nominal Size Inches mm		920 or 920N	psi kPa	Hole Diameter +0.13 -0.00	T** Inches mm	V † # Thd. Inches mm	V † Grv. Inches mm	W Inches mm	Y Inches mm	Z Inches mm	Female Thd. Lbs. kg	Grv. Lbs. kg	
TABLE CONTINUED FROM PAGE 3													
139.7 ×	1½ † 40	920N	500 3450	2.00 50.8	3.78 96	4.50 114	—	3.30 84	8.23 209	3.25 83	7.0 3.2	—	
	2 † 50	920N	500 3450	2.50 63.5	3.75 95	4.50 114	—	3.30 84	8.23 209	3.88 99	9.0 4.1	—	
6 150 ×	1¼ (a) 32 (b)	920N	500 3450	1.75 44.5	4.43 112	5.13 130	5.13 130	3.79 96	9.15 232	3.25 83	5.1 2.3	4.8 2.2	
	1½ (a) †‡ 40 (b)	920N	500 3450	2.00 50.8	4.40 112	5.13 130	5.13 130	3.79 96	9.15 232	3.25 83	5.4 2.4	5.1 2.3	
	2 (a) †‡ 50	920N	500 3450	2.50 63.5	4.38 111	5.13 130	5.13 130	3.79 96	9.15 232	3.88 99	6.0 2.7	5.6 2.5	
	2½ 65	920	500 3450	2.75 69.9	4.01 110	5.13 130	5.12 130	3.69 94	10.51 267	4.63 118	8.3 3.8	7.6 3.4	
	76.1 mm ‡	920	500 3450	2.75 69.9	4.15 105	—	5.21 132	3.69 94	10.51 267	4.63 118	—	8.4 3.8	
	3 (a) † 80	920	500 3450	3.50 88.9	4.31 110	5.50 140	5.13 130	3.69 94	10.51 267	5.31 135	9.9 4.5	8.4 3.8	
	4 (a) †‡ 100	920	500 3450	4.50 114.3	3.81 97	5.75 146	5.38 137	3.69 94	10.51 267	6.25 159	10.1 4.6	10.1 4.6	
	159.0 ×	1½ (a) 40	920N	500 3450	2.00 50.8	4.41 112	5.13 130	—	3.63 92	9.40 239	3.25 83	7.8 3.5	—
		2 (a) 50	920N	500 3450	2.50 63.5	4.38 111	5.13 130	—	3.63 92	9.40 239	3.88 99	8.0 3.6	—
76.1 mm		920	500 3450	2.75 69.9	4.38 111	5.50 140	5.13 130	3.63 92	9.40 239	4.63 118	9.5 4.3	9.5 4.3	
3 80		920	500 3450	3.50 88.9	4.31 110	5.50 140	5.13 130	3.63 92	9.40 239	5.31 135	8.1 3.7	14.0 6.4	
108.0 mm		920	500 3450	4.50 114.3	4.45 113	—	5.38 137	3.63 92	9.40 239	6.12 155	—	10.0 4.5	
4 100		920	500 3450	4.50 114.3	3.81 96.80	5.75 146	—	3.63 92	9.40 239	6.25 159	18.0 8.2	—	
TABLE CONTINUED ON PG. 5													

** Center of run to engaged pipe end, female threaded outlet only (dimensions approximate).

† Available with grooved or female threaded outlet. Specify choice on order.

‡ Center of run to end of fitting.

Female threaded outlets are available to NPT and BSPT specifications.

@ See page 7 for Fire Protection approvals and pressure ratings.

(a) British Standard female pipe threaded outlet is available as listed. Specify "BSPT" clearly on order.

(b) For 76.1 mm threaded outlet, specify 2 ½" BSPT clearly on order.

§ Vds approved for fire protection services

‡ LPCB approved for fire protection services


Ø Approved for use in China by Tianjin Approvals Company.

Mechanical-T® Bolted Branch Outlets


506

STYLES 920 AND 920N

DIMENSIONS

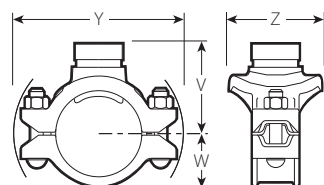

GROOVED OUTLET

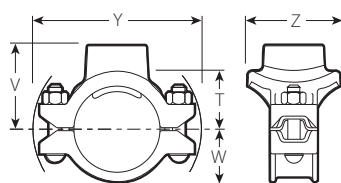

FEMALE THREADED OUTLET

- Provides a direct branch connection at any location where a hole can be cut in the pipe
- A pressure responsive gasket provides the seal
- Request Publication 11.03 for Mechanical-T cross assemblies
- Pressure rated up to 500 psi/3450 kPa on steel pipe; also available for use with HDPE pipe
- Sizes from 2 × ½"/50 × 15 mm through 8 × 4"/200 × 100 mm

Size		Style No.	Max. Work Pressure®	Dimensions							Approx. Weight Each	
Run × Branch Nominal Size Inches mm		920 or 920N	psi kPa	Hole Diameter +0.13 -0.00	T** Inches mm	V ‡ # Thd. Inches mm	V ‡ Grv. Inches mm	W Inches mm	Y Inches mm	Z Inches mm	Female Thd. Lbs. kg	Grv. Lbs. kg
TABLE CONTINUED FROM PAGE 4												
165.1 ×	1 25	920N	500 3450	1.50 38.1	3.88 99	4.56 116	—	3.79 96	9.34 237	2.75 70	8.0 3.6	—
	1¼ α 32	920N	500 3450	1.75 44.5	4.43 113	5.13 130	—	3.79 96	9.34 237	3.25 83	8.4 3.8	—
	1½ (a) †α 40	920N	500 3450	2.00 50.8	4.41 112	5.13 130	5.13 130	3.79 96	9.34 237	3.25 83	8.4 3.8	5.4 2.4
	2 (a) † 50	920N	500 3450	2.50 63.5	4.38 111	5.13 130	5.13 130	3.79 96	9.34 237	3.88 99	8.5 3.9	6.0 2.7
	76.1 mm	920	500 3450	2.75 69.9	4.01 110	5.13 130	5.21 132	3.63 92	10.51 267	4.63 118	8.6 3.9	7.6 3.4
	3 (a) † ø 80	920	500 3450	3.50 88.9	4.31 110	5.50 140	5.13 130	3.63 92	10.51 267	5.31 135	10.2 4.6	8.4 3.8
	4 (a) †α 100	920	500 3450	4.50 114.3	3.81 97	5.75 146	5.38 137	3.63 92	10.51 267	6.25 159	10.5 4.8	8.4 3.8
	8 200 ×	2 (a) † 50	920	500 3450	2.75 69.9	5.44 138	6.19 157	6.25 159	4.81 122	12.42 316	4.50 114	11.6 5.3
2½ (a) † 65		920	500 3450	2.75 69.9	5.07 129	6.19 157	6.19 157	4.81 122	12.42 316	4.50 114	11.6 5.3	11.6 5.3
76.1 mm α		920	500 3450	2.75 69.9	5.25 133	—	6.25 159	4.81 122	12.42 316	4.56 116	—	11.6 5.3
3 (a) †α 80		920	500 3450	3.50 88.9	5.31 135	6.50 165	6.50 165	4.81 122	12.42 316	5.31 135	12.6 5.7	11.6 5.3
4 (a) †α 100		920	500 3450	4.50 114.3	4.81 122	6.75 171	6.38 162	4.81 122	12.42 316	6.25 159	15.3 6.9	12.5 5.7

** Center of run to engaged pipe end, female threaded outlet only (dimensions approximate).

† Available with grooved or female threaded outlet. Specify choice on order.

‡ Center of run to end of fitting.

Female threaded outlets are available to NPT and BSPT specifications.

@ See page 7 for Fire Protection approvals and pressure ratings.

(a) British Standard female pipe threaded outlet is available as listed. Specify "BSPT" clearly on order.

(b) For 76.1 mm threaded outlet, specify 2½" BSPT clearly on order.

§ Vds approved for fire protection services

⌘ LPCB approved for fire protection services

Ø Approved for use in China by Tianjin Approvals Company.

IMPORTANT NOTES:


Style 920 and Style 920N housings cannot be mated to **each other** to achieve cross connections.

Mechanical-T[®] Bolted Branch Outlets

506

STYLES 920 AND 920N

FLOW DATA

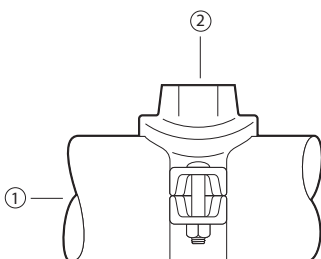

Exaggerated for clarity

Flow test data has shown that the total head loss between point (1) and (2) for the Style 920, 920N and 929 Mechanical-T[®] fittings can best be expressed in terms of the pressure difference across the inlet and branch. The pressure difference can be obtained from the relationship below.

C_v and K_v Values

Values for flow of water at +60°F/+16°C are shown in the table below.

Formulas for C_v/K_v Values:

$$\Delta P = \frac{Q^2}{C_v^2}$$

$$Q = C_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (GPM)

ΔP = Pressure Drop (psi)

C_v = Flow Coefficient

$$\Delta P = \frac{Q^2}{K_v}$$

$$Q = K_v \times \sqrt{\Delta P}$$

Where:

Q = Flow (m³/h)

ΔP = Pressure Drop (bar)

K_v = Flow Coefficient

OUTLET SIZE		Equivalent Length of Outlet Size Schedule 40 Carbon Steel Pipe (per UL 213, Sec. 16) (C = 120)† FT		C _v /K _v Values	
NOMINAL DIAMETER In/mm	ACTUAL O.D. In/mm	GROOVED	THREADED	GROOVED	THREADED
½	0.840	-	2	-	11
15	21.3	-	-	-	9.4
¾	1.050	-	4	-	16
20	26.7	-	-	-	13.7
1	1.315	-	8	-	21
25	33.7	-	-	-	1.8
1 ¼	1.660	5 ½	6	50	48
32	42.7	-	-	42.9	41.1
1 ½	1.900	11	11	53	53
40	98.3	-	-	45.4	45.4
2	2.375	9	10 ½	112	104
50	60.3	-	-	96	89.1
2 ½	2.875	20	12 ½	119	150
65	73.0	-	-	102	128.5
76.1 mm	3.000	16*	-	161	-
	76.1	-	-	138.1	-
3	3.500	14	15 ½	249	237
80	88.9	-	-	213.4	203.1
4	4.500	20	22	421	401
100	114.3	-	-	360.8	343.6

† Hazen-Williams coefficient of friction is 120.

* Pipe with a wall thickness of 0.165in./4.2mm.

Mechanical-T[®] Bolted Branch Outlets

506

STYLES 920 AND 920N

FIRE PROTECTION APPROVALS AND PRESSURE RATINGS

The information provided below is based on the latest listing and approval data at the time of publication. Listings/Approvals are subject to change and/or additions by the approvals agencies. Contact Victaulic for performance on other pipe and the latest listings and approvals.

Run Size		Outlet Size	Pipe	Approval Agency Rated Working Pressures – psi/kPa					
Nominal Size Inches/mm	Actual Outside Diameter Inches/mm	Inches/mm	Schedule	UL	ULC	FM	LPCB	Vds	
								(Style 920)	(Style 920N)
2 1/2 - 6 65 - 150	2.875 - 6.625 73.0 - 168.3	All	10, 40	400 2755	400 2755	400 2755	290 1999	232 1599	362 2496
2 1/2 - 4 65 - 100	2.875 - 4.500 73.0 - 114.3	All	DF	300 2065	300 2065	300 2065	290 1999	232 1599	362 2496
2 1/2 - 4 65 - 100	2.875 - 4.500 73.0 - 114.3	All	SF	300 2065	300 2065	300 2065	290 1999	232 1599	362 2496
6 150	6.625 168.3	3, 4	10	300 2065	300 2065	250 1724	290 1999	232 1599	362 2496
6 150	6.625 168.3	3, 4	30, 40	300 2065	300 2065	300 2065	290 1999	232 1599	362 2496
8 200	8.625 219.1	2 1/2	10, 40	400 2755	—	—	—	145 1000	—
8 200	8.625 219.1	3, 4	10	300 2065	—	250 1724	—	145 1000	—
8 200	8.625 219.1	3, 4	30, 40	300 2065	—	300 2065	—	145 1000	—

NOTES:

10 refers to Listed/Approved Schedule 10 steel sprinkler pipe.

40 refers to Listed/Approved Schedule 40 steel sprinkler pipe.

DF refers to Listed/Approved Dyna-Flow steel sprinkler pipe manufactured by American Tube Company.

SF refers to Listed/Approved Super-Flo steel sprinkler pipe manufactured by Allied Tube and Conduit Corporation.

VIC-TAP II HOLE CUTTING TOOL FOR 4 - 8"/100 - 200MM CARBON STEEL PIPE



The Vic-Tap II hole cutting tool is designed for use with the Style 931 Vic-Tap II Mechanical-T unit, which is a combination of the Style 920 Mechanical-T and Series 726 Vic-Ball Valve. The Vic-Tap II is capable of tapping into carbon steel pipe systems under pressures up to 500 psi/3450 kPa.

The Style 931 Vic-Tap II Mechanical-T unit is a full port ball valve which can be mounted on 4"/100mm, 5"/125mm, 6"/150mm and 8"/200 mm diameter pipe. The Style 931 comes with a 2 1/2"/65 mm grooved outlet.

The drill motor is an electric motor with ground fault circuit interrupter (GFCI) in accordance with safety codes.

For more information, refer to publication 24.01.

Mechanical-T[®] Bolted Branch Outlets

506

STYLES 920 AND 920N

INSTALLATION

Reference should always be made to the I-100 Victaulic Field Installation Handbook for the product you are installing. Handbooks are included with each shipment of Victaulic products for complete installation and assembly data, and are available in PDF format on our website at www.victaulic.com.

WARRANTY

Refer to the Warranty section of the current Price List or contact Victaulic for details.

NOTE

This product shall be manufactured by Victaulic or to Victaulic specifications. All products to be installed in accordance with current Victaulic installation/assembly instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

For complete contact information, visit www.victaulic.com

11.02 1480 REV M UPDATED 03/2012

VICTAULIC IS A REGISTERED TRADEMARK OF VICTAULIC COMPANY. © 2012 VICTAULIC COMPANY. ALL RIGHTS RESERVED.

11.02_L



Shop Drawing Submittal Review

Transmitted To: Cannon Design

Date: December 20, 2016

Attention: stl-cac@cannondesign.com

Contact Person / WTA Field Inspector:
Patrick Garner

Project Name: Webster University-**ISB**

Reviewed by: Mike Whitworth (WES)

Project No. WT 14127.01
WES 607

☐

UPS

☐

Courier

☒

Email

Copies	No.	Description
1 PDF	211313F02	(Submittal No.'s:)
		(Cannon #211313-015) - (Paric #15051-0349) – (WES #607)
		➤ Wet Pipe Sprinkler System Product Data

***Remarks: See Submittal Review from Webb Engineering.**

c: Kelvin Patel
Kpatel@cannondesign.com

☒

***Reviewed**

☒

***No Exceptions Taken -**

☒

***Amend and Resubmit**

☒

***Make Corrections As Noted,
No Resubmittal Required**

Corrections or comments made on shop drawings during this review do not relieve contractor from compliance with requirements of drawings and specifications. This check is only for review of general conformance with the design concept of project and general compliance with information given in contract documents. Contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating his work with that of all other trades; and performing his work in a safe and satisfactory manner.



1400 S. 3rd Street, Suite 201
St. Louis, Missouri 63104
Phone: (314) 588-0600
Fax: (314) 588-0604

Letter of Transmittal

To: wtashop@wmtao.com

From: Mike Whitworth

Date: December 20, 2016

Re: Webster University ISB

WES No: 607

☐ For your Files

☐ For Review

☐ Please Comment

☐ Please Reply

Item No.	Description	No. of Copies	Date
1	Shop Drawing Review – (213113-015) 211313 Wet Pipe Sprinkler System	1	12/20/16

•Signature: Mike Whitworth

The review of this submittal is limited to the general conformance with the designated design concept and intent of this project and with the general compliance of the information provided in the contract documents. All comments, remarks and notations made on the submittal(s) as a result of this review do not relieve the contractor from full compliance with requirements of the contract documents. Approval for a specific item shall not include approval of an assembly of which the item is not a component. The contractor is solely responsible for rough-in and installation confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordination of this work with that of other trades on this project; and in a safe and satisfactory manner. All work shall be installed in full compliance with the manufacturer's recommendation, Federal, State and Local rules and regulation and the Authority Having Jurisdiction (AHJ) and applicable adopted codes and standards.

PROJECT NAME: Webster University I
 LOCATION: St. Louis Missouri
 CLIENT PROJ. NO.: N/A
 WES PROJ. NO.: 607
 SPECIFICATION SECTION: 211313
Wet Pipe Sprinkler
System
 SUBMITTAL ITEM: See Below -

CONTRACTOR: J.F. Ahern Co.
 CTR. SUBMITTAL #: 21 1313-015
 SUBMITTAL DATE: November 29, 2016
 DATE RECEIVED: December 07, 2016
 RECEIVED VIA: E-Mail
 RECEIVED FROM: WTA
 DATE RETURNED: DECEMBER 20, 2016
 RETURNED VIA: E-MAIL
 RETRURNED TO: WTASHOP@WMTAO.COM

STATUS KEY:

NO EXCEPTION TAKEN						
NEC	MCN	AAR	REJ	REV	MAKE CORRECTIONS NOTED, NO RESUBMITTAL:	
					AMEND AND RESUBMIT	
					REJECTED, SEE REMARKS:	
					REVIEWED ONLY	
					ITEM	REMARKS
Pages numbers have been added to cut sheets for referencing						
X					Page 001 Schedule 10 Pipe Various Manufacturers	
X					Page 002 Schedule 40 Pipe Various Manufacturers	
X					Pages 003 – 004 Test and Drain Valve AGF Manufacture ring Model – 1011A	
X					Pages 005 – 006 Backflow Preventer Zurn Industries Model – 350A	
X					Pages 007 – 008 Standard Duty Loop Hanger Caddy Model – 115 Series	

X				Pages 009 – 010 Universal Beam Clamp Caddy Model – 300 Series	
X				Pages 011 – 016 Carbon Steel Anchor Screw Hilti Model – 3.3.5 KWIK HUS- EZ (KH-EZ1)	
X				Page 017 Riser Clamp PHD Manufacturing Model – Fig. 550-551-553	
X				Page 018 Universal Restraining Strap Afcon Model - 162	
X				Pages 019 – 027 Sleeve Expansion Anchors Powers Fasteners Model – Lok-Bolt Hex Head and Rod Hanger	
X				Pages 028 – 031 Strut Channel Gregory Strut Products Model – G712OS, G712A, G5820S, G582A and G1320OS	
X				Page 032 Surge Restraint 115 Caddy Model – SR6	
X				Page 033 Screw Anchor/Hanger ITW Model – Sammy X-Press	
		X		Pages 034 – 039 Quick Response Dry Pendent Sprinkler Viking Model - SIN Not Specified	1. SIN numbers listed in submittal (VK172, VK176, VK180 on pages 037/038) is not listed on the FP drawings in the Sprinkler schedule.
X				Pages 040 -043 Microfast Quick Response Upright Sprinkler Viking Model – SIN VK300	
		X		Pages 044 -049 Microfast Quick Response Pendent Sprinkler Viking Model – SIN VK302	1. SIN number listed in submittal (VK302 on pages 047/048) is not listed on the FP drawings in the Sprinkler schedule.

X				Pages 050 – 055 Microfast Quick Response Horizontal Sidewall Sprinkler Viking Model – SIN VK305	
X				Pages 056 – 059 Microfast Quick Response Upright Sprinkler Viking Model – SIN VK350	
		X		Pages 060 – 065 Microfast Quick Response Pendent Sprinkler Viking Model – SIN VK352 (K8.0)	1. SIN number listed in submittal (VK352 on pages 063/064) is not listed on the FP drawings in the Sprinkler schedule.
		X		Pages 066 – 071 Microfast Quick Response Pendent Sprinkler Viking Model – SIN VK352 (K8.0)	1. SIN number listed in submittal (VK352 on pages 069/070) is not listed on the FP drawings in the Sprinkler schedule.
X				Pages 072 – 077 Mirage Standard and QR Concealed Pendent Sprinkler Viking Model – SIN VK462	
X				Page 078 Spare Sprinkler Head Cabinet FPPI Model – Not indicated	
X				Page 079 – 089-091 Spare Sprinkler Head Cabinet TYCO Model – Not Indicated	
X				Pages 080 – 088 Sprinkler Escutcheons Viking Model -	
X				Pages 092 – 094 Sprinkler Guards Viking Model – D-1	
X				Pages 095 – 100 Standard / QR Extended Coverage Upright Sprinkler Viking Model – SIN VK532	
X				Pages 101 – 106 Standard / QR Extended Coverage Pendent Sprinkler Viking Model – SIN VK534	

X				Pages 107 – 112 Mirage QR Extended Coverage Concealed Pendent Sprinkler Viking Model – SIN VK634	
		X		Pages 113 – 120 Concealed Dry Pendent Sprinkler Reliable Model – G5-56 Dry (SIN RA5114)	1. Manufacturer and model/SIN number listed in submittal is not listed on the FP drawings in the Sprinkler schedule. 2. Color/finish of cover plate to be submitted to the Architect for review and approval.
X				Pages 121 - 124 Flexible Coupling Victaulic Model – Style 75	
X				Pages 125 - 128 Reducing Coupling Victaulic Model – Style 750	
X				Pages 129 – 131 FireLock Fittings Victaulic Model – Fire lock	
X				Pages 132 – 134 FireLock Rigid Coupling Victaulic Model – Style 005H	
X				Pages 135 – 136 Fire lock Flange Adapter Victaulic Model – Style 744	
X				Pages 137 – 144 Mechanical T Bolted Branch Outlets Victaulic Model – Styles 920 and 920N	
X				Pages 145 – 149 Firelock Rigid Coupling Victaulic Model – Style 009N	
X				Pages 150 – 151 Threaded Mechanical Branch Tee Anvil Model – Fig. MT-30	
X				Pages 152 – 153 Grooved Welded Steel Pipe Outlets Vandewater International Inc. Model - Various	
X				Pages 154 – 155 Welded Steel Pipe Outlets Vandewater International Inc. Model - Various	

X					Page 156 DI Threaded Fitting – 90 Elbow Anvil Model – Fig 3201	
X					Page 157 DI Threaded Fitting – 45 Elbow Anvil Model – Fig 3202	
X					Page 158 DI Threaded Fitting – Reducing 90 Elbow Anvil Model – Fig 3201R	
X					Page 159 DI Threaded Fitting – Straight T Anvil Model – Fig 3205	
X					Pages 160 - 161 DI Threaded Fitting – Reducing T Anvil Model – Fig 3205R	
X					Page 162 DI Threaded Fitting Anvil Model – Bull Head T	
X					Page 163 DI Threaded Fitting Cross Anvil Model - 3207	
X					Page 164 DI Threaded Fitting Anvil Model – 3221R	
X					Page 165 DI Threaded Fitting Anvil Anvil Model - 3121	
X					Page 166 DI Threaded Fitting Cap Anvil Model - 3224	
X					Page 167-168 DI Threaded Fitting Bushing Anvil Model - 3283	

				X	Pages 169 – 183 Flexible Sprinkler Hose Victaulic Model – Series AH2 Bracket AB1, AB7 and AB7 Adjustable	1. This product is not listed in the construction documents for use on this project. Contractor has elected to incorporate into the delegated design.
X					Pages 184 – 185 Water Flow Detector System Sensor Model – WFD Series	
X					Pages 186 – 192 Supervisory Switch Potter Electrical Model – PCVS Series	
	X				Pages 193 – 194 Electric Bell Potter Electric Model – Not Indicated	1. Specified to be 10 inch diameter. Refer to specification section 211313, part 2.6, B4 and B-7.
X					Page 195 Service Gauge Ashcroft Model – 35W1005PH02LXUL300	
X					Pages 196 – 199 Intumescent Sealant STI Model - Series LCI	
X					Page 200 Fire Pump Suction and Discharge Gauges Alenco Series AG-1000L	
X					Page 201 Suction and Discharge Gauge Assembly A-C Fire Pump systems Model – Not Indicated	
	X				Pages 202 – 203 Fire Pump Test Header Potter Roemer Model – 5864-x-x-6-D- NST	1. Assembly to be mounted vertically, in space available.
Note: Fire protection drawings list sprinkler Viking model Mirage, SIN VK464 (31 total) and Viking model Dry, Sin VK194, (24 total) in the Sprinkler Schedule. These two sprinkler heads are not included in this submittal.						

REVIEWED BY: Michael R. Whitworth DATE: December 20, 2016

THESE COMMENTS ARE TO BE ATTACHED TO ALL COPIES OF THE SHOP DRAWING REFERENCED ABOVE.

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

PROJECT NAME	
ADDRESS	
NUMBER	
OWNER	
ARCHITECT / ENGINEER	
SUBMITTED BY	
CONTRACTOR / CM SUBMITTAL NO.	CANNON DESIGN SUBMITTAL NO.
DRAWING / DETAIL REFERENCE	SPECIFICATION SECTION / PARAGRAPH
MANUFACTURER / SUPPLIER	ITEM / PRODUCT ID
REQUIRED DATE	PRIORITY
	☐ CRITICAL

ITEM BEING SUBMITTED (check only one)

- | | | |
|---|--|--|
| ☐ Shop Drawings | ☐ Certification / Qualifications | ☐ Coordination Drawing |
| ☐ Samples (_____ copies) | ☐ Record Documents | ☐ Calculations |
| ☐ LEED Submittal | ☐ Product Data | ☐ Schedules |
| ☐ Other _____ | ☐ O&M Manuals | |

ITEM BEING SUBMITTED FOR (check only one)

- ☐ Action
 ☐ Information Only
 ☐ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION (SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)



PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

By:

Devin D. Gates

REVIEWED BY	DATE

To be completed by Reviewer

CANNON DESIGN SUBMITTAL NUMBER
RECEIVED DATE
☐ A. No Exceptions Taken No further review of submittal is required.
☐ B. Make Corrections Noted Incorporate corrections in work; resubmission is not required.
☐ C. Revise and Resubmit Revise as noted, and resubmit for review.
☐ D. Rejected Submittal is not in compliance with Contract Documents; provide new submittal.
☐ E. For Record / Information Only Submittal was reviewed for Record / Information purposes only.
☐ F. Not Required for Review Submittal is not required by Contract Documents and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

A/E COMMENTS

☐ See attached sheet(s) for additional comments

REVIEWED BY	DATE



77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0349

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 11/29/2016

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

Fax;
314-241-2203

RE: Wet Pipe Sprinkler System Product Data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:	SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings	☒ Approval	☐ Approved as Submitted
☐ Letter	☐ Your Use	☐ Approved as Noted
☐ Prints	☐ As Requested	☐ Returned After Loan
☐ Change Order	☐ Review and Comment	☐ Resubmit
☐ Plans		☐ Submit
☐ Samples	SENT VIA:	☐ Returned
☐ Specifications	☐ Attached	☐ Returned for Corrections
☒ Other: Product Data	☐ Separate Cover Via:	☐ Due Date:

Item	Package	Code	Rev.	Copies	Date	Description	Status
Submittal		211313-015	1		11/29/2016	Wet Pipe Sprinkler System Product Data	Submitted

NOTES:

CC:

Signed: _____
Devin Gates