


5100 Grease interceptor

Regularly Furnished: A.R.C. coated fabricated steel grease interceptor with removable baffles, external, flow control fitting and gasketed scoriated cover and no-hub inlet/outlet.

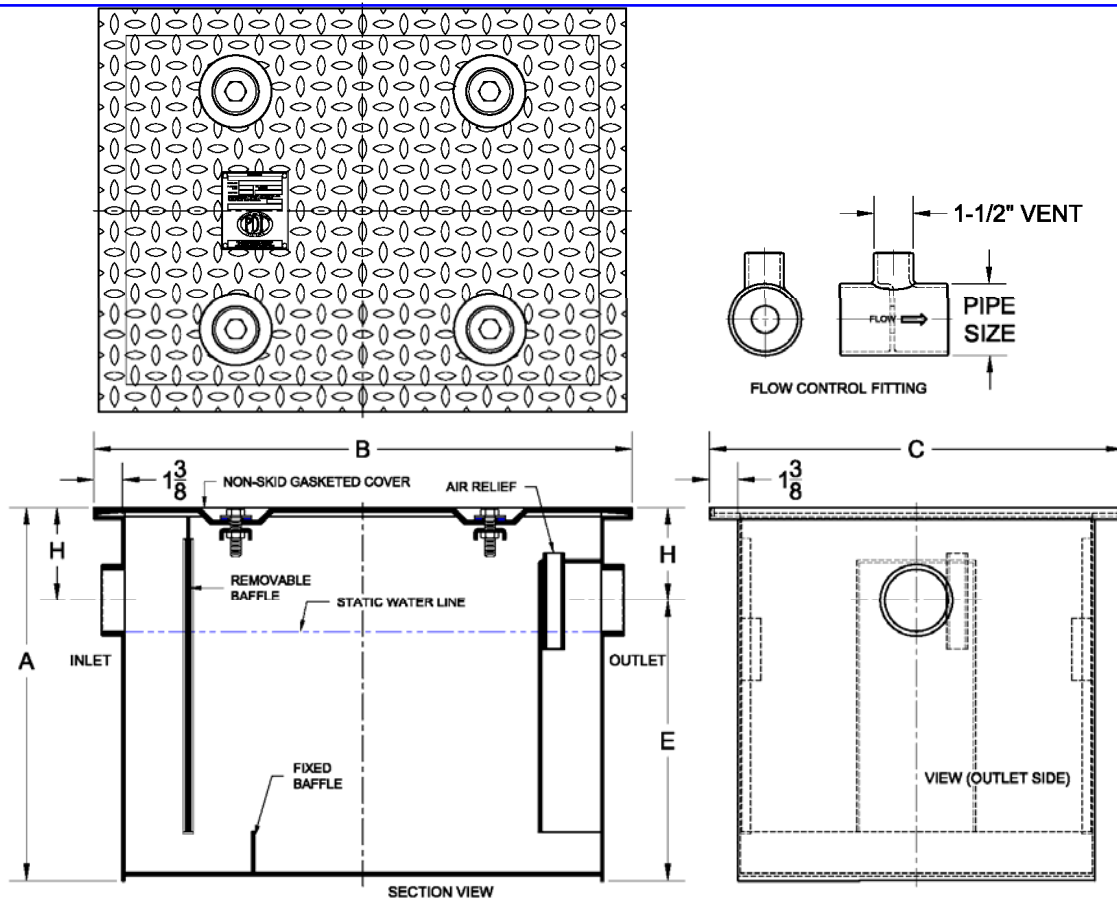

✓	Size (GPM)	Inlet Outlet	Capacity Lbs. (Kg)	Capacity Gal. (L)	A	B	C	E	H
	4	2 (50)	8 (3.6)	3.7 (12.8)	10 ½ (267)	18 (457)	13 (330)	7 (178)	3 ½ (89)
	7	2 (50)	14 (6.3)	5.4 (20.4)	12 1/8 (308)	18 3/16 (462)	13 (330)	8 5/8 (219)	3 ½ (89)
	10	2 (50)	20 (9.0)	7.3 (27.6)	13 ¼ (367)	20 1/8 (511)	14 ¾ (375)	9 ¾ (248)	3 ½ (89)
	15	2 (50)	30 (13.6)	11.0 (41.6)	13 ¾ (367)	25 (635)	17 (432)	9 ¾ (235)	4 (102)
	20	3 (75)	40 (18.1)	12.6 (47.7)	13 ¾ (367)	27 (686)	18 ¾ (476)	9 ¾ (428)	3 ½ (89)
	25	3 (75)	50 (22.7)	19.8 (74.9)	18 ½ (470)	26 (660)	20 (508)	14 (356)	4 ½ (114)
✓	35	4 (100)	70 (31.7)	28.8 (109.0)	22 ½ (572)	28 ¾ (730)	20 (508)	18 (457)	4 ½ (114)
	50	4 (100)	100 (45.3)	37.4 (141.5)	22 ½ (572)	30 (762)	24 (610)	18 (457)	4 ½ (114)
	75	4 (100)	150 (68.0)	57.1 (216.1)	23 3/8 (594)	34 5/8 (879)	30 5/8 (778)	17 ½ (445)	5 7/8 (149)
	100	4 (100)	200 (90.7)	106.2 (402.0)	27 5/8 (702)	41 3/8 (1051)	30 5/8 (778)	22 (559)	5 5/8 (143)

Options		
✓	Suffix	Description
✓	-18	Heavy Duty Cover
	-24	Anchor Flange
	-26	Anchor Flange w/ Clamp Device
✓	-27	Sediment (Sludge) Bucket
	-70	Outlet One Size Larger
	-71	Outlet One Size Smaller

Options		
✓	Suffix	Description
✓	-XT	Extension (Specify H)
	-FH	Cradle Housing
	-FHT	Enclosed Cradle Housing
	-T	Cover Recessed for Tile
	-IPS	Female ✓ Threaded Inlet/Outlet

Shop Drawing Submittal

Project Name: WEBSTER ISB

Specification # **221319-R1**

Specification Description: Grease Interceptor

Date: 08-10-16

General Contractor / Construction Manager: PARIC

ARCHITECT: KWA

ENGINEER: William Tao / Webb

Contractor: DeLuca Plumbing, L.L.C.
8465 Delport Drive
St. Louis, MO 63114

Supplier: Ferguson

Manufacturer: Wade

Reviewed & Approved by: DeLuca Plumbing 08-10-16

Action: Forward to GC/CM for Review & Approval

--

Shop Drawing Submittal Review

Transmitted To: Cannon Design

Date: August 16, 2016

Attention: stl-cac@cannondesign.com

Contact Person / WTA Field Inspector:
Patrick Garner

Project Name: Webster University-**ISB**

Reviewed by: Mike Whitworth (WES)

Project No. WT 14127.01
WES 607

☐

UPS

☐

Courier

☒

Email

Copies	No.	Description
1 PDF	221319P02A	(Submittal No.'s) - Resubmittal
		(Cannon #22 1319-003 REV1) - (Paric #15051-0186) - (WES #607)
		• Wade Grease Interceptor

***Remarks: See Submittal Review from Webb Engineering.**

c: **Kelvin Patel**
Kpatel@cannondesign.com

☒

***Reviewed**

☒

***No Exceptions Taken**

☐☐

***Make Corrections As Noted,
No Resubmittal Required**

Corrections or comments made on shop drawings during this review do not relieve contractor from compliance with requirements of drawings and specifications. This check is only for review of general conformance with the design concept of project and general compliance with information given in contract documents. Contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating his work with that of all other trades; and performing his work in a safe and satisfactory manner.



1400 S. 3rd Street, Suite 201
St. Louis, Missouri 63104
Phone: (314) 588-0600
Fax: (314) 588-0604

Letter of Transmittal

To: **wtashop@wmtao.com**

From: **Mike Whitworth**

Date: **August 13, 2016**

Re: **Webster University ISB**

WES No: **607**

☐ For your Files

☐ For Review

☐ Please Comment

☐ Please Reply

Item No.	Description	No. of Copies	Date
1	Shop Drawing Review – Resubmittal – Rev 002 221319 Grease Interceptor	1	08-13-2016

•Signature: Mike Whitworth



**WEBB
ENGINEERING
SERVICES INC.**

www.webb-engineering.com

The review of this submittal is limited to the general conformance with the designated design concept and intent of this project and with the general compliance of the information provided in the contract documents. All comments, remarks and notations made on the submittal(s) as a result of this review do not relieve the contractor from full compliance with requirements of the contract documents. Approval for a specific item shall not include approval of an assembly of which the item is not a component. The contractor is solely responsible for rough-in and installation confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordination of this work with that of other trades on this project; and in a safe and satisfactory manner. All work shall be installed in full compliance with the manufacturer's recommendation, Federal, State and Local rules and regulation and the Authority Having Jurisdiction (AHJ) and applicable adopted codes and standards.

PROJECT NAME: Webster University
ISB

LOCATION: St. Louis Missouri

CLIENT PROJ. NO.: N/A

WES PROJ. NO.: 607

SPECIFICATION SECTION: 221319
Grease Interceptor

SUBMITTAL ITEM: See Below -

CONTRACTOR: Deluca Plumbing, LLC

CTR. SUBMITTAL #: 22 1319-003 – RESUBMITTED – REV002

SUBMITTAL DATE: August 10, 2016

DATE RECEIVED: August 11, 2016

RECEIVED VIA: E-Mail

RECEIVED FROM: WTA

DATE RETURNED: JULY 17, 2016

RETURNED VIA: E-MAIL

RETRURNED TO: WTASHOP@WMTAO.COM

STATUS KEY:

NO EXCEPTION TAKEN						
NEC	MAKE CORRECTIONS NOTED, NO RESUBMITTAL:					
	MCN	AMEND AND RESUBMIT				
		AAR	REJECTED, SEE REMARKS:			
			REJ	REVIEWED ONLY		
				REV	ITEM	REMARKS
X					Grease Interceptor Wade Model 510035-18-27-XT-4NH	

REVIEWED BY: Michael R. Whitworth DATE: August 13, 2016

THESE COMMENTS ARE TO BE ATTACHED TO ALL COPIES OF THE SHOP DRAWING REFERENCED ABOVE.

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

PROJECT NAME	
ADDRESS	
NUMBER	
OWNER	
ARCHITECT / ENGINEER	
SUBMITTED BY	
CONTRACTOR / CM SUBMITTAL NO.	CANNON DESIGN SUBMITTAL NO.
DRAWING / DETAIL REFERENCE	SPECIFICATION SECTION / PARAGRAPH
MANUFACTURER / SUPPLIER	ITEM / PRODUCT ID
REQUIRED DATE	PRIORITY
CRITICAL	☐

To be completed by Reviewer

CANNON DESIGN SUBMITTAL NUMBER
RECEIVED DATE

- ☐ **A. No Exceptions Taken**
No further review of submittal is required.
- ☐ **B. Make Corrections Noted**
Incorporate corrections in work;
resubmission is not required.
- ☐ **C. Revise and Resubmit**
Revise as noted, and resubmit for review.
- ☐ **D. Rejected**
Submittal is not in compliance with Contract Documents;
provide new submittal.
- ☐ **E. For Record / Information Only**
Submittal was reviewed for Record / Information
purposes only.
- ☐ **F. Not Required for Review**
Submittal is not required by Contract Documents
and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

ITEM BEING SUBMITTED (check only one)

- ☐ Shop Drawings ☐ Certification / Qualifications ☐ Coordination Drawing
☐ Samples ☐ Record Documents ☐ Calculations
 (_____ copies) ☐ Product Data ☐ Schedules
☐ LEED Submittal ☐ O&M Manuals
☐ Other _____

ITEM BEING SUBMITTED FOR (check only one)

- ☐ Action ☐ Information Only ☐ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION
(SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)



PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

Ry:

Devin D. Gates

REVIEWED BY	DATE

A/E COMMENTS

- ☐
- See attached sheet(s) for additional comments

REVIEWED BY	DATE



77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0186

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 08/10/2016

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

RE: Grease Interceptor Product Data REV1

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:		SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings		☒ Approval	☐ Approved as Submitted
☐ Letter		☐ Your Use	☐ Approved as Noted
☐ Prints		☐ As Requested	☐ Returned After Loan
☐ Change Order		☐ Review and Comment	☐ Resubmit
☐ Plans			☐ Submit
☐ Samples		SENT VIA:	
☐ Specifications		☐ Attached	☐ Returned
☒ Other: Product Data		☐ Separate Cover Via:	☐ Returned for Corrections
			☐ Due Date:

<i>Item</i>	<i>Package</i>	<i>Code</i>	<i>Rev.</i>	<i>Copies</i>	<i>Date</i>	<i>Description</i>	<i>Status</i>
Submittal		221319-003	2		08/10/2016	Grease Interceptor Product Data REV1	Submitted

NOTES:

CC:

Signed: _____
Devin Gates