

Description

Knauf 1000° Pipe Insulation is a molded, heavy-density, one-piece insulation made from inorganic glass fibers bonded with a thermosetting resin. It is produced in 3' lengths with or without a factory-applied jacket. The jacket is a white-kraft paper bonded to aluminum foil and reinforced with glass fibers, and the longitudinal lap of the jacket is available with or without a self-sealing adhesive. A butt strip is furnished for each section.

Application

Knauf 1000° Pipe Insulation is used in power, process and industrial applications and in commercial and institutional buildings where maximum fire safety, resistance to physical abuse and a finished appearance are desired. Additional weather protection is needed outdoors.

Features & Benefits

Energy Conservation

- Offers excellent resistance to heat loss or gain, which saves energy and lowers operating costs.
- A low thermal conductivity of .23 at 75°F (24°C).

Low-Cost Installation

- Available with a self-sealing lap, which eliminates need for staples, additional material and tools.
- Fast, easy installation reduces labor costs.

Condensation Control

- Installed properly, the foil vapor retarder and pressure-sensitive lap assure a positive vapor seal.

UL Classified

- All Knauf 1000° Pipe Insulation, plain or jacketed, meets the fire and smoke safety requirements of most federal, state and local building codes.

Easy Size Identification

- Pipe size, wall thickness and Proto 25/50 Rated PVC fitting cover size are printed in a repeat pattern along the longitudinal lap.
- Easy identification at job site.
- Simplifies restocking.
- After application, print is covered by the lap for a neat appearance.

Specification Compliance

In U.S.:

- ASTM E 136 (plain pipe insulation)
- ASTM C 547; Type I, Type IV
- ASTM C 585
- ASTM C 795
- ASTM C 1136 (jackets); Type I, II, III, IV
- HH-B-100B (jackets); Type I and II
- HH-I-558C; Form D, Type III, Class 12; Class 13 (to 1000°F, 538°C)
- GREENGUARD Certification
- GREENGUARD For Children & Schools™ Certification
- MEA 325-83-M (City of New York Dept. of Buildings)
- MIL-I-22344D
- MIL-I-24244C (ships)
- NFPA 90A and 90B
- NRC Reg. Guide 1.36
- USCG 164.109/4/0 (plain, unjacketed only)

In Canada:

- CAN/ULC S102-M88
- CCG F1-304 (plain only)
- CGSB 51-GP-9M
- CGSB 51-GP-52M (jacket)

Technical Data

Surface Burning Characteristics

- UL Classified.
- Does not exceed 25 Flame Spread, 50 Smoke Developed when tested in accordance with ASTM E 84, CAN/ULC S102-M88, NFPA 255 and UL 723.

Temperature Range

- Pipe operating temperatures from 0°F to 1000°F (-18°C to 538°C).

Water Vapor Transmission (ASTM E 96, Procedure A)

- Jacket has a water vapor permeance of .02 perms or less.

Corrosiveness (ASTM C 665)

- No greater than sterile cotton.

Stress Corrosion

- Complies with ASTM C 795, MIL-I-24244C and NRC 1.36.

Puncture Resistance (TAPPI Test T803) (Beach Units)

- Jacket minimum rating of 50 units.

Alkalinity (ASTM C 871)

- Less than 0.6% as Na₂O.
- pH between 7.5 and 10.0.

Microbial Growth (ASTM C 1338)

- Does not promote microbial growth.

Water Vapor Sorption (ASTM C 1104)

- Less than 0.2% by volume.

Linear Shrinkage (ASTM C 356)

- Negligible.

Product Forms and Sizes

Produced in 3' (914 mm) sections:

- For iron pipe from ½" to 24" nominal pipe size (15 mm to 610 mm).
- For copper tube from ⅝" to 6⅞" (16 mm to 156 mm).
- Wall thicknesses from ½" to 6" (13 mm to 152 mm) in single layer (for most sizes).
- All insulation inner and outer diameters comply with ASTM C 585.

Packaging

- Four convenient carton sizes for easy ordering, inventory tracking and storage.
- Reinforced carton handles for strength and easy lifting.
- Bar-coded cartons for accurate shipments and tracking.
- Full product range stocked at distributors for fast availability.

Precautions

Hot Pipe

- May be installed while the system is in operation, at all temperatures up to 1000°F (538°C).
- Knauf recommends, for insulation thickness greater than 6" (152 mm), the temperature must be increased from 500°F (260°C) to maximum temperature at a rate not exceeding 100°F (56°C) per hour.
- During initial heat-up to operating temperatures above 350°F (177°C), a slight odor and some smoke may be given off as a portion of the bonding material used in the insulation begins to undergo a controlled decomposition.
- If natural convection is not adequate in confined areas, forced ventilation should be provided in

order to protect against any harmful fumes and vapors that might be generated.

- Care must also be taken when using sealants, solvents or flammable adhesive during installation.
- A maximum of 6" (152 mm) wall thickness is recommended.

Cold Pipe

- Use a continuous vapor retarder on piping operating below ambient temperatures.
- Seal all joints, surfaces, seams and fittings to prevent condensation.
- On below freezing applications and, in high abuse areas, the ASJ jacket shall be protected with a PVC vapor retarding outer jacket. In addition, exposed ends of insulation shall be sealed with vapor barrier mastic installed per the mastic manufacturer's instructions. Vapor seals at the butt joint shall be applied at every fourth pipe section joint and at each fitting to isolate any water incursion.
- On chilled water systems operating in high humidity conditions, it is recommended that the same guide lines be followed as listed above for below freezing applications.
- Exterior hanger supports are recommended.

Outside Application

- Do not expose pipe insulation to weather. It must be covered with appropriate jacketing, mastic or vapor retardant adhesives.
- All exposed surfaces must be protected. Proto® Indoor/Outdoor PVC Jacketing is recommended. See Knauf Guide Specifications for recommended PVC jacketing application guidelines.
- Apply jacketing, mastics or vapor retardant adhesives per manufacturer's instructions. For metallic jackets, factory-applied condensate barriers are recommended.

ASJ-SSL

- Keep adhesive and contact surfaces free from dirt and water, and seal immediately once adhesive is exposed.
- Apply when ambient and insulation temperatures are between 0°F and 130°F (-18°C and 54°C).
- If stored below 0°F or above 130°F, allow insulation cartons to stand within recommended temperature range for 24 hours prior to application.
- Do not store product below -20°F (-29°C) or above 150°F (66°C).
- When using Knauf's SSL closure system, make sure the longitudinal and circumferential joints are properly sealed by rubbing the closure firmly with a squeegee. Use of staples is not recommended.
- When using Knauf SSL Pipe Insulation, the surface temperature of the insulation should be between -20°F and 150°F (-29°C and 66°C) during the life of the insulation.

Fittings and Hangers

- Use Proto 25/50 Rated (ASTM E 84) PVC Fitting Covers, applying PVC fittings per Proto's Data Sheet.
- Fittings should be insulated to same thickness as the adjoining insulation.
- Apply fittings per manufacturer's instructions.
- When required by specification, a hard insert of sufficient length should be used to avoid compression of the insulation.

Additional Precautions

- Fiber glass may cause temporary skin irritation. Wear long-sleeved, loose-fitting clothing, head

1000° Pipe Insulation

Submittal Date _____

KNAUFINSULATION

covering, gloves and eye protection when handling and applying material.

- Wash with soap and warm water after handling.
- Wash work clothes separately and rinse washer.
- Use a disposable mask/respirator designed for nuisance-type dusts where sensitivity to dust and airborne particles may cause irritation to the nose or throat.

Application Guidelines

Storage

- Protect insulation from water damage or other abuse, welding sparks and open flame.
- Cartons are not designed for outside storage.

Preparation

- Apply only on clean, dry surfaces.
- Pipe or vessel should be tested and released before insulation is applied.

General Guidelines

- All sections should be firmly butted.
- Seal circumferential joint with a minimum 3" (76 mm) wide butt strip.
- Jackets, coating and adhesives should have a comparable F.H.C. rating.

- Factory-applied jacket can be painted with latex or water-based paint. Solvent-based paints should not be used.
- Do not expose factory-applied jacket to chemicals or liquid water.
- All piping should have continuous insulation.
- Position longitudinal lap downward to avoid dirt and moisture infiltration.
- Do not expose pipe insulation to excessive vibration or physical abuse.
- Faced insulation should not have a facing temperature above 150°F (66°C).

Recommended Thicknesses

ASHRAE 90.1-1989

The minimum thicknesses are based on ASHRAE 90.1-1989 standards and do not necessarily represent the Economic Thickness of Insulation or the thickness required for proper condensation control. Rather, they serve as minimum recommendations for commercial applications. For recommended Economic Thickness, install according to Knauf or NAIMA 3E Plus programs or as specified.

Fiber Glass and Mold


Fiber glass insulation will not sustain mold growth. However, mold can grow on almost any material when it becomes wet and contaminated with organic materials. Carefully inspect any insulation that has been exposed to water. If it shows any sign of mold it must be discarded. If the material is wet but shows no evidence of mold, it should be dried rapidly and thoroughly. If it shows signs of facing degradation from wetting, it should be replaced.

Notes

The chemical and physical properties of Knauf 1000° Pipe Insulation represent typical average values determined in accordance with accepted test methods. The data is subject to normal manufacturing variations. The data is supplied as a technical service and is subject to change without notice. References to numerical flame spread ratings are not intended to reflect hazards presented by these or any other materials under actual fire conditions.

Check with your Knauf Insulation sales representative to assure information is current.

Thermal Efficiency (ASTM C 335)

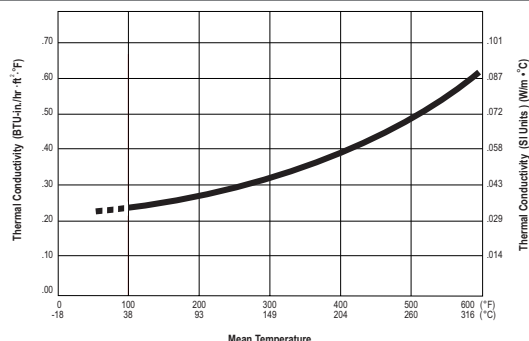

Mean Temperature	k	k (SI)
75°F (24°C)	.23	.033
100°F (38°C)	.24	.035
200°F (93°C)	.28	.040
300°F (149°C)	.34	.049
400°F (204°C)	.42	.061
500°F (260°C)	.51	.074
600°F (316°C)	.62	.089

Shop Drawing Submittal Review

Transmitted To: Cannon Design

Date: February 7, 2017

Attention: stl-cac@cannondesign.com

Contact Person / WTA Field Inspector:
Patrick Garner

Project Name: Webster University-**ISB**

Reviewed by: Mike Nolte

Project No. WT 14127.01

☐

UPS

☐

Courier

☒

Email

Copies	No.	Description
1 PDF	232500M01	(Submittal No.'s:) (R&B CxSRC)
		(Cannon #232500-001) - (Paric #15051-0453) - (WES #607)
		➤ Mechanical Insulation Product Data

***Remarks: See Review Comments on PAGE 2.**

c: Kelvin Patel
Kpatel@cannondesign.com

☐ Furnish as Submitted

☒ ***Furnish as Noted**

☐ Rejected

☐ Revise & Resubmit

☐ Reviewed

☐

Corrections or comments made on shop drawings during this review do not relieve contractor from compliance with requirements of drawings and specifications. This check is only for review of general conformance with the design concept of project and general compliance with information given in contract documents. Contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating his work with that of all other trades; and performing his work in a safe and satisfactory manner.

Shop Drawing Submittal Review

***Submittal Review Comments**

1. Contractor responsible to verify that all adhesives, sealants and sealant primers meet the requirements of LEED Credit IEQ 4.1. Provide Product Data for Credit IEQ 4.1 for all adhesives, sealants and sealant primers, including printed statement of VOC content. The submittal does not appear to contain this information for all sealants submitted.
2. Provide aluminum jacketing on all exterior piping per Specification 232500-2.2-D-5: For insulation installed outdoors and insulation subject to water damage, provide an additional **0.016 inch** aluminum jacket with lock seam, longitudinal joint and gasketed bands for butted joints as required for a watertight installation. Jacket shall be complete with waterproof, laminated paper lining and shall be manufactured by ITW Insulation System or RPR Products.

14127.01 - 232500 M01
MTN TO REVIEW -
01/18/17

From: STL-CAC <STL-CAC@CANNONDESIGN.COM>
To: 'Patrick Garner' <pgarner@wmtao.com>, "WTASHOP (WTASHOP@wmtao.com)"
<WTA...
CC: "Patel, Kelvin" <kpatel@CANNONDESIGN.COM>
Date: 1/18/2017 3:01 PM
Subject: Webster ISB - 23 2500-001
Attachments: 232500-001 Mechanical Insulation Product Data.pdf

Attached for review.

Melissa Pirtle

[cid:image001.png@01D2719B.8CD710A0]
1100 Clark Ave
St. Louis, Missouri 63102
T 314.425.8797
cannondesign.com

SUBMITTAL IDENTIFICATION SHEET

To be completed by Contractor/CM

PROJECT NAME	
ADDRESS	
NUMBER	
OWNER	
ARCHITECT / ENGINEER	
SUBMITTED BY	
CONTRACTOR / CM SUBMITTAL NO.	CANNON DESIGN SUBMITTAL NO.
DRAWING / DETAIL REFERENCE	SPECIFICATION SECTION / PARAGRAPH
MANUFACTURER / SUPPLIER	ITEM / PRODUCT ID
REQUIRED DATE	PRIORITY
CRITICAL	☐

To be completed by Reviewer

CANNON DESIGN SUBMITTAL NUMBER
RECEIVED DATE

- ☐ **A. No Exceptions Taken**
No further review of submittal is required.
- ☐ **B. Make Corrections Noted**
Incorporate corrections in work;
resubmission is not required.
- ☐ **C. Revise and Resubmit**
Revise as noted, and resubmit for review.
- ☐ **D. Rejected**
Submittal is not in compliance with Contract Documents;
provide new submittal.
- ☐ **E. For Record / Information Only**
Submittal was reviewed for Record / Information
purposes only.
- ☐ **F. Not Required for Review**
Submittal is not required by Contract Documents
and has not been reviewed.

Review is for conformance with the design concept of this project and for general compliance with contract documents. Contractor is responsible for quantities, dimensions and compliance with contract documents and for information that pertains to fabrication processes, construction techniques and coordination of this work with all trades which will be affected thereby. This review is null and void if submittal deviates from contract documents and does not indicate or note deviations.

ITEM BEING SUBMITTED (check only one)

- ☐ Shop Drawings ☐ Certification / Qualifications ☐ Coordination Drawing
☐ Samples ☐ Record Documents ☐ Calculations
 (_____ copies) ☐ Product Data ☐ Schedules
☐ LEED Submittal ☐ O&M Manuals
☐ Other _____

ITEM BEING SUBMITTED FOR (check only one)

- ☐ Action ☐ Information Only ☐ Record

REMARKS OR DEVIATIONS

CONTRACTOR / CM CERTIFICATION
(SUBMITTALS NOT CERTIFIED WILL BE RETURNED WITHOUT REVIEW)



PARIC CORPORATION
SUBMITTAL STAMP

THIS SHOP DRAWING HAS BEEN REVIEWED BY PARIC CORPORATION

Subcontractor remains responsible for dimensions, quantities, coordination with other trades and compliance with contract documents.

Ry:

By:
Devin D. Gates

REVIEWED BY	DATE

A/E COMMENTS

- ☐
- See attached sheet(s) for additional comments

REVIEWED BY	DATE



77 Westport Plaza
Suite 250
St. Louis, MO 63146

TRANSMITTAL

No. 15051-0453

Paric Corporation

PROJECT: 15051-Webster University Interdisciplinary Science Building

DATE: 01/17/2017

TO: Cannon Design
1100 Clark Ave
St Louis MO 63102

Fax;
314-241-2203

RE: Mechanical insulation product data

ATTN: Kelvin Patel

JOB: 15051

WE ARE SENDING:		SUBMITTED FOR:	ACTION TAKEN:
☐ Shop Drawings		☒ Approval	☐ Approved as Submitted
☐ Letter		☐ Your Use	☐ Approved as Noted
☐ Prints		☐ As Requested	☐ Returned After Loan
☐ Change Order		☐ Review and Comment	☐ Resubmit
☐ Plans			☐ Submit
☐ Samples		SENT VIA:	☐ Returned
☐ Specifications		☐ Attached	☐ Returned for Corrections
☒ Other: Product Data		☐ Separate Cover Via:	☒ Due Date: 08/26/2016

Item	Package	Code	Rev.	Copies	Date	Description	Status
Submittal		232500-001	1		01/17/2017	Mechanical insulation product data	Submitted

NOTES:

CC:

Signed: _____
Devin Gates



Mechanical

LETTER OF TRANSMITTAL

TO: Paric Corporation

77 West Port Plaza #250

St. Louis, MO 63146

ATTN: Jason Szachnieski, Devin Gates

DATE: 1/16/17

JOB #: 5768

RE: Webster ISB

We are sending you

☒

Shop drawings

☐ Attached

☐ Prints

☐ Under separate cover

☐ Plans

☐ Samples

☐ Specifications

☐ Copy of letter

☐ Change order

☐ Other

COPIES	DATE	NO.	DESCRIPTION
1	1/16/17	232500	Mechanical Insulation

These are transmitted as checked below:

☐ For signature

☐ For your use

☐ As requested

☐ For bids due

☒

For review and comment

☐ Approved as submitted

☐ Approved as noted

☐ Returned for corrections

☐ Prints returned after loan to us

☐ Other

☐ Resubmit

☒ Submit

☐ Return

☐ copies for approval

☐ copies for distribution

☐ corrected prints

Remarks: Please return by 1/24/17

COPY TO: file

SIGNED:

Alex Chambers



Mechanical

Webster University ISB Webster Groves, MO

Submittal #:

232500

Submittal Description:

Mechanical Insulation

Return By:

1/24/17

Please Note: To avoid scheduling delays and equipment release delays, please submit by the "Return By" date.

CHECKED BY:			
DESIGNER:		ENGINEER: X	
X	NO EXCEPTION TAKEN		MAKE CORRECTIONS NOTED
	SUBMIT SPECIFIED ITEM		REVISE AND RESUBMIT
	REJECTED		
Checking is only for general conformance with the design concept of the project and general compliance with the information given in the contract documents. Any action shown is subject to the requirements of the plans and specifications. Equipment supplier is responsible for: dimensions which shall be confirmed and correlated at the job site; fabrication processes and techniques of construction; coordination of his work with that of all other trades; and satisfactory performance of his work.			
		Job #:	5768
		Date:	1/16/17
		By:	ARC